



FULL KPI MATRIX

CATEGORY	2025	2026	TOTAL
A. Production			
Measured (MWh)	35,859	238,841	274,700
Deviation Historical	-	-	-
Deviation P50	6.1%	-16.4%	-14.1%
Deviation P90	18.8%	-6.4%	-3.7%
Capacity Factor	33.1%	37.8%	37.1%
Electrical Losses	1.4%	0.8%	0.9%
B. Consumption			
Measured Consumption (MWh)	0	120	120
Ratio to Production	0.0%	0.1%	0.1%
C. Availability			
Contractual availability	99.0%	98.1%	98.2%
Technical availability	92.8%	91.3%	91.5%
Technical availability - Energy based	97.9%	96.7%	96.8%
D. Downtime			
Manufacturer	0.000%	0.875%	0.750%
Owner	0.000%	0.029%	0.025%
Environmental	0.000%	0.071%	0.061%
Utility	0.000%	0.064%	0.055%
Bat Curtailment	0.000%	0.000%	0.000%
E. Wind			
Forecasted WS (m/s)	8.4 m/s	8.4 m/s	8.4 m/s
Measured WS (m/s)	8.3 m/s	7.8 m/s	7.8 m/s
WindSpeed Deviation	-1.6%	-7.2%	-6.4%


PRODUCTION VS TARGET

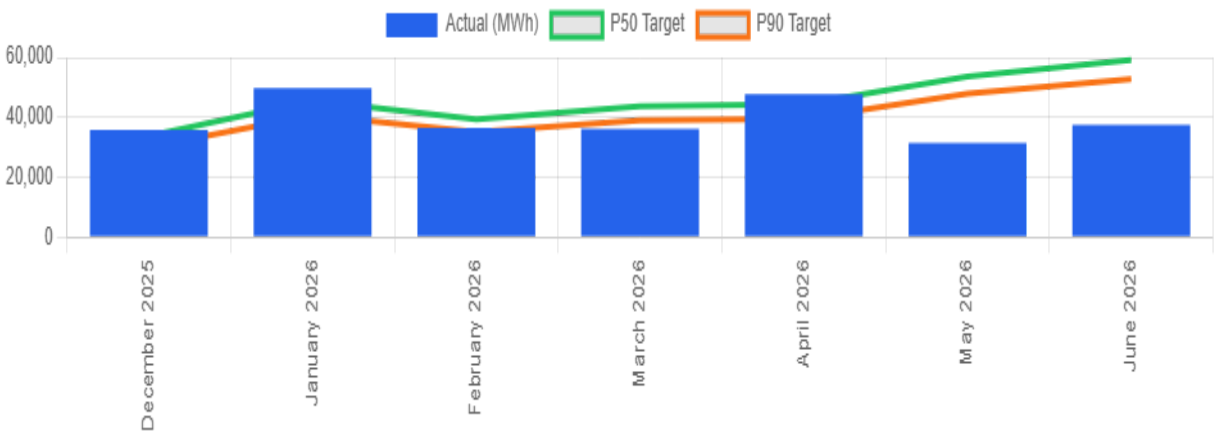


TURBINE-LEVEL PRODUCTION & AVAILABILITY

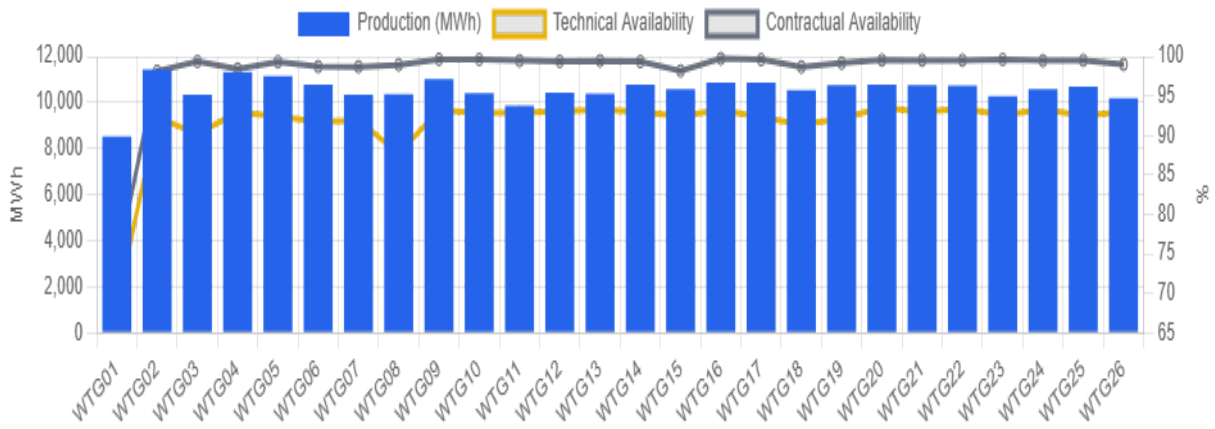


AVAILABILITY TREND

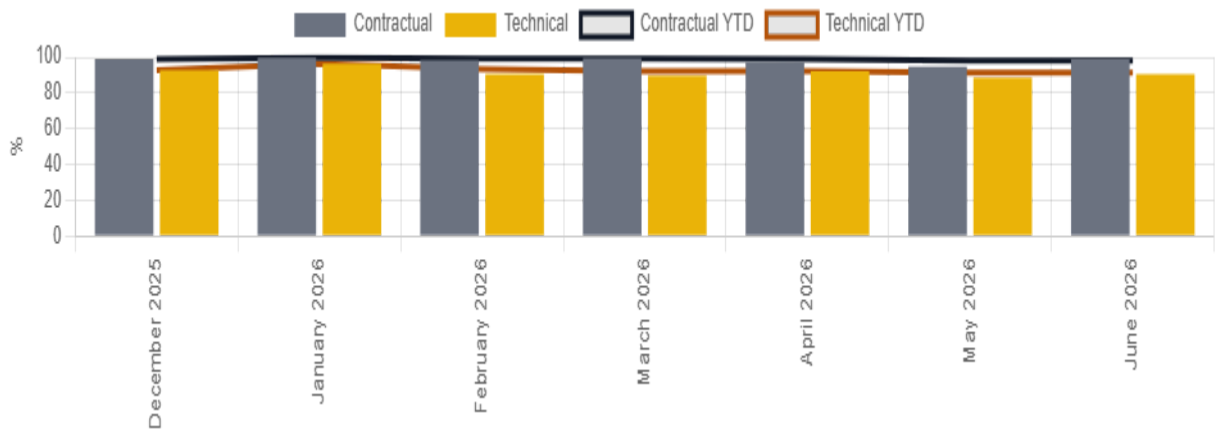

WIND RESOURCE

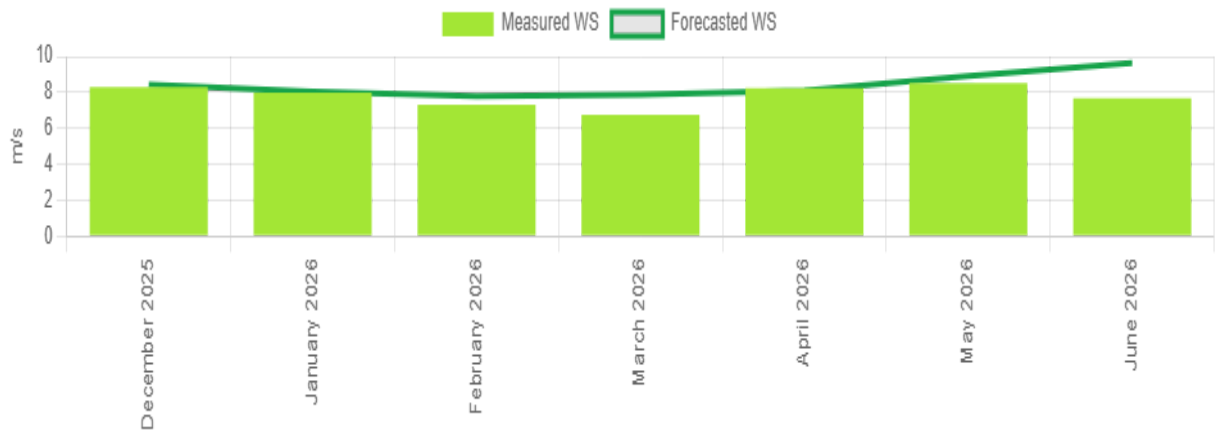

DOWNTIME BY CAUSE

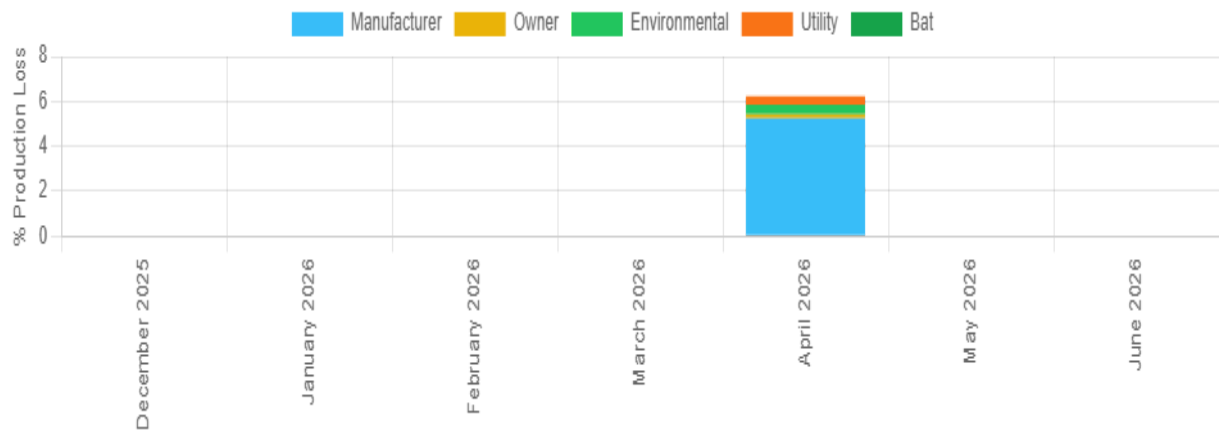

Plant Analysis Reports · San Kraal · Full history · Source: P&O_Custom_Semantic_Model (PowerBI)