


FULL KPI MATRIX

CATEGORY	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production									
Measured (MWh)	35,859	238,841	49,681	36,513	36,070	47,694	31,450	37,433	274,700
Deviation Historical	–	–	–	–	–	–	–	–	–
Deviation P50	6.1%	-16.4%	9.0%	-7.4%	-17.5%	7.5%	-41.3%	-36.7%	-14.1%
Deviation P90	18.8%	-6.4%	22.1%	3.8%	-7.6%	20.5%	-34.3%	-29.1%	-3.7%
Capacity Factor	33.1%	37.8%	45.9%	37.3%	33.3%	45.5%	29.0%	35.7%	37.1%
Electrical Losses	1.4%	0.8%	1.1%	-0.7%	1.5%	1.6%	0.7%	–	0.9%
B. Consumption									
Measured Consumption (MWh)	0	120	28	26	34	16	16	–	120
Ratio to Production	0.0%	0.1%	0.1%	0.1%	0.1%	0.0%	0.1%	–	0.1%
C. Availability									
Contractual availability	99.0%	98.1%	99.8%	98.4%	99.6%	97.2%	94.6%	98.8%	98.2%
Technical availability	92.8%	91.3%	96.3%	90.4%	89.7%	92.1%	88.5%	90.4%	91.5%
Technical availability - Energy based	97.9%	96.7%	98.9%	96.8%	98.8%	96.1%	91.0%	98.3%	96.8%
D. Downtime									
Manufacturer	0.000%	0.875%	0.000%	0.000%	0.000%	5.248%	0.000%	0.000%	0.750%
Owner	0.000%	0.029%	0.000%	0.000%	0.000%	0.172%	0.000%	0.000%	0.025%
Environmental	0.000%	0.071%	0.000%	0.000%	0.000%	0.427%	0.000%	0.000%	0.061%
Utility	0.000%	0.064%	0.000%	0.000%	0.000%	0.383%	0.000%	0.000%	0.055%
Bat Curtailment	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
E. Wind									
Forecasted WS (m/s)	8.4 m/s	8.4 m/s	8.1 m/s	7.8 m/s	7.9 m/s	8.1 m/s	8.9 m/s	9.6 m/s	8.4 m/s
Measured WS (m/s)	8.3 m/s	7.8 m/s	8 m/s	7.3 m/s	6.8 m/s	8.3 m/s	8.5 m/s	7.7 m/s	7.8 m/s
WindSpeed Deviation	-1.6%	-7.2%	-0.7%	-5.9%	-14.1%	2.0%	-4.4%	-20.3%	-6.4%

PRODUCTION VS TARGET




TURBINE-LEVEL PRODUCTION & AVAILABILITY

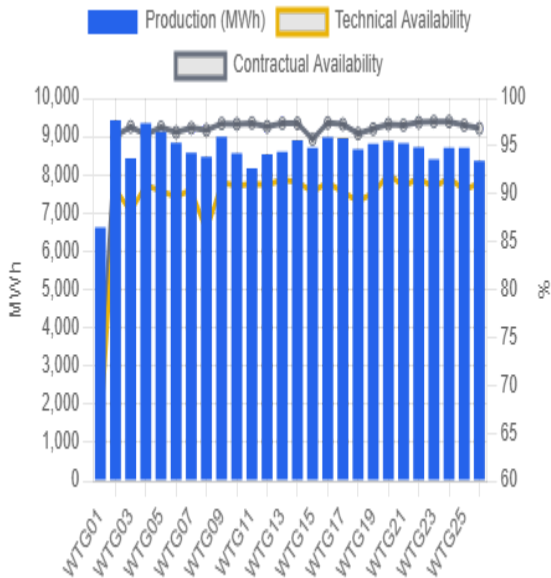


AVAILABILITY TREND



DOWNTIME BY CAUSE

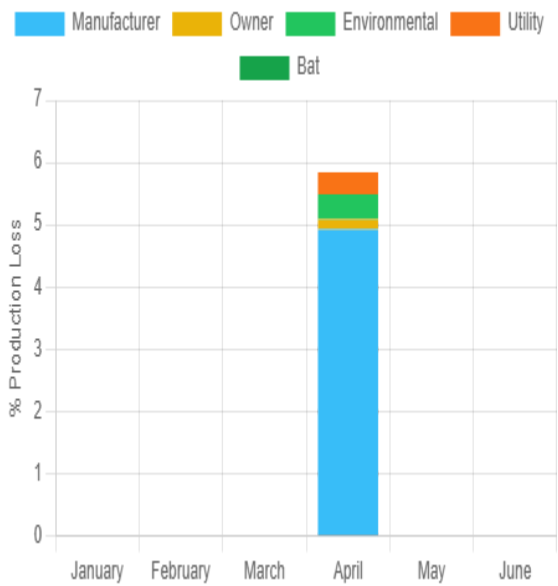

WIND RESOURCE

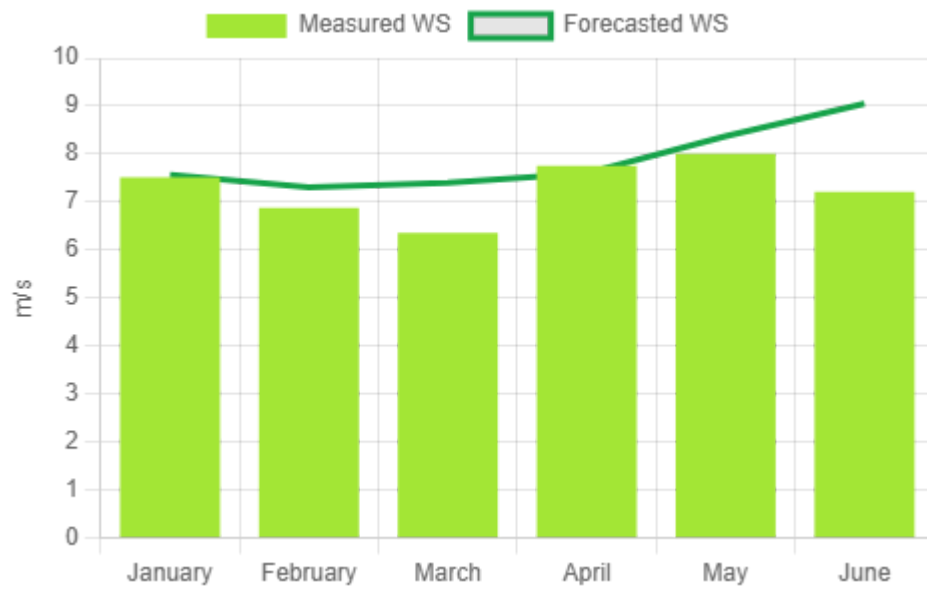

Plant Analysis Reports · San Kraal · Full history table, 2026 dashboard · Source: P&O_Custom_Semantic_Model (PowerBI)