


FULL KPI MATRIX

| CATEGORY                              | 2022    | 2023    | 2024    | 2025    | 2026    | JAN     | FEB     | MAR     | APR     | MAY     | JUN     | TOTAL   |
|---------------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| A. Production                         |         |         |         |         |         |         |         |         |         |         |         |         |
| Measured (MWh)                        | 91,310  | 93,813  | 93,177  | 87,626  | 39,791  | 6,458   | 5,488   | 5,741   | 7,302   | 6,946   | 7,856   | 405,717 |
| Deviation Historical                  | –       | 3.9%    | 1.8%    | -4.5%   | -5.8%   | 3.3%    | -4.2%   | -16.1%  | 6.5%    | 3.0%    | -19.9%  | -0.4%   |
| Deviation P50                         | –       | –       | –       | –       | -18.9%  | -20.1%  | -18.7%  | -19.8%  | -7.3%   | -21.9%  | -23.9%  | -18.9%  |
| Deviation P90                         | –       | –       | –       | –       | -6.9%   | -8.2%   | -6.6%   | -7.9%   | 6.5%    | -10.3%  | -12.6%  | -6.9%   |
| Capacity Factor                       | 42.4%   | 43.4%   | 43.1%   | 40.6%   | 37.2%   | 35.3%   | 33.2%   | 31.4%   | 41.2%   | 38.0%   | 44.4%   | 41.8%   |
| Electrical Losses                     | 1.2%    | 1.0%    | 1.2%    | 0.6%    | 1.2%    | 1.1%    | 1.1%    | 1.2%    | 1.2%    | 1.2%    | –       | 1.0%    |
| B. Consumption                        |         |         |         |         |         |         |         |         |         |         |         |         |
| Measured Consumption (MWh)            | 100     | 83      | 117     | 118     | 82      | 15      | 12      | 19      | 19      | 17      | –       | 500     |
| Ratio to Production                   | 0.1%    | 0.1%    | 0.1%    | 0.1%    | 0.3%    | 0.2%    | 0.2%    | 0.3%    | 0.3%    | 0.3%    | –       | 0.1%    |
| C. Availability                       |         |         |         |         |         |         |         |         |         |         |         |         |
| Contractual availability              | 93.9%   | 88.5%   | 96.3%   | 96.9%   | 95.5%   | 96.9%   | 90.2%   | 92.8%   | 98.0%   | 97.9%   | 97.0%   | 94.1%   |
| Technical availability                | 93.7%   | 88.7%   | 92.9%   | 92.3%   | 91.4%   | 93.0%   | 86.8%   | 86.6%   | 92.1%   | 92.6%   | 97.1%   | 91.9%   |
| Technical availability - Energy based | 97.2%   | 95.6%   | 95.5%   | 95.4%   | 95.7%   | 97.9%   | 89.5%   | 92.6%   | 98.3%   | 98.7%   | 97.5%   | 95.9%   |
| D. Downtime                           |         |         |         |         |         |         |         |         |         |         |         |         |
| Manufacturer                          | 1.105%  | 1.838%  | 1.028%  | 0.994%  | 1.614%  | 0.786%  | 4.142%  | 3.150%  | 1.168%  | 0.439%  | 0.000%  | 1.283%  |
| Owner                                 | 0.007%  | 0.001%  | 0.011%  | 0.000%  | 0.000%  | 0.000%  | 0.000%  | 0.000%  | 0.000%  | 0.000%  | 0.000%  | 0.004%  |
| Environmental                         | 0.007%  | 0.005%  | 0.678%  | 0.736%  | 0.166%  | 0.580%  | 0.400%  | 0.003%  | 0.006%  | 0.007%  | 0.000%  | 0.335%  |
| Utility                               | 0.034%  | 0.006%  | 0.149%  | 0.672%  | 1.101%  | 0.542%  | 0.020%  | 0.539%  | 3.147%  | 2.355%  | 0.000%  | 0.314%  |
| Bat Curtailment                       | 0.000%  | 0.000%  | 0.033%  | 0.137%  | 0.056%  | 0.053%  | 0.062%  | 0.074%  | 0.101%  | 0.047%  | 0.000%  | 0.044%  |
| E. Wind                               |         |         |         |         |         |         |         |         |         |         |         |         |
| Forecasted WS (m/s)                   | 8.2 m/s | 8.2 m/s | 8.2 m/s | 8.2 m/s | 8.1 m/s | 7.9 m/s | 7.8 m/s | 7.6 m/s | 7.4 m/s | 8.4 m/s | 9.3 m/s | 8.2 m/s |
| Measured WS (m/s)                     | 7.6 m/s | 8 m/s   | 7.8 m/s | 7.7 m/s | 7.4 m/s | 6.9 m/s | 7 m/s   | 6.7 m/s | 7.9 m/s | 7.9 m/s | 7.8 m/s | 7.7 m/s |
| WindSpeed Deviation                   | -7.2%   | -3.1%   | -4.7%   | -6.8%   | -8.4%   | -12.8%  | -10.1%  | -11.7%  | 6.3%    | -5.6%   | -16.5%  | -5.8%   |


PRODUCTION VS TARGET




TURBINE-LEVEL PRODUCTION & AVAILABILITY

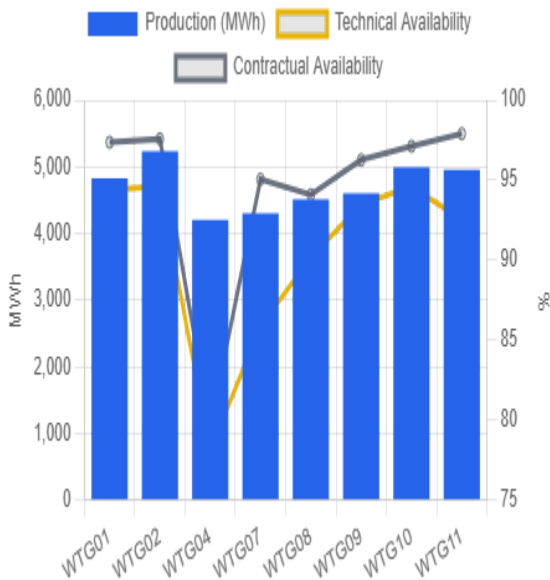


### AVAILABILITY TREND

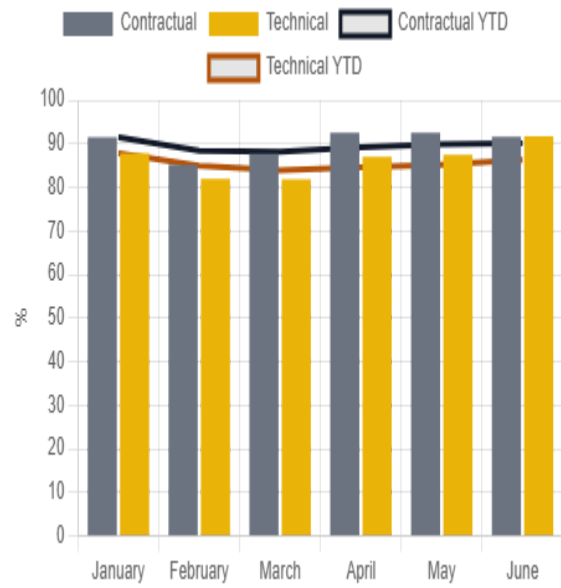

### DOWNTIME BY CAUSE

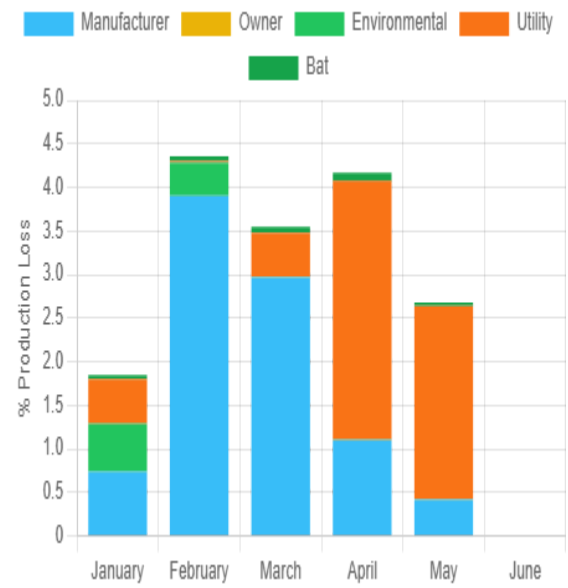

## WIND RESOURCE

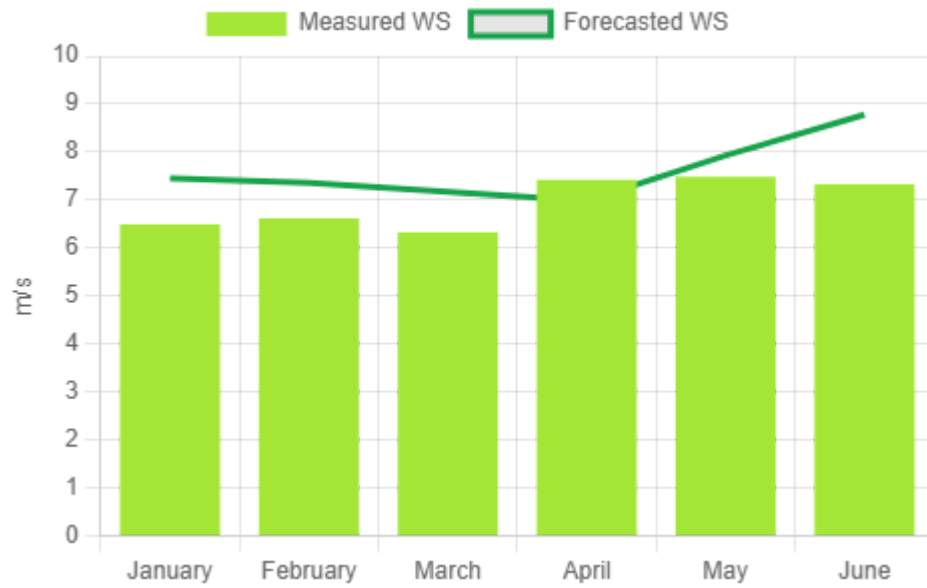

Plant Analysis Reports · Waainek · Full history table, 2026 dashboard · Source: P&O\_Custom\_Semantic\_Model (PowerBI)