



FULL KPI MATRIX

CATEGORY	2022	2023	2024	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production												
Measured (MWh)	56,966	60,670	59,862	54,656	25,259	3,822	3,457	3,927	5,135	4,573	4,347	257,414
Deviation Historical	–	7.0%	2.4%	-6.9%	-5.5%	4.9%	2.8%	-5.9%	23.6%	-7.7%	-32.6%	-0.1%
Deviation P50	-54.8%	-51.9%	-3.9%	-57.9%	-19.2%	-7.2%	-7.0%	-17.0%	-1.3%	-22.2%	-43.1%	-45.9%
Deviation P90	-59.3%	-56.6%	10.0%	-7.5%	-7.6%	6.1%	6.4%	-5.0%	12.9%	-11.0%	-34.9%	-38.8%
Capacity Factor	30.2%	32.1%	31.6%	28.9%	27.0%	23.9%	23.9%	24.5%	33.1%	28.6%	28.0%	30.3%
Electrical Losses	0.6%	0.8%	1.0%	-2.1%	1.2%	1.2%	1.2%	1.3%	1.1%	1.2%	1.2%	0.2%
B. Consumption												
Measured (MWh)	136	131	134	143	96	17	21	19	14	15	10	639
Ratio to Production	0.3%	0.3%	0.2%	0.3%	0.4%	0.5%	0.6%	0.5%	0.3%	0.3%	0.2%	0.3%
C. Availability												
Contractual - Time Based	96.8%	97.2%	97.0%	97.2%	97.2%	97.7%	96.8%	97.1%	98.5%	96.8%	96.2%	97.1%
TBA - Time Based	96.3%	96.9%	94.2%	94.0%	91.4%	93.1%	90.2%	91.5%	91.7%	88.5%	93.4%	94.9%
PBA - Energy Based	97.1%	97.6%	97.8%	97.4%	97.3%	98.1%	97.4%	97.6%	98.9%	95.4%	96.6%	97.4%
D. OLF - Losses												
Manufacturer	3.2%	2.5%	2.3%	2.7%	3.9%	1.9%	2.6%	3.2%	4.0%	6.4%	5.3%	2.8%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Environmental	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Utility	0.2%	0.1%	0.6%	1.1%	2.7%	0.8%	0.0%	1.4%	4.3%	4.2%	5.5%	0.7%
Bat Curtailment	0.0%	0.0%	0.2%	0.6%	0.4%	0.4%	0.8%	0.5%	0.4%	0.7%	0.0%	0.2%
E. Wind												
Forecasted WS (m/s)	7.2	7.2	7.2	7.2	7	6.5	6.5	6.6	6.7	7.5	8.1	7.2
Measured WS (m/s)	6.4	6.6	6.6	6.5	6.3	5.8	5.8	5.9	6.9	6.9	6.5	6.5
WindSpeed Deviation	-11.3%	-8.6%	-8.0%	-10.1%	-9.5%	-11.3%	-11.0%	-10.4%	3.3%	-7.9%	-19.9%	-9.5%


PLANT PRODUCTION

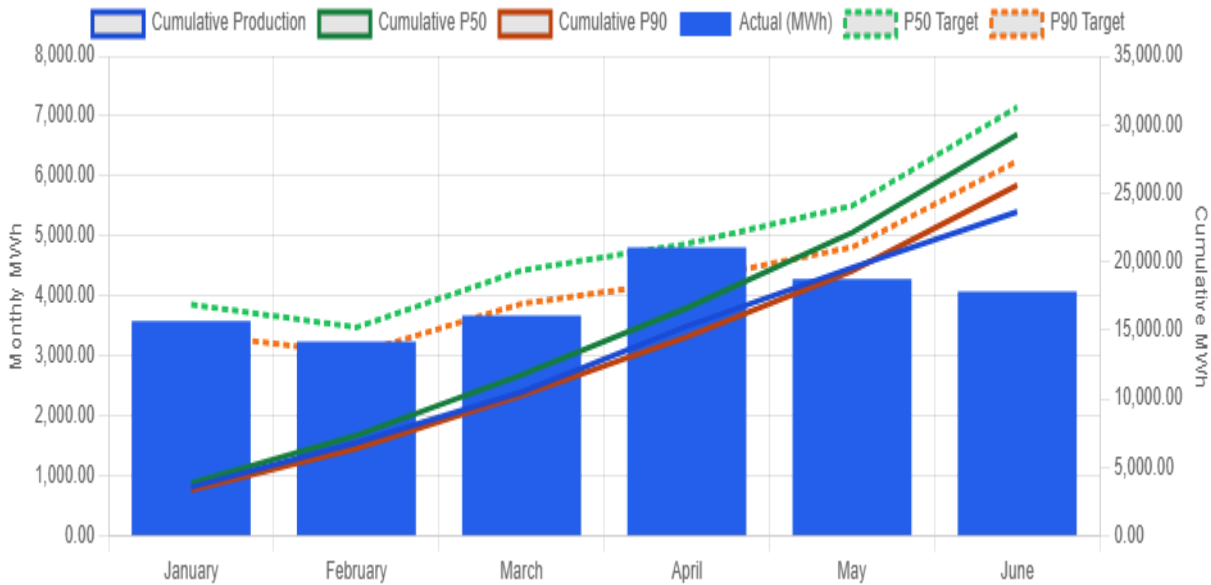


ANNUAL PRODUCTION AND AVAILABILITY PER WT

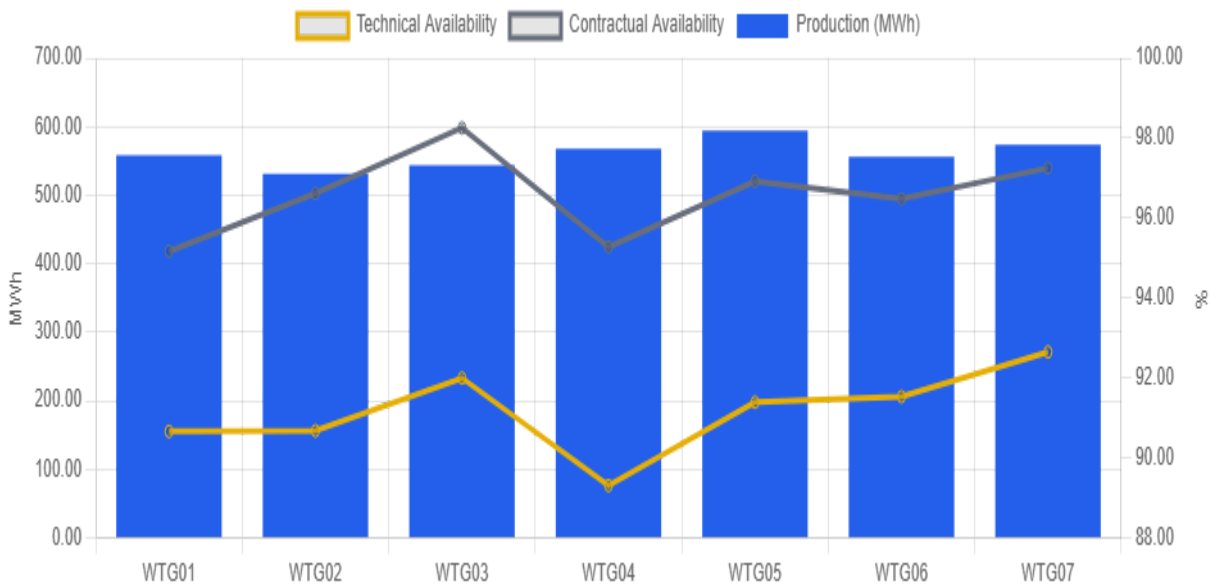

PLANT AVAILABILITY

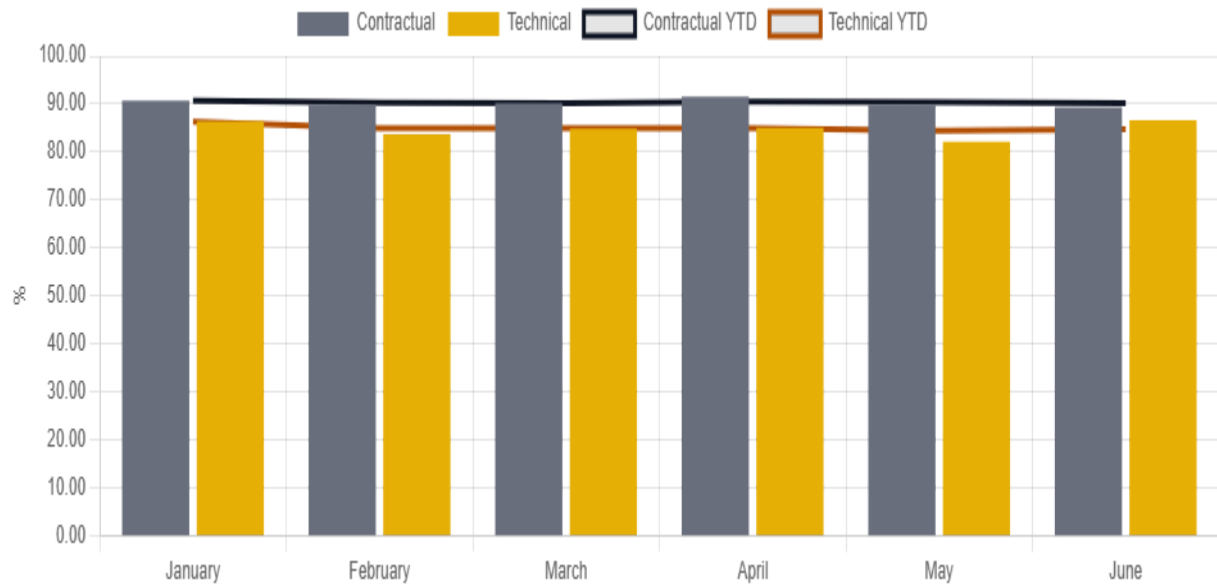

OPERATIONAL LOSS FACTORS

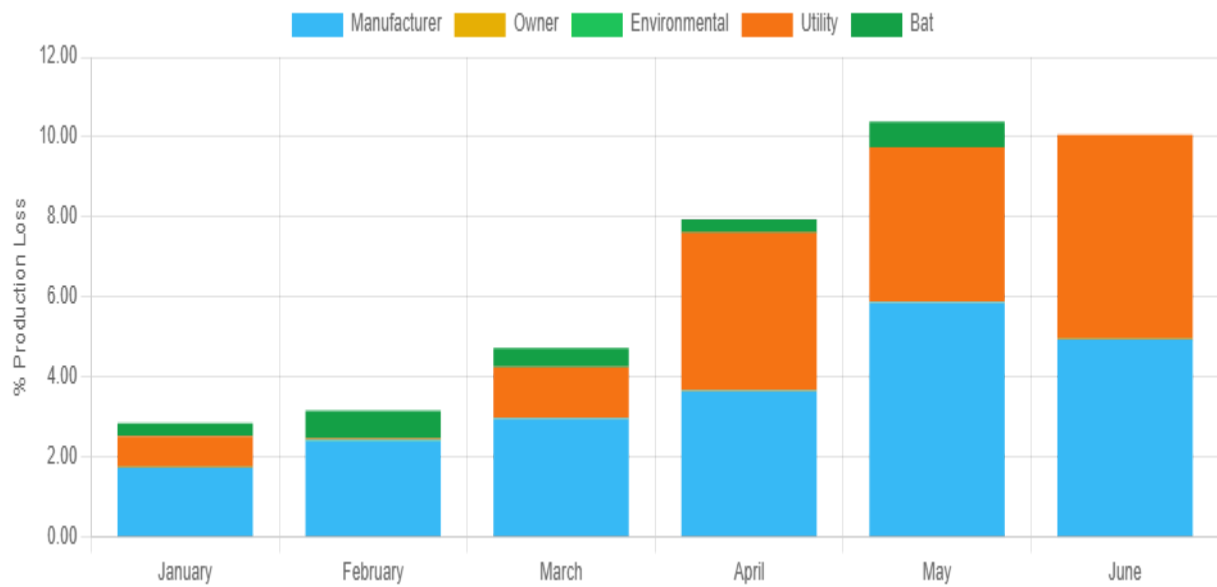

WIND SPEED

