



FULL KPI MATRIX

CATEGORY	2022	2023	2024	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production												
Measured (MWh)	5,484	111,398	134,334	128,319	57,288	10,190	10,568	10,888	9,286	8,534	7,822	436,824
Deviation Historical	–	-13.7%	2.8%	-2.2%	-8.3%	-6.5%	6.8%	-2.2%	-9.4%	-2.0%	-32.6%	-4.9%
Deviation P50	-89.0%	-21.1%	-4.8%	-9.1%	-14.1%	-11.0%	2.4%	-4.9%	-13.5%	-23.5%	-32.5%	-19.1%
Deviation P90	-90.0%	-11.3%	6.9%	2.1%	-3.5%	-0.0%	15.1%	6.8%	-2.9%	-14.1%	-24.2%	-11.1%
Capacity Factor	1.8%	36.8%	44.4%	42.5%	38.3%	39.7%	45.6%	42.4%	37.4%	33.2%	31.5%	32.1%
Electrical Losses	-95.8%	-15.5%	1.6%	0.9%	0.1%	1.4%	0.1%	1.6%	1.7%	-4.6%	0.5%	-24.2%
B. Consumption												
Measured (MWh)	172	174	186	166	111	17	16	19	16	20	23	808
Ratio to Production	0.1%	0.1%	0.1%	0.1%	0.2%	0.2%	0.1%	0.2%	0.2%	0.2%	0.3%	0.1%
C. Availability												
Contractual - Time Based	–	97.3%	96.5%	97.9%	98.4%	99.1%	97.4%	99.3%	98.7%	98.1%	97.9%	97.4%
TBA - Time Based	100.0%	96.6%	95.5%	97.3%	97.5%	99.0%	97.3%	99.0%	94.5%	97.9%	97.1%	97.4%
PBA - Energy Based	4.3%	96.0%	96.6%	98.2%	98.4%	99.0%	97.1%	99.7%	97.7%	98.3%	98.7%	76.5%
D. OLF - Losses												
Manufacturer	0.0%	4.2%	4.2%	2.1%	1.6%	1.0%	2.9%	0.4%	2.3%	1.7%	1.4%	2.5%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Environmental	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Utility	0.0%	0.4%	1.0%	3.4%	7.4%	0.8%	0.7%	7.2%	15.0%	9.7%	10.8%	1.9%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind												
Forecasted WS (m/s)	8.3	8.3	8.3	8.3	7.9	8.1	7.3	8.1	7.6	7.9	8.2	8.3
Measured WS (m/s)	7.8	7.9	8	7.8	7.5	7.3	7.9	7.9	7.7	7.4	6.8	7.8
WindSpeed Deviation	-6.3%	-5.3%	-3.7%	-6.0%	-4.2%	-9.4%	8.8%	-2.0%	0.9%	-6.4%	-17.0%	-5.2%


PLANT PRODUCTION

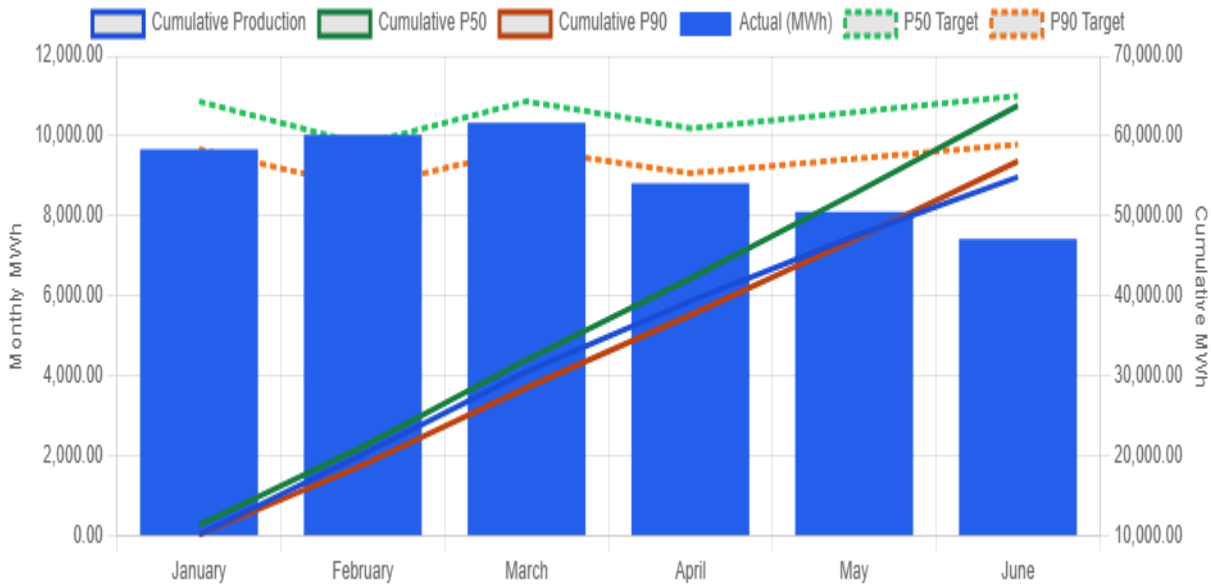


ANNUAL PRODUCTION AND AVAILABILITY PER WT

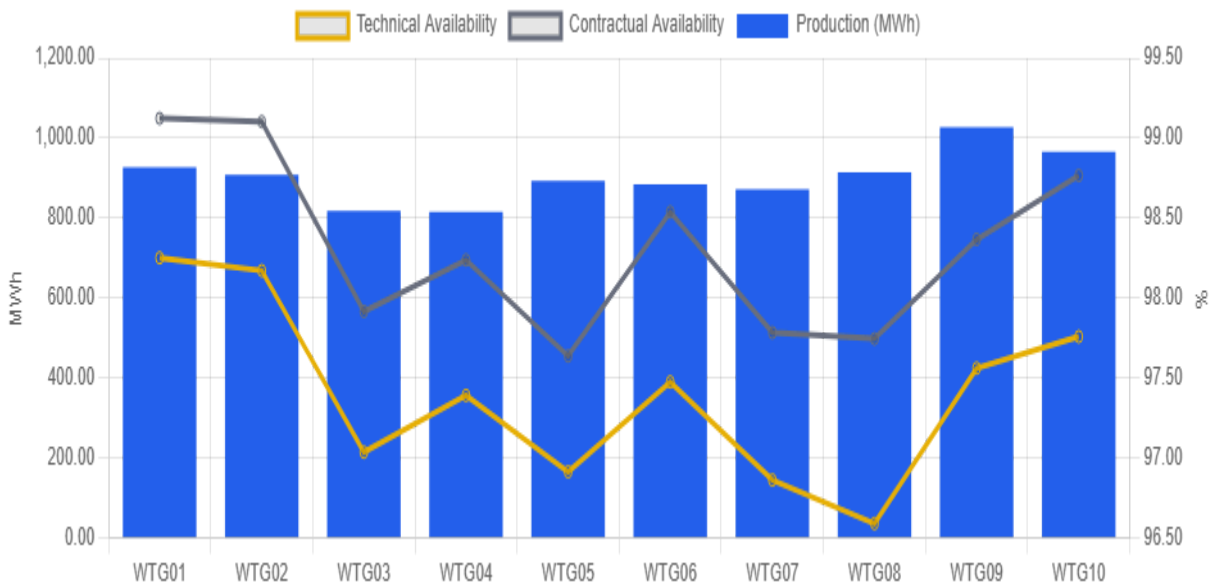

PLANT AVAILABILITY

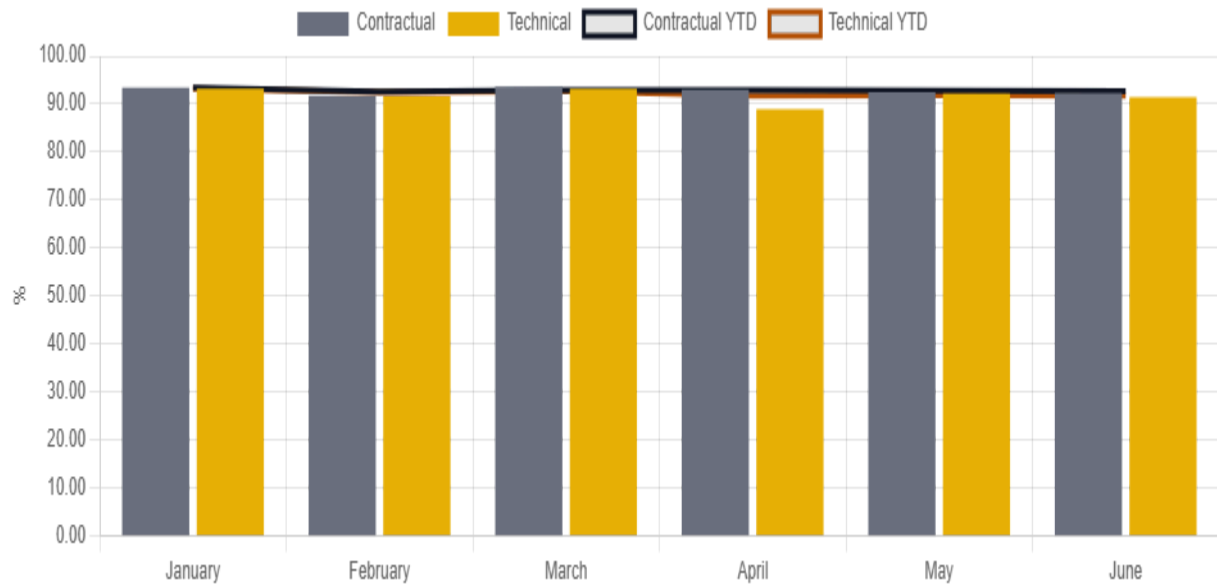

OPERATIONAL LOSS FACTORS

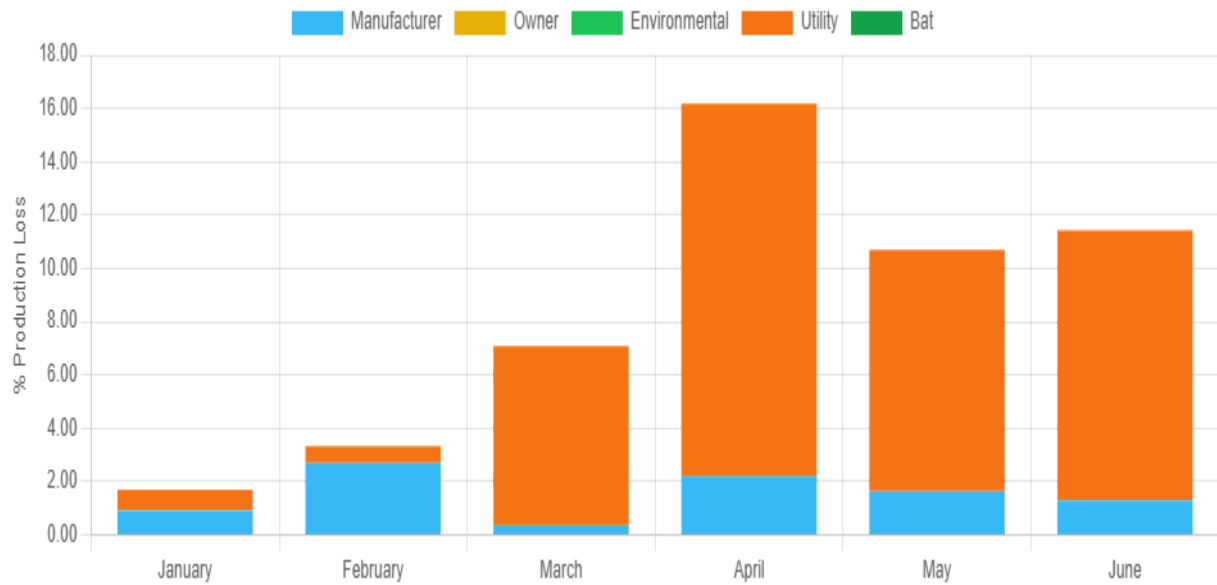

WIND SPEED

