



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production							
Measured (MWh)	158,657	8,096	36,822	44,460	33,537	35,741	158,657
Deviation Historical	–	–	–	–	–	–	–
Deviation P50	-29.1%	-33.2%	-22.6%	-6.6%	-40.1%	-40.9%	-29.1%
Deviation P90	-20.0%	-24.7%	-12.7%	5.4%	-32.4%	-33.3%	-20.0%
Capacity Factor	1.6%	1.7%	0.0%	0.0%	0.0%	6.4%	1.6%
Electrical Losses	-92.1%	-79.1%	-100.0%	-100.0%	-100.0%	-81.4%	-92.1%
B. Consumption							
Measured (MWh)	78	0	28	9	12	29	78
Ratio to Production	0.0%	0.0%	0.1%	0.0%	0.0%	0.1%	0.0%
C. Availability							
TBA - Contractual	100.0%	100.0%	100.0%	100.0%	100.0%	99.9%	100.0%
TBA - Technical	99.7%	99.4%	–	100.0%	100.0%	99.2%	99.7%
PBA - Technical	51.1%	27.2%	0.0%	32.6%	96.3%	99.5%	51.1%
D. OLF - Losses							
Manufacturer	48.9%	72.8%	100.0%	67.3%	3.7%	0.5%	48.9%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Environmental	0.1%	0.0%	0.0%	0.0%	0.0%	0.7%	0.1%
Utility	3.4%	0.0%	0.0%	0.0%	0.0%	16.9%	3.4%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind							
Forecasted WS (m/s)	7.8	7.5	7.5	7.5	8.1	8.7	7.8
Measured WS (m/s)	7.6	6	–	–	–	9.1	7.6
WindSpeed Deviation	-63.0%	-20.3%	-100.0%	-100.0%	-100.0%	5.4%	-63.0%


PLANT PRODUCTION

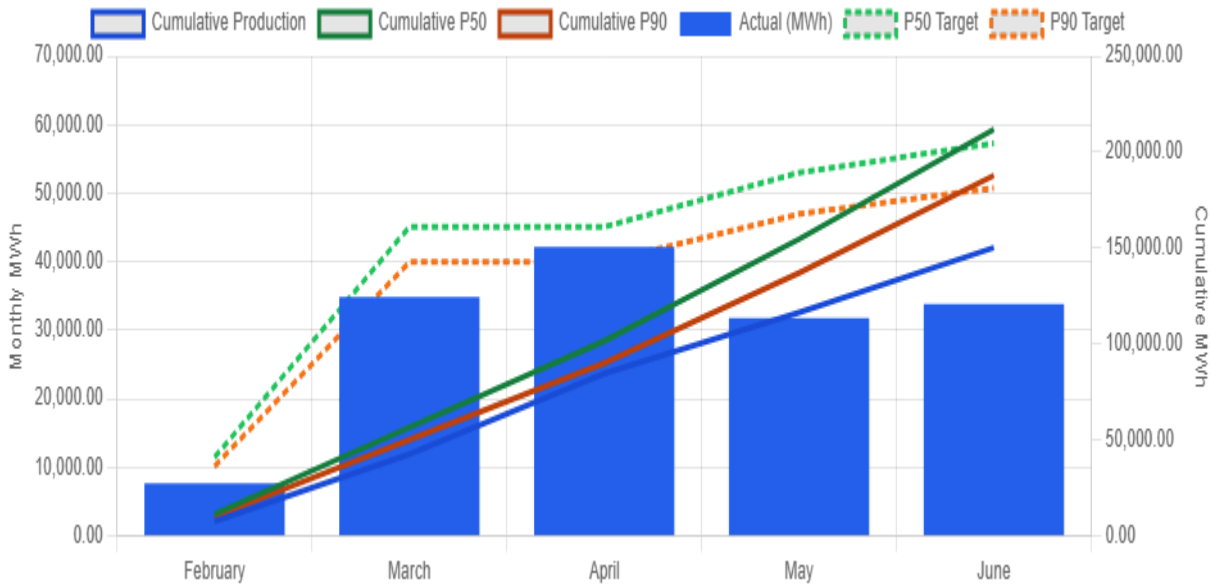


ANNUAL PRODUCTION AND AVAILABILITY PER WT

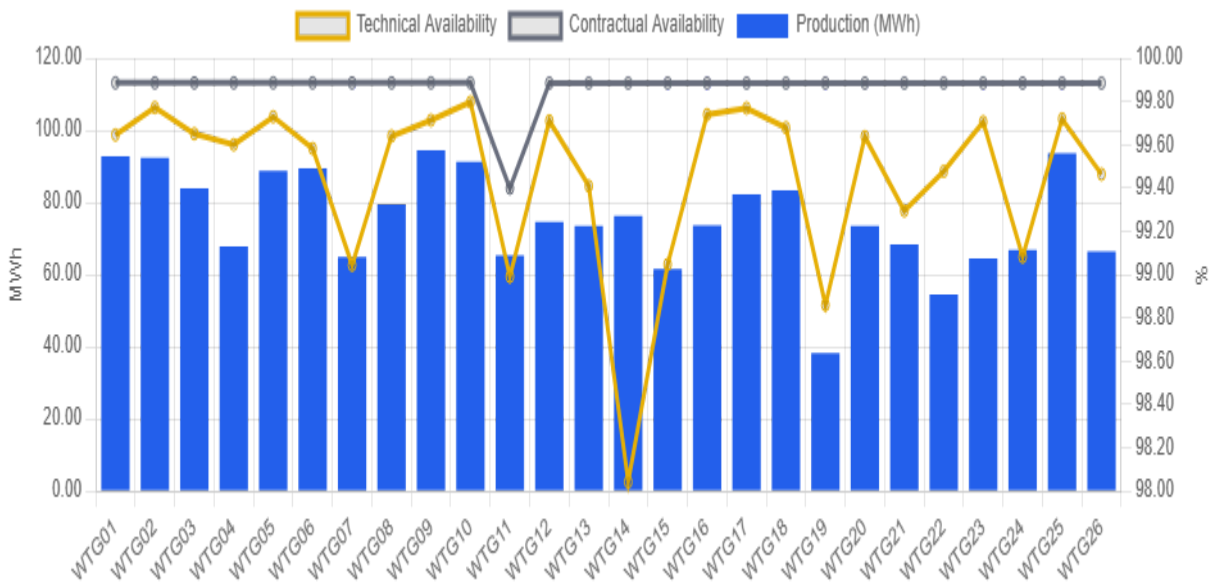

PLANT AVAILABILITY

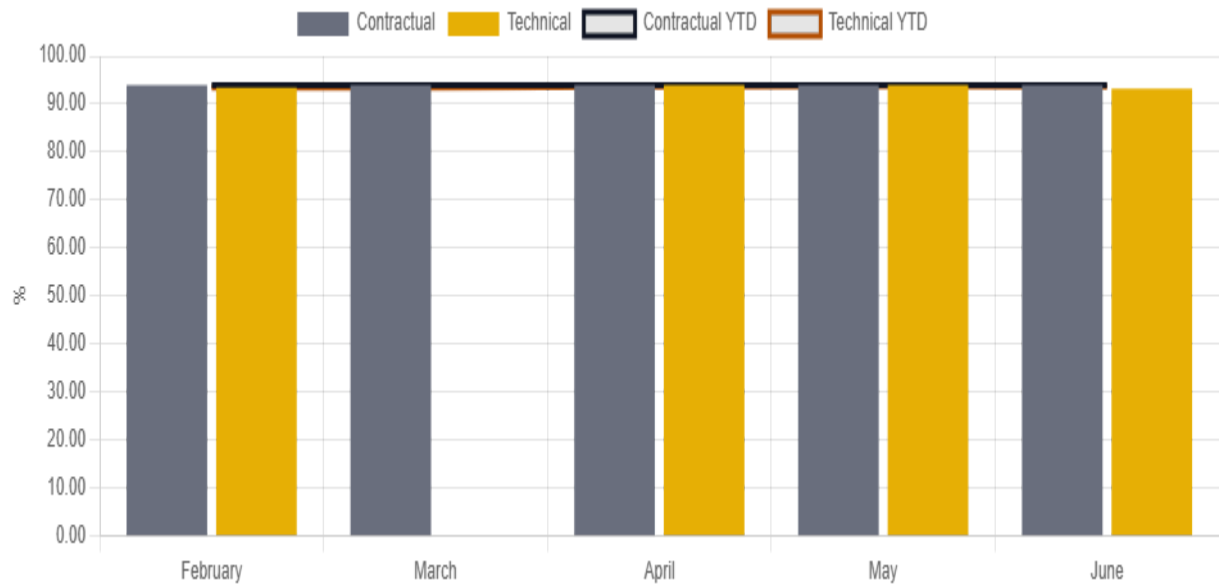

OPERATIONAL LOSS FACTORS

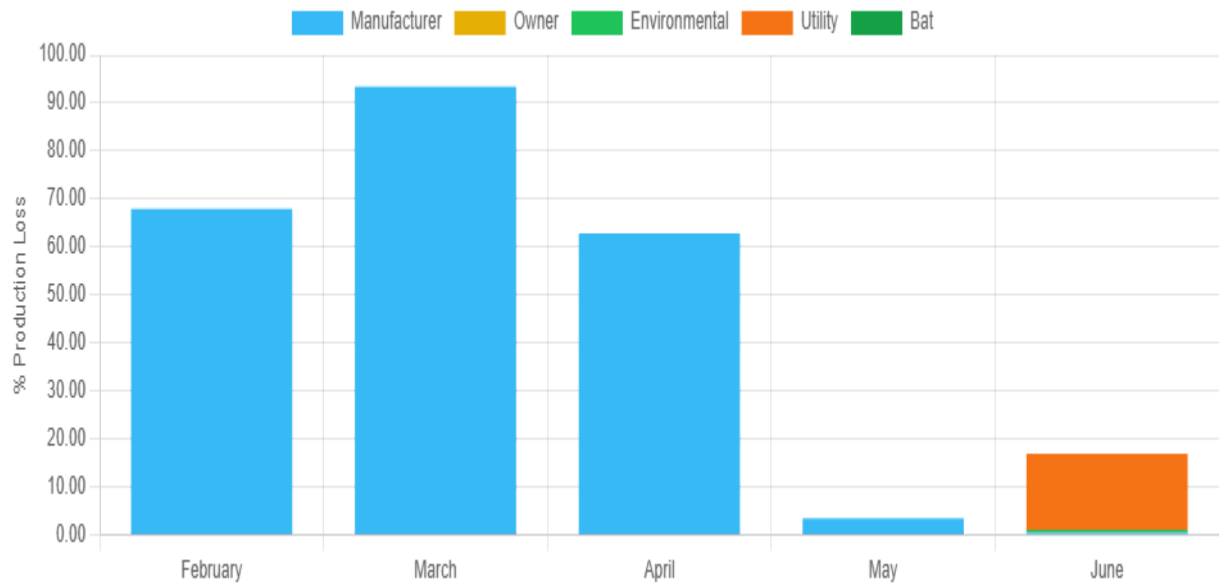

WIND SPEED

