


Chaba: the plant produced 3.5 GWh, significantly below historical, P50 and P90 targets. Contractual availability averaged 98.9%, while technical availability was 98.2%. The negative delta in production was visible in the wind resource deviation of -30%.


FULL KPI MATRIX

CATEGORY	2022	2023	2024	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production													
Measured (MWh)	56,701	60,160	59,270	55,978	28,443	3,776	3,414	3,876	5,080	4,516	4,295	3,485	260,552
Deviation Historical	–	6.1%	1.4%	-4.7%	-15.6%	3.7%	1.5%	-7.1%	22.3%	-8.8%	-33.4%	-49.9%	-1.8%
Deviation P50	-5.5%	0.3%	-4.8%	-17.1%	-27.0%	-8.4%	-8.1%	-18.0%	-2.3%	-23.1%	-43.7%	-54.7%	-9.8%
Deviation P90	4.2%	10.6%	8.9%	-5.2%	-16.5%	4.8%	5.1%	-6.3%	11.7%	-12.1%	-35.6%	-48.2%	1.6%
Capacity Factor	30.2%	32.1%	31.6%	28.9%	26.3%	23.9%	23.9%	24.5%	33.1%	28.6%	28.0%	22.1%	30.2%
B. Consumption													
Measured (MWh)	136	131	134	143	116	17	21	19	14	15	10	20	659
Ratio to Production	0.3%	0.3%	0.2%	0.3%	0.4%	0.5%	0.6%	0.5%	0.3%	0.3%	0.2%	0.6%	0.3%
C. Availability													
TBA - Contractual	96.8%	97.2%	97.0%	97.2%	97.6%	97.7%	96.8%	97.1%	98.5%	96.8%	97.2%	98.9%	97.1%
TBA - Technical	96.3%	96.9%	94.2%	94.0%	92.3%	93.1%	90.2%	91.5%	91.7%	88.5%	93.0%	98.2%	94.9%
PBA - Technical	96.6%	97.3%	96.9%	95.2%	92.9%	96.7%	96.6%	94.9%	91.4%	88.5%	87.7%	94.4%	96.0%
D. Losses Breakdown													
Grid	0.3%	0.3%	1.1%	1.4%	3.0%	1.0%	0.0%	1.4%	4.3%	4.5%	7.1%	2.4%	1.3%
Breakdown	1.9%	1.6%	1.2%	1.6%	1.5%	0.8%	1.4%	1.0%	0.8%	4.4%	1.2%	0.4%	1.6%
Maintenance	1.0%	0.8%	0.8%	0.9%	0.8%	1.0%	1.2%	1.4%	0.3%	0.1%	1.0%	0.4%	0.9%
Partial Perf.	0.4%	0.3%	0.4%	0.4%	2.1%	–	–	0.8%	2.9%	1.7%	2.9%	2.2%	0.7%
Environmental	0.0%	0.0%	0.0%	0.1%	0.1%	0.0%	–	–	–	0.1%	–	–	0.1%
Data Quality	–	0.1%	0.3%	–	–	–	–	–	–	–	–	–	0.3%
Requested Shutdown	0.1%	0.0%	0.0%	0.0%	0.0%	0.1%	0.0%	0.0%	–	0.1%	0.0%	–	0.0%
Electrical Losses	0.6%	0.8%	1.0%	-2.9%	1.1%	1.2%	1.2%	1.2%	1.0%	1.1%	1.0%	1.3%	0.0%
BoP	0.0%	0.0%	0.0%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%
Bat	0.1%	0.1%	0.6%	2.0%	0.5%	0.4%	0.8%	0.5%	0.4%	0.7%	–	–	0.8%
E. Wind													
Forecasted WS (m/s)	7.2	7.2	7.2	7.2	7.1	6.5	6.5	6.6	6.7	7.5	8.1	7.9	7.2
Measured WS (m/s)	6.4	6.6	6.6	6.5	6.2	5.8	5.8	5.9	6.9	6.9	6.5	5.6	6.5
WindSpeed Deviation	-11.3%	-8.6%	-8.0%	-10.1%	-12.4%	-11.3%	-11.0%	-10.4%	3.3%	-7.9%	-19.9%	-29.6%	-9.9%


PLANT PRODUCTION

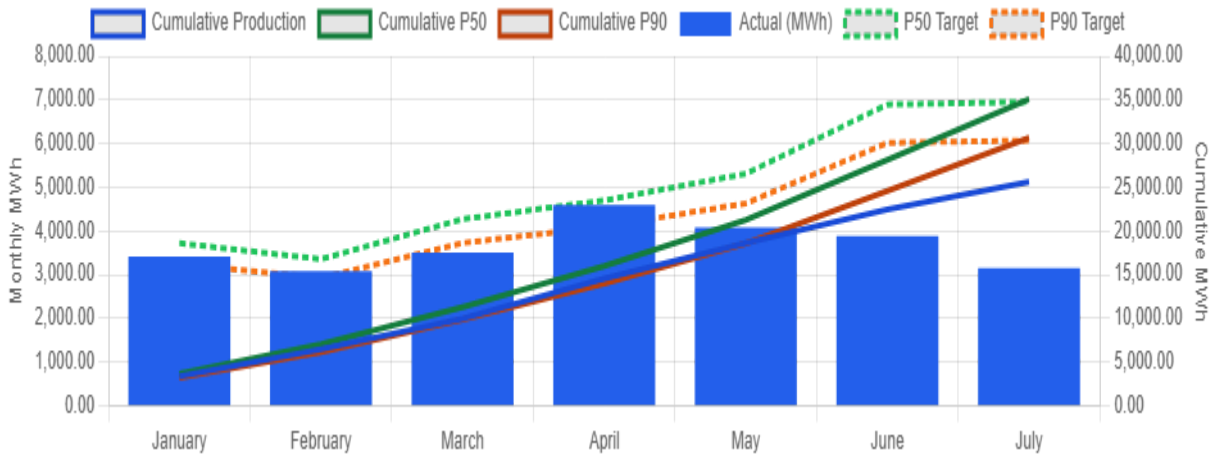


PLANT AVAILABILITY

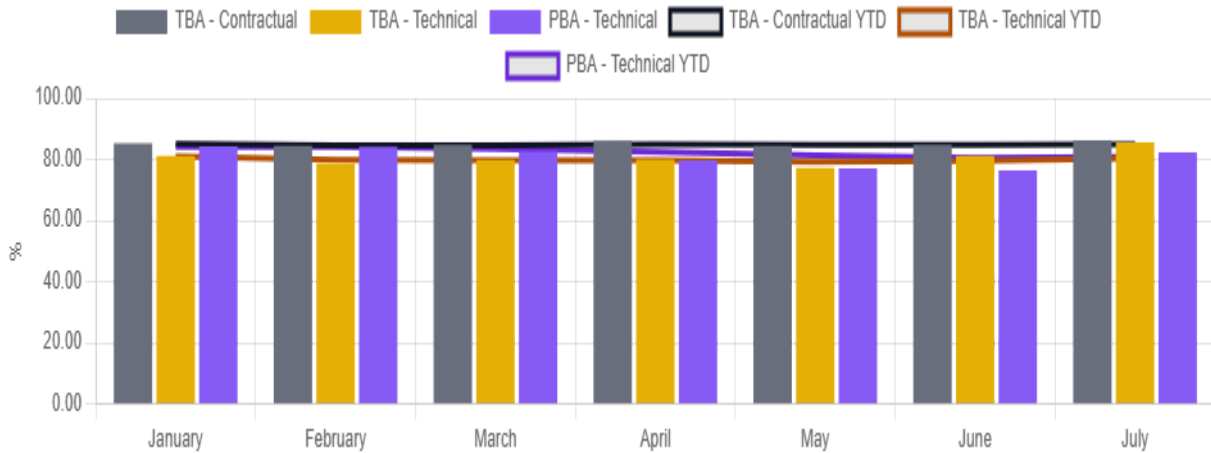

WIND SPEED

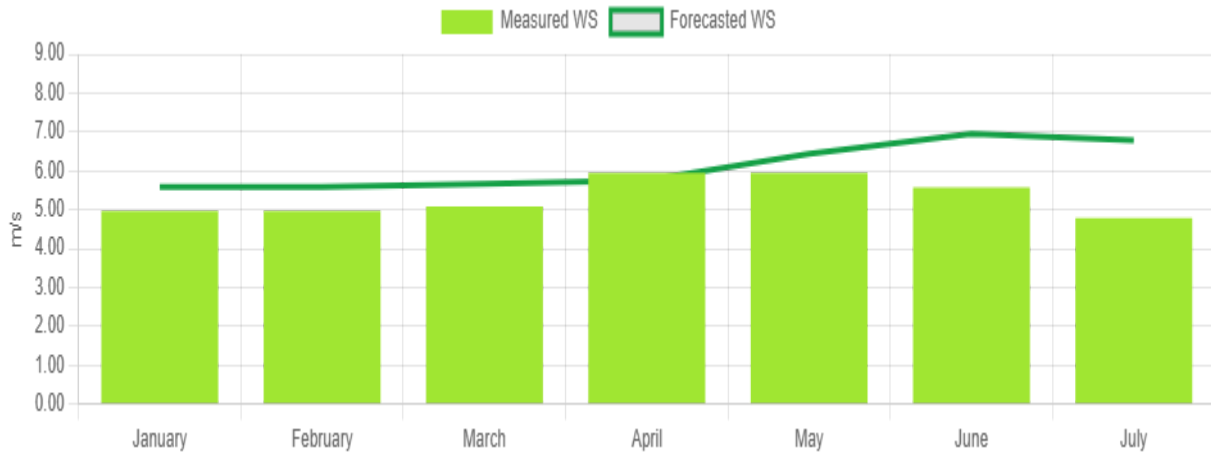

ANNUAL PRODUCTION AND AVAILABILITY PER WT

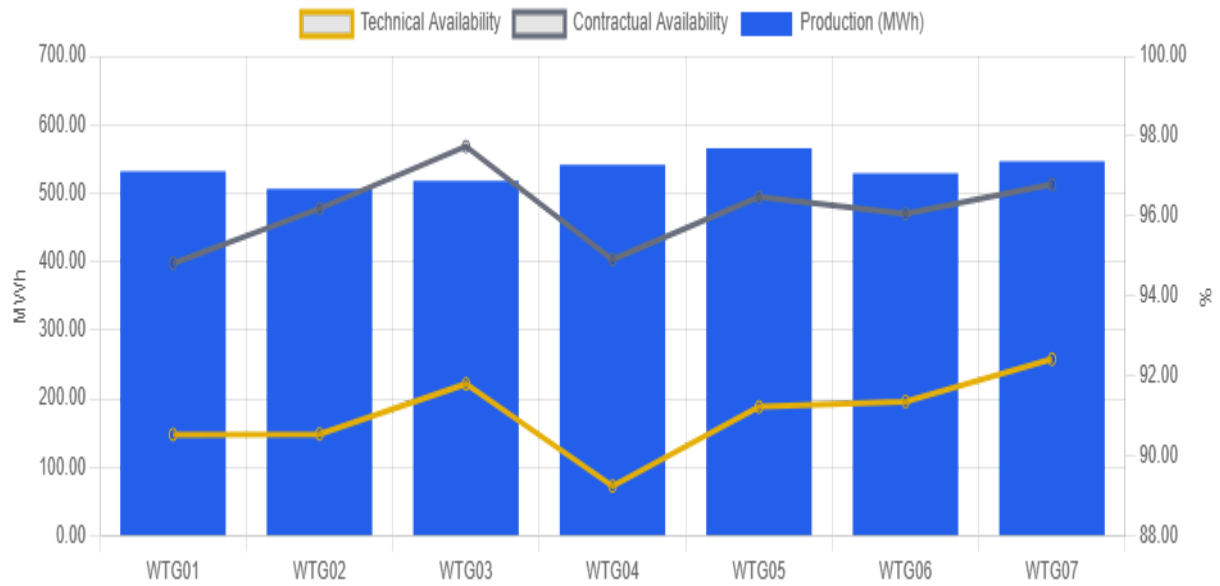

LOSSES BREAKDOWN

