


Waainek: the plant produced 5.7 GWh, significantly below historical, P50 and P90 targets. Contractual availability averaged 98.6%, while technical availability was lower at 85.9%. The negative delta in production was visible in the wind resource deviation of -18%.


FULL KPI MATRIX

CATEGORY	2022	2023	2024	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production													
Measured (MWh)	90,260	92,833	92,112	87,117	45,063	6,386	5,427	5,675	7,217	6,864	7,770	5,726	407,386
Deviation Historical	–	2.9%	0.6%	-5.0%	-14.2%	2.1%	-5.2%	-17.1%	5.3%	1.8%	-20.8%	-44.3%	-2.7%
Deviation P50	-11.7%	-9.2%	-9.9%	-14.8%	-21.7%	-21.0%	-19.6%	-20.7%	-8.4%	-22.9%	-24.8%	-32.5%	-12.7%
Deviation P90	1.4%	4.3%	3.5%	-2.1%	-10.1%	-9.2%	-7.6%	-8.9%	5.3%	-11.4%	-13.6%	-22.5%	0.3%
Capacity Factor	42.4%	43.4%	43.1%	40.6%	36.4%	35.3%	33.2%	31.4%	41.2%	38.0%	44.4%	31.7%	41.6%
B. Consumption													
Measured (MWh)	100	83	117	118	100	15	12	19	19	17	8	9	517
Ratio to Production	0.1%	0.1%	0.1%	0.1%	0.2%	0.2%	0.2%	0.3%	0.3%	0.3%	0.1%	0.2%	0.1%
C. Availability													
TBA - Contractual	93.9%	88.5%	96.3%	96.9%	96.5%	96.9%	90.2%	92.8%	98.0%	99.5%	99.3%	98.6%	94.2%
TBA - Technical	93.7%	88.7%	92.9%	92.3%	90.6%	93.0%	86.8%	86.6%	92.1%	92.6%	97.1%	85.9%	91.7%
PBA - Technical	97.1%	95.5%	95.0%	93.2%	89.9%	93.6%	88.1%	89.2%	88.0%	90.3%	96.7%	83.6%	94.5%
D. Losses Breakdown													
Grid	0.2%	0.1%	0.9%	1.8%	5.7%	2.5%	0.1%	1.4%	10.0%	8.0%	2.9%	14.9%	2.2%
Breakdown	2.3%	3.9%	1.6%	1.1%	3.1%	1.0%	10.1%	6.7%	1.3%	1.2%	0.1%	1.3%	2.4%
Maintenance	0.4%	0.4%	0.9%	0.6%	0.3%	0.6%	0.3%	0.5%	0.4%	0.0%	0.0%	0.0%	0.5%
Partial Perf.	0.2%	0.1%	0.1%	0.2%	0.2%	0.5%	0.2%	0.1%	0.0%	–	0.3%	0.0%	0.2%
Environmental	0.0%	0.0%	0.2%	0.1%	1.3%	1.6%	1.1%	1.7%	–	0.7%	–	–	0.3%
Data Quality	0.1%	–	–	–	–	–	–	–	–	–	–	–	0.1%
Requested Shutdown	0.1%	0.0%	0.1%	0.0%	0.1%	0.0%	–	0.2%	–	0.0%	–	–	0.0%
Electrical Losses	1.1%	0.9%	1.1%	0.5%	1.0%	1.0%	1.0%	1.0%	1.0%	1.1%	1.1%	1.1%	0.9%
BoP	0.0%	0.0%	0.0%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Bat	–	–	0.3%	1.1%	0.2%	0.1%	0.2%	0.2%	0.3%	0.3%	–	–	0.6%
MCR	–	–	11.5%	10.5%	–	–	–	–	–	–	–	–	10.9%
Other	–	–	–	–	0.1%	–	–	0.1%	–	–	–	–	0.1%
E. Wind													
Forecasted WS (m/s)	8.2	8.2	8.2	8.2	8.2	7.9	7.8	7.6	7.4	8.4	9.3	8.7	8.2
Measured WS (m/s)	7.6	8	7.8	7.7	7.3	6.9	7	6.7	7.9	7.9	7.8	7.1	7.7
WindSpeed Deviation	-7.2%	-3.1%	-4.7%	-6.8%	-9.9%	-12.8%	-10.1%	-11.7%	6.3%	-5.6%	-16.5%	-18.5%	-6.0%


PLANT PRODUCTION

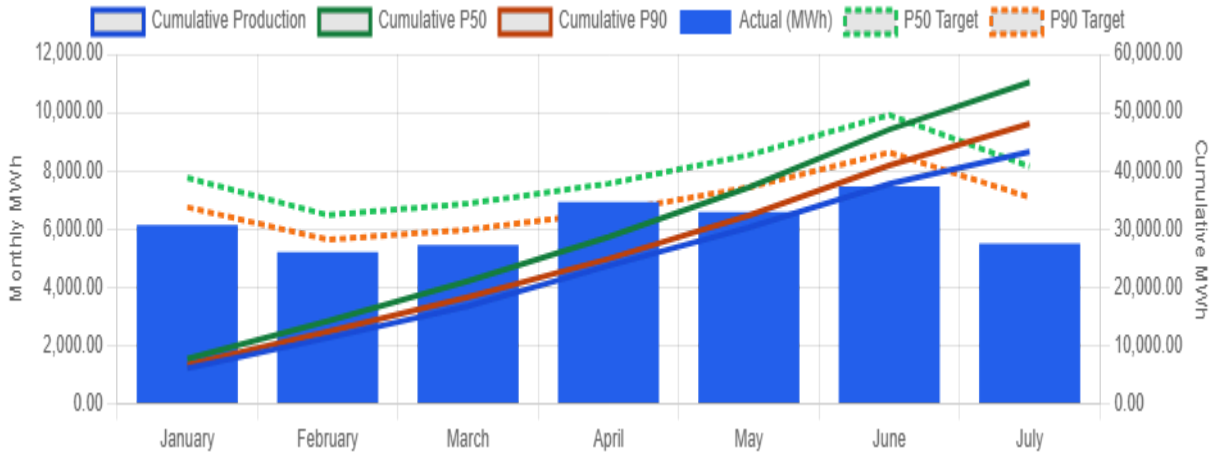


PLANT AVAILABILITY

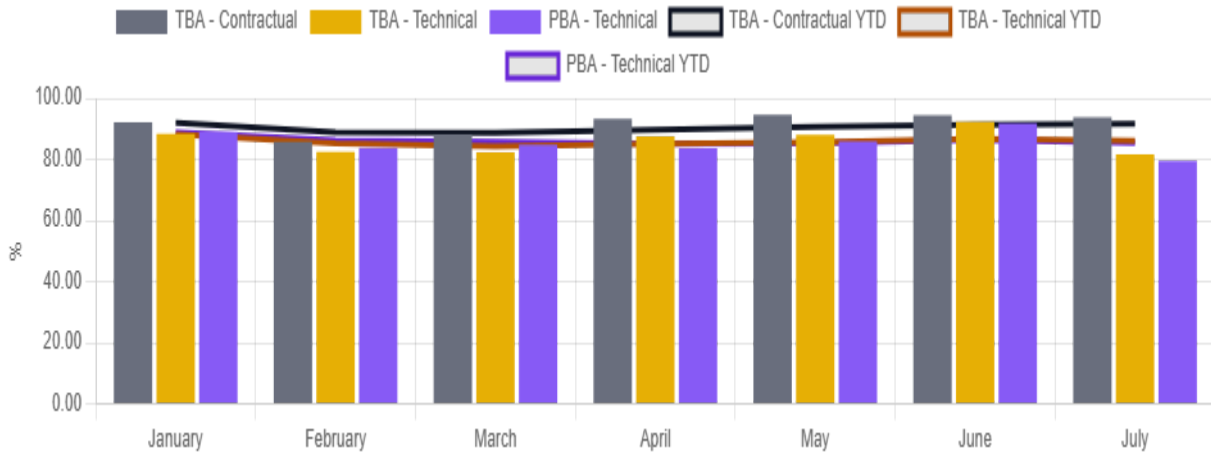

WIND SPEED

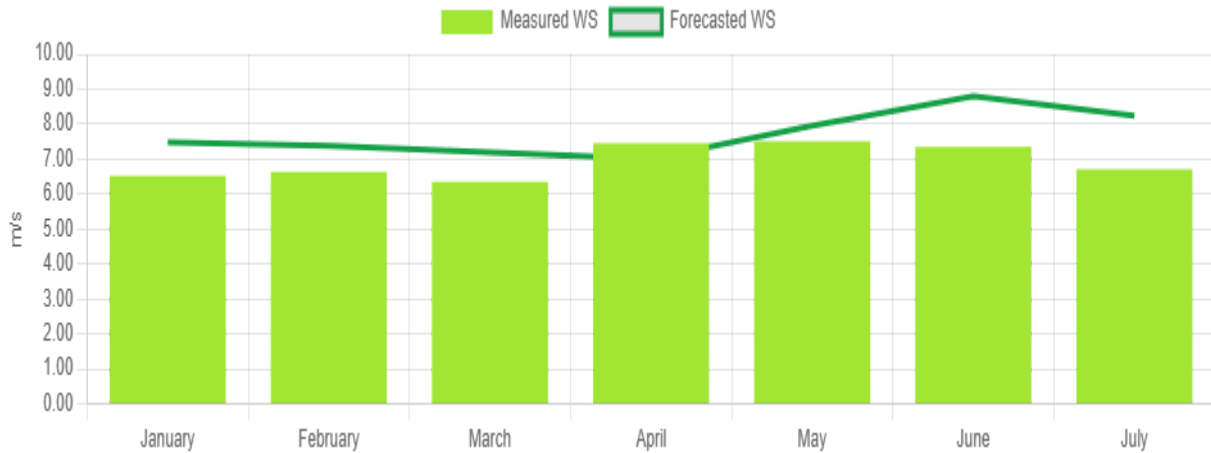

ANNUAL PRODUCTION AND AVAILABILITY PER WT

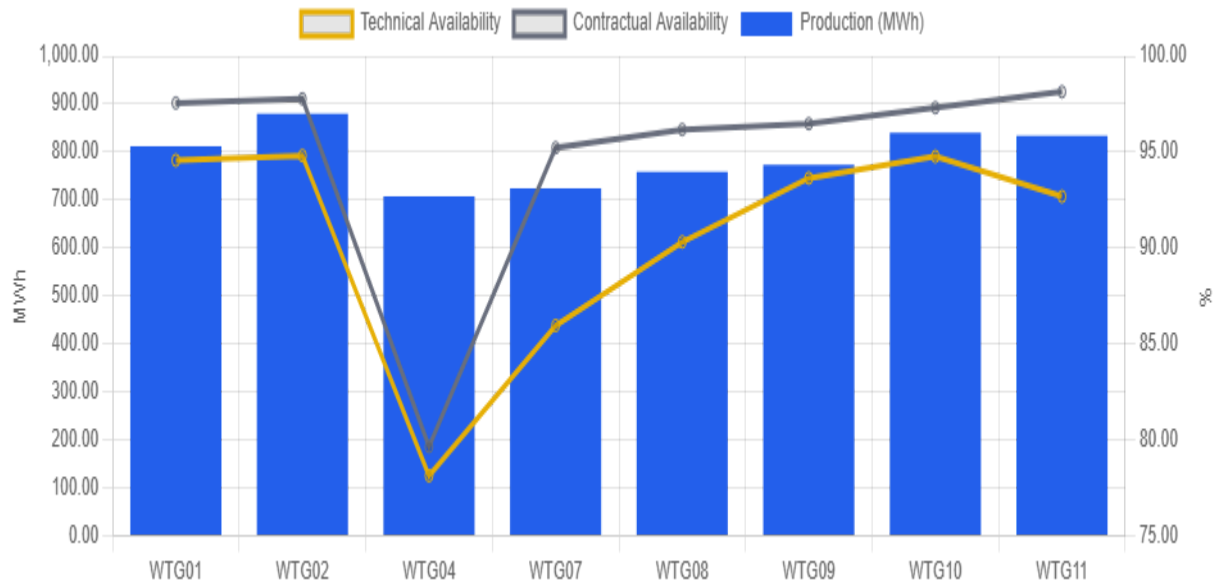

LOSSES BREAKDOWN

