



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production							
Measured (MWh)	8,358	1,694	0	0	0	6,663	8,358
Deviation Historical	–	–	–	–	–	–	–
Deviation P50	-96.3%	-86.0%	-100.0%	-100.0%	-100.0%	-89.0%	-96.3%
Deviation P90	-95.8%	-84.2%	-100.0%	-100.0%	-100.0%	-87.6%	-95.8%
Capacity Factor	1.6%	1.7%	0.0%	0.0%	0.0%	6.4%	1.6%
Electrical Losses	-92.1%	-79.1%	-100.0%	-100.0%	-100.0%	-81.4%	-92.1%
B. Consumption							
Measured Consumption (MWh)	78	0	28	9	12	29	78
Ratio to Production	0.0%	0.0%	0.1%	0.0%	0.0%	0.1%	0.0%
C. Availability							
Contractual availability	100.0%	100.0%	100.0%	100.0%	100.0%	99.9%	100.0%
Technical availability	99.7%	99.4%	–	100.0%	100.0%	99.2%	99.7%
Technical availability - Energy based	51.1%	27.2%	0.0%	32.6%	96.3%	99.5%	51.1%
D. Downtime							
Manufacturer	48.865%	72.772%	100.000%	67.342%	3.734%	0.476%	48.865%
Owner	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
Environmental	0.135%	0.000%	0.000%	0.000%	0.000%	0.677%	0.135%
Utility	3.389%	0.000%	0.000%	0.000%	0.000%	16.945%	3.389%
Bat Curtailment	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
E. Wind							
Forecasted WS (m/s)	7.8 m/s	7.5 m/s	7.5 m/s	7.5 m/s	8.1 m/s	8.7 m/s	7.8 m/s
Measured WS (m/s)	7.6 m/s	6 m/s	–	–	–	9.1 m/s	7.6 m/s
WindSpeed Deviation	-63.0%	-20.3%	-100.0%	-100.0%	-100.0%	5.4%	-63.0%


PRODUCTION VS TARGET

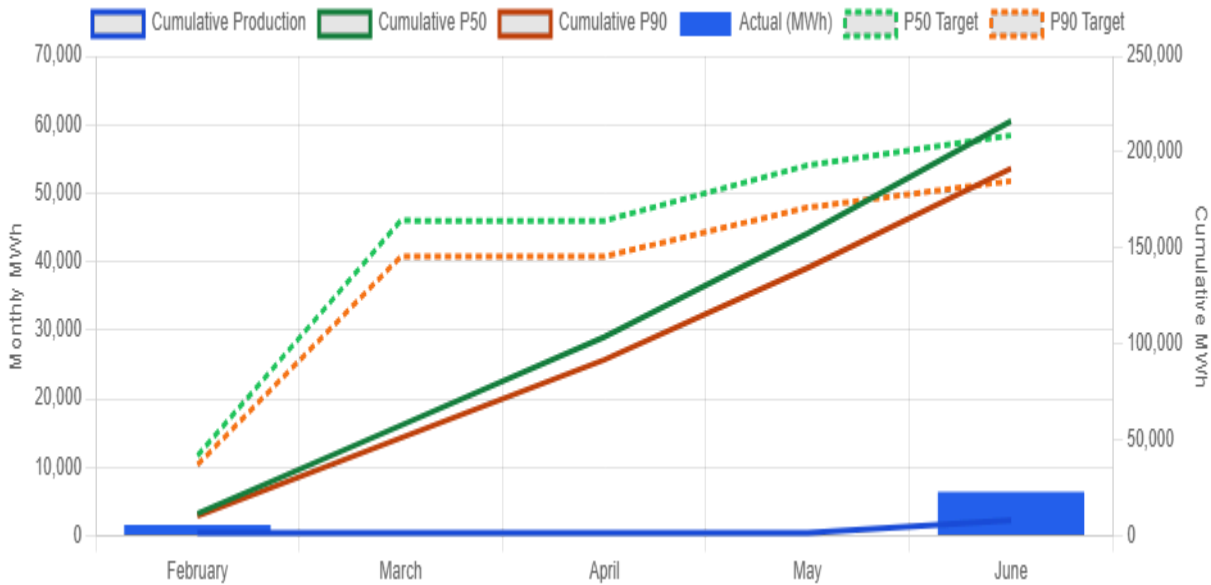


TURBINE-LEVEL PRODUCTION & AVAILABILITY

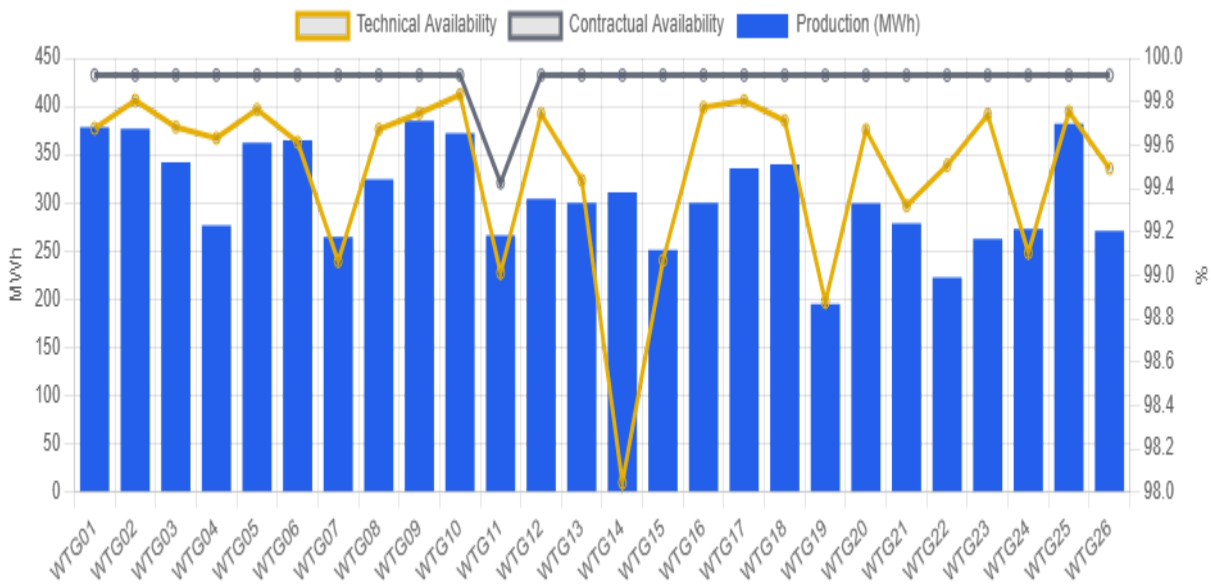

AVAILABILITY TREND

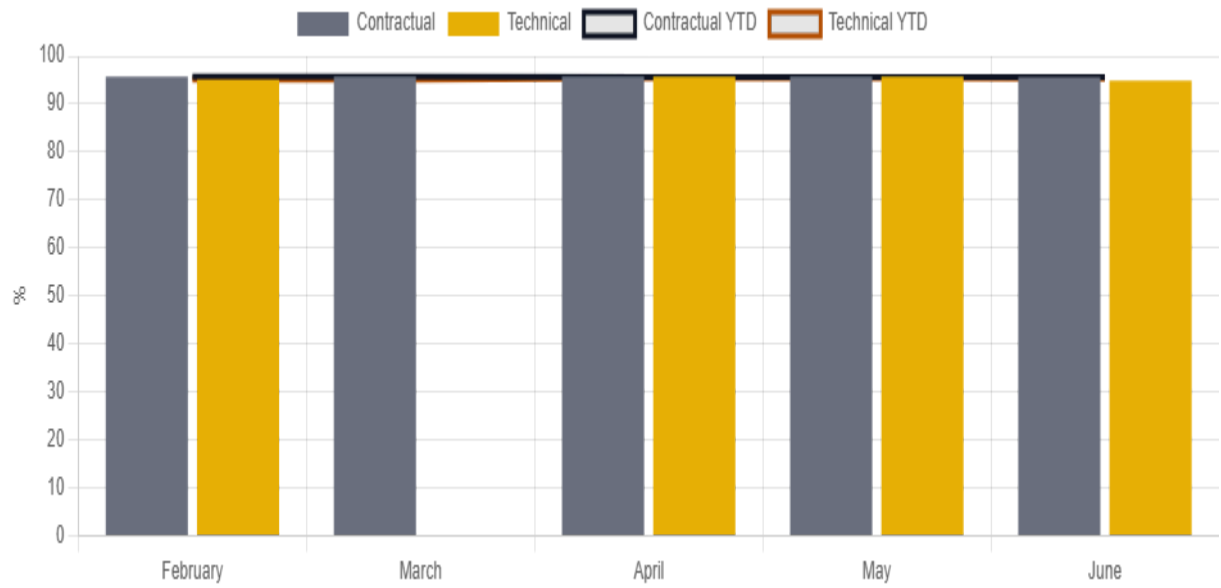

DOWNTIME BY CAUSE

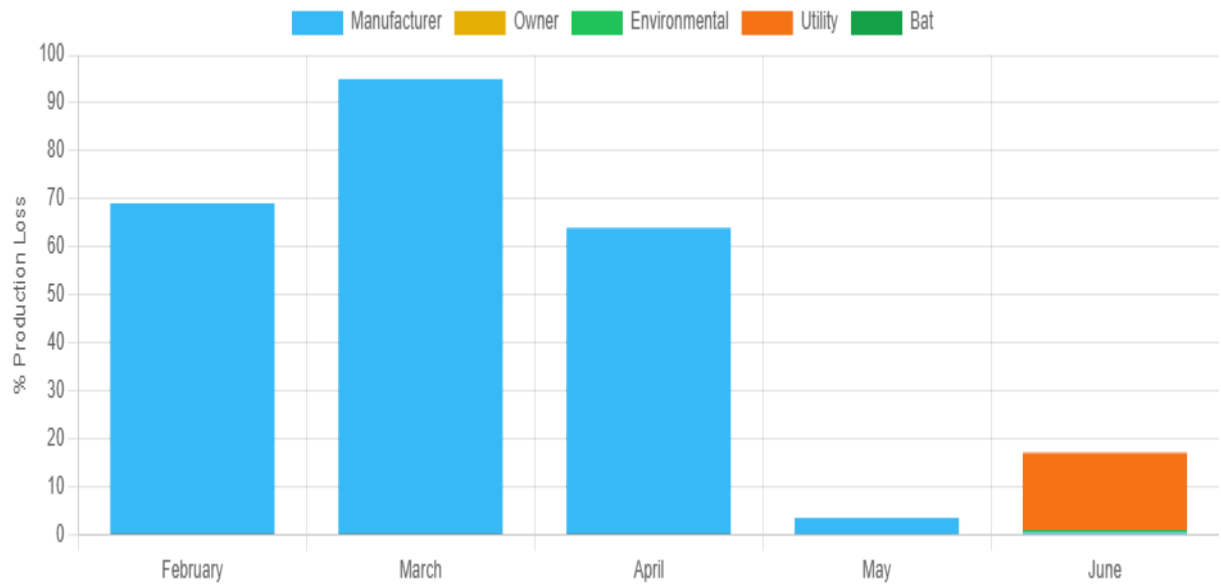

WIND RESOURCE

