



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production							
Measured (MWh)	162,744	32,127	28,644	39,730	29,475	32,768	162,744
Deviation Historical	–	–	–	–	–	–	–
Deviation P50	-34.4%	-17.7%	-40.6%	-16.5%	-46.1%	-44.0%	-34.4%
Deviation P90	-27.4%	-8.9%	-34.2%	-7.6%	-40.3%	-38.0%	-27.4%
Capacity Factor	31.1%	32.8%	26.4%	37.9%	27.2%	31.3%	31.1%
Electrical Losses	-3.1%	1.2%	-15.8%	-3.2%	1.1%	1.3%	-3.1%
B. Consumption							
Measured Consumption (MWh)	113	38	15	15	14	31	113
Ratio to Production	0.1%	0.1%	0.0%	0.0%	0.0%	0.1%	0.1%
C. Availability							
Contractual availability	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%
Technical availability	97.9%	97.3%	99.4%	98.6%	97.1%	97.3%	97.9%
Technical availability - Energy based	93.3%	94.5%	81.3%	96.6%	95.8%	98.3%	93.3%
D. Downtime							
Manufacturer	18.329%	5.913%	21.315%	14.662%	34.056%	15.698%	18.329%
Owner	0.001%	0.000%	0.000%	0.000%	0.000%	0.004%	0.001%
Environmental	1.048%	0.000%	0.000%	1.131%	3.515%	0.595%	1.048%
Utility	1.917%	0.000%	0.000%	0.000%	0.000%	9.587%	1.917%
Bat Curtailment	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
E. Wind							
Forecasted WS (m/s)	8.4 m/s	8 m/s	8 m/s	8 m/s	8.7 m/s	9.3 m/s	8.4 m/s
Measured WS (m/s)	7.6 m/s	7.3 m/s	6.8 m/s	8.3 m/s	8.1 m/s	7.4 m/s	7.6 m/s
WindSpeed Deviation	-9.2%	-8.3%	-14.0%	3.3%	-6.2%	-20.6%	-9.2%


PRODUCTION VS TARGET

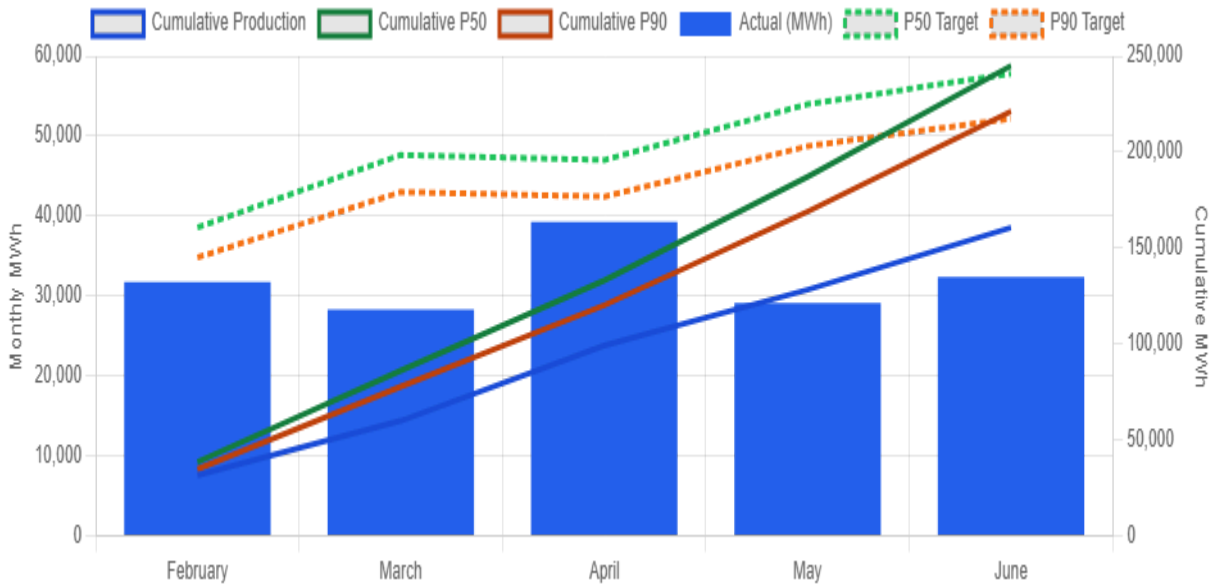


TURBINE-LEVEL PRODUCTION & AVAILABILITY

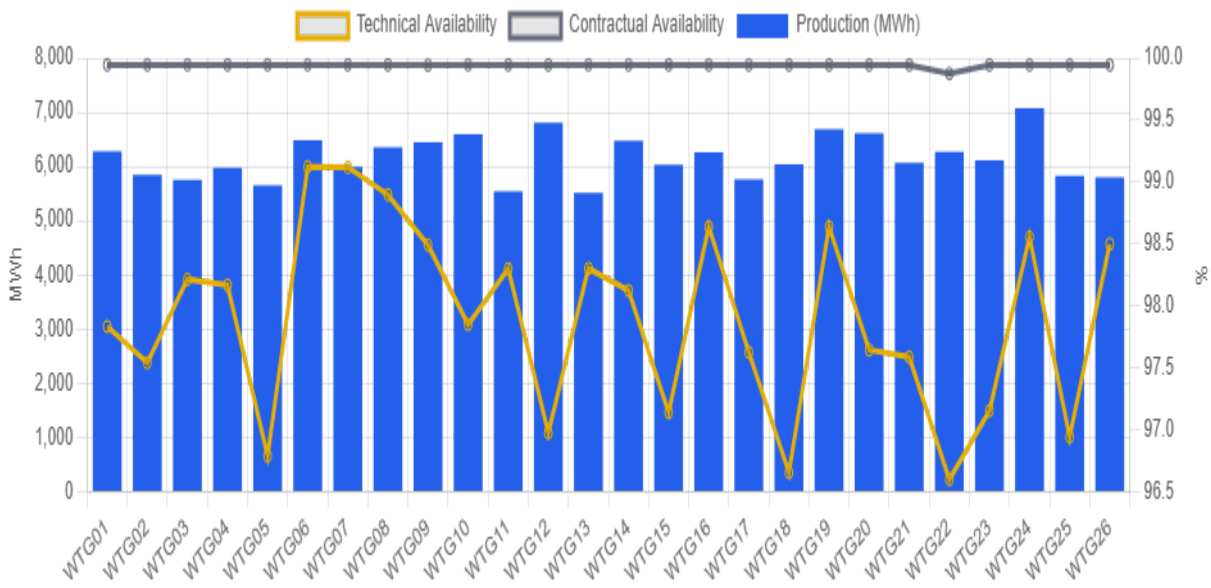

AVAILABILITY TREND

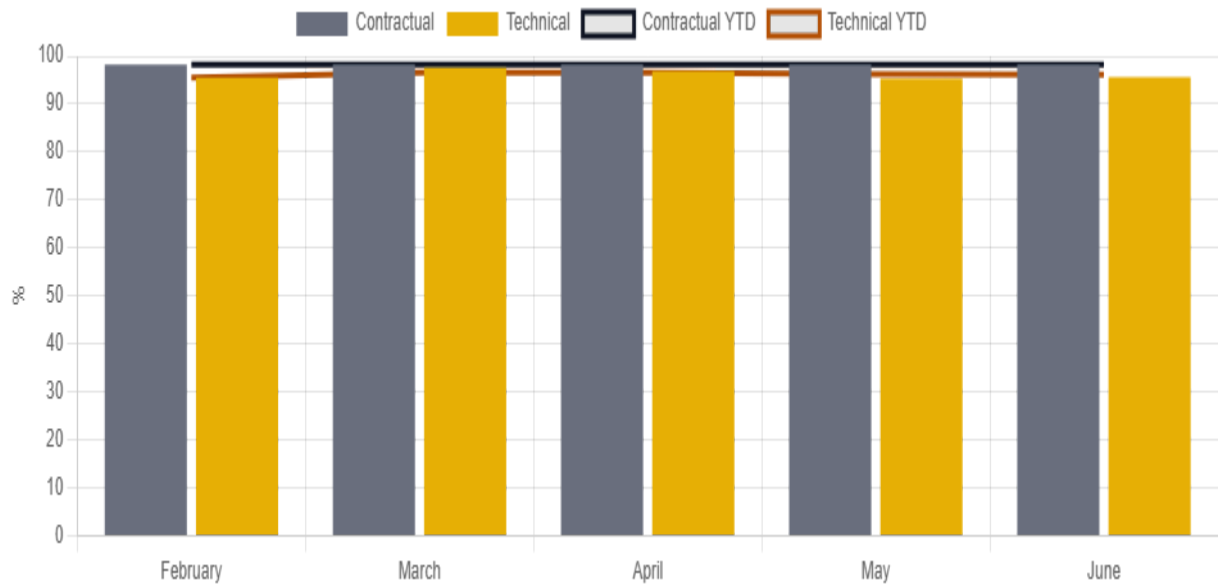

DOWNTIME BY CAUSE

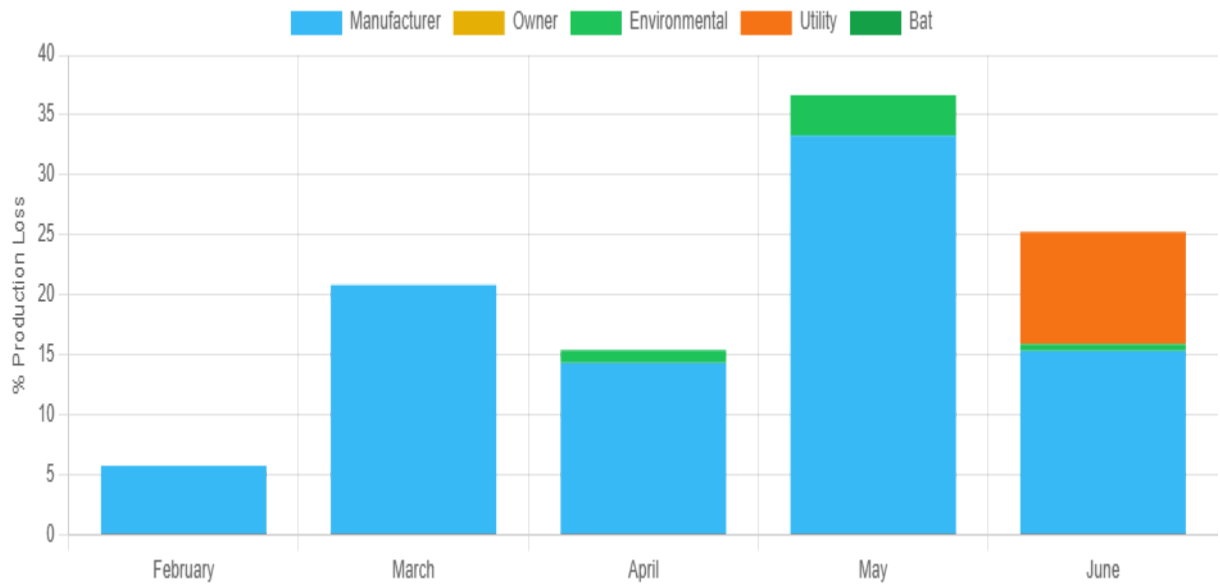

WIND RESOURCE

