



FULL KPI MATRIX

CATEGORY	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production									
Measured (MWh)	35,859	238,841	49,681	36,513	36,070	47,694	31,450	37,433	274,700
Deviation Historical	-	-	-	-	-	-	-	-	-
Deviation P50	6.1%	-16.4%	9.0%	-7.4%	-17.5%	7.5%	-41.3%	-36.7%	-14.1%
Deviation P90	18.8%	-6.4%	22.1%	3.8%	-7.6%	20.5%	-34.3%	-29.1%	-3.7%
Capacity Factor	33.1%	37.8%	45.9%	37.3%	33.3%	45.5%	29.0%	35.7%	37.1%
Electrical Losses	1.4%	0.8%	1.1%	-0.7%	1.5%	1.6%	0.7%	0.9%	0.9%
B. Consumption									
Measured Consumption (MWh)	0	162	28	26	34	16	16	42	162
Ratio to Production	0.0%	0.1%	0.1%	0.1%	0.1%	0.0%	0.1%	0.1%	0.1%
C. Availability									
Contractual availability	99.0%	98.1%	99.8%	98.4%	99.6%	97.2%	94.6%	98.8%	98.2%
Technical availability	92.8%	91.3%	96.3%	90.4%	89.7%	92.1%	88.5%	90.4%	91.5%
Technical availability - Energy based	97.9%	96.7%	98.9%	96.8%	98.8%	96.1%	91.0%	98.3%	96.8%
D. Downtime									
Manufacturer	1.532%	8.416%	1.101%	2.939%	1.375%	5.242%	31.326%	8.512%	7.432%
Owner	0.108%	0.566%	0.004%	0.069%	0.163%	0.159%	2.778%	0.226%	0.501%
Environmental	1.046%	1.191%	0.162%	1.064%	0.950%	0.553%	3.926%	0.493%	1.171%
Utility	0.319%	1.931%	0.017%	0.306%	0.356%	0.395%	0.216%	10.297%	1.701%
Bat Curtailment	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
E. Wind									
Forecasted WS (m/s)	8.4 m/s	8.4 m/s	8.1 m/s	7.8 m/s	7.9 m/s	8.1 m/s	8.9 m/s	9.6 m/s	8.4 m/s
Measured WS (m/s)	8.3 m/s	7.8 m/s	8 m/s	7.3 m/s	6.8 m/s	8.3 m/s	8.5 m/s	7.7 m/s	7.8 m/s
WindSpeed Deviation	-1.6%	-7.2%	-0.7%	-5.9%	-14.1%	2.0%	-4.4%	-20.3%	-6.4%


PRODUCTION VS TARGET

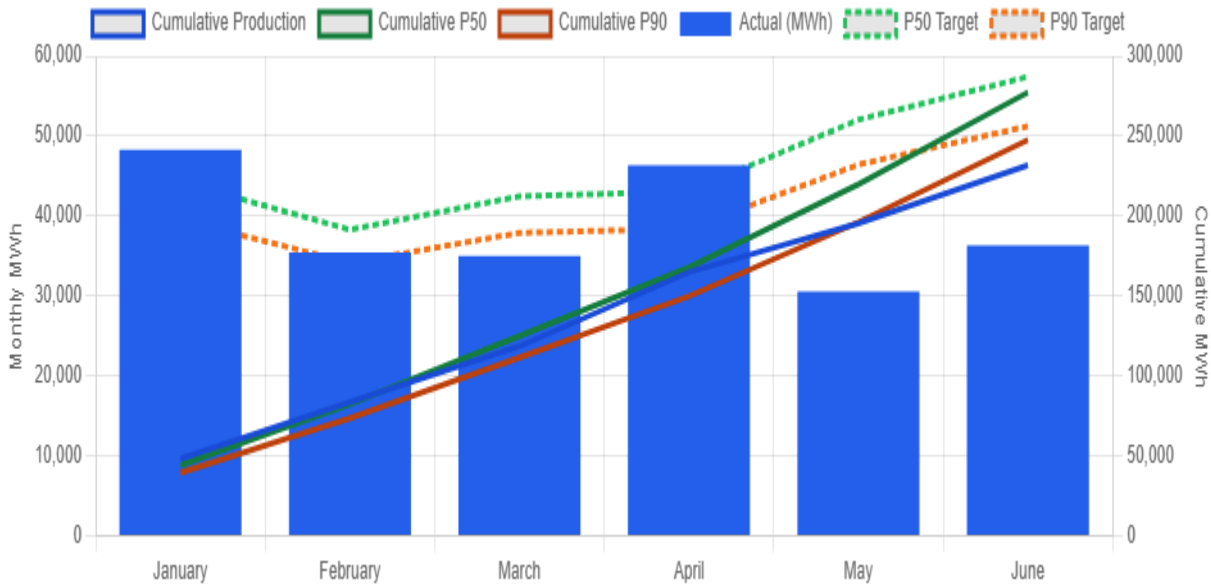


TURBINE-LEVEL PRODUCTION & AVAILABILITY

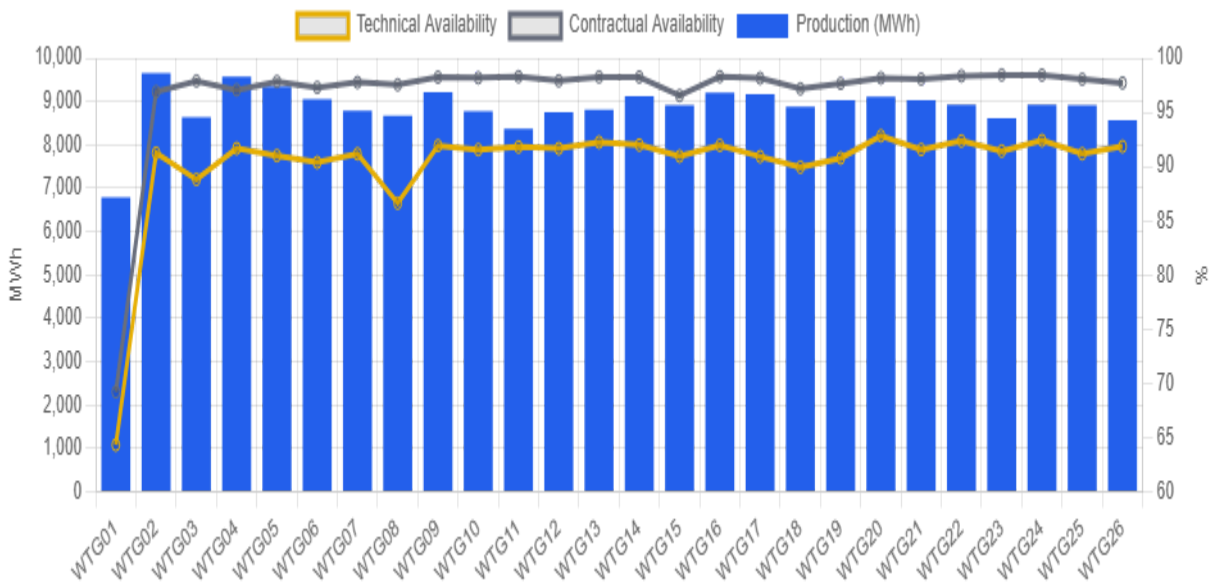

AVAILABILITY TREND

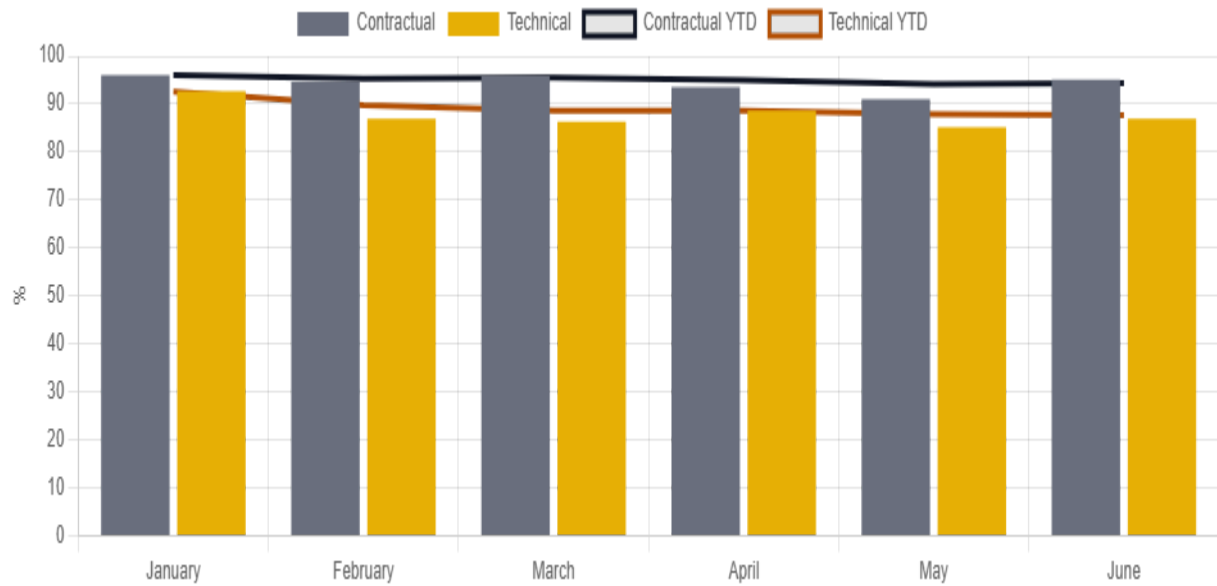

DOWNTIME BY CAUSE

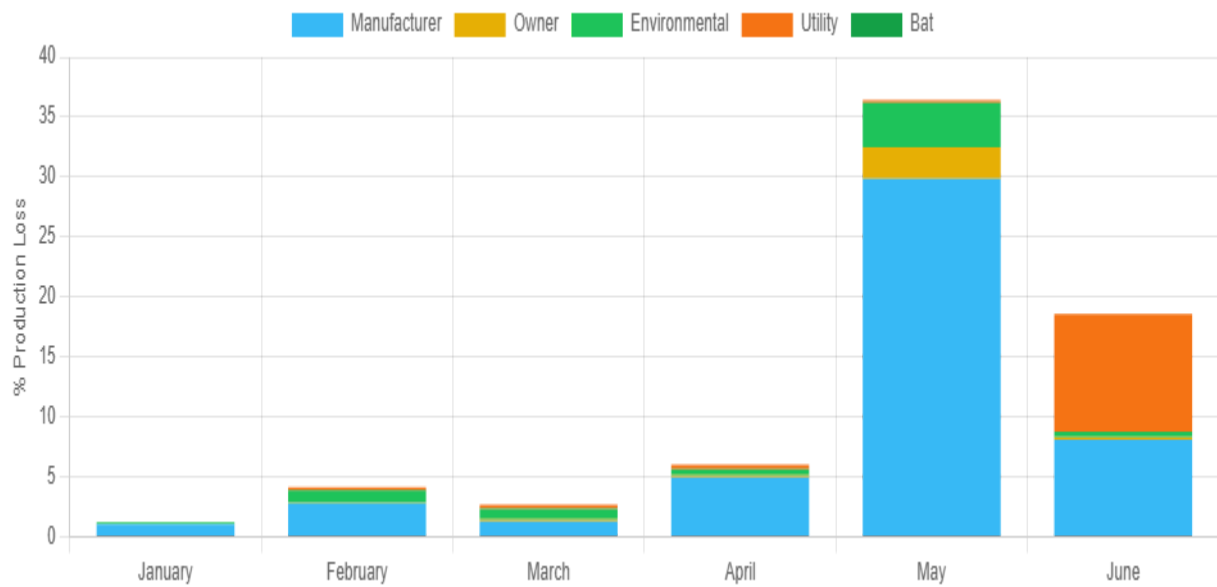

WIND RESOURCE

