


Dassiesridge: the plant produced 10.7 GWh, significantly below P50 and P90 targets. Contractual availability averaged 99.2%, while technical availability was lower at 92.4%. The negative delta in production was visible in the wind resource deviation of -28%.


FULL KPI MATRIX

CATEGORY	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production										
Measured (MWh)	14,944	87,229	14,780	11,841	10,471	15,782	12,522	11,098	10,735	102,173
Deviation Historical	–	–	–	–	–	–	–	–	–	–
Deviation P50	–	-27.1%	-14.9%	-20.1%	-36.5%	8.2%	-26.3%	-44.7%	-44.5%	-27.1%
Deviation P90	–	-16.3%	-2.2%	-8.2%	-27.1%	24.2%	-15.4%	-36.5%	-36.3%	-16.3%
Capacity Factor	29.5%	27.8%	32.1%	28.5%	22.9%	35.5%	27.3%	25.1%	23.5%	28.0%
B. Consumption										
Measured (MWh)	70	443	68	39	43	42	85	94	72	513
Ratio to Production	0.5%	0.5%	0.5%	0.3%	0.4%	0.3%	0.7%	0.8%	0.7%	0.5%
C. Availability										
TBA - Contractual	98.4%	93.2%	98.3%	98.5%	98.1%	98.6%	92.9%	66.7%	99.2%	93.9%
TBA - Technical	95.1%	88.9%	93.7%	95.2%	94.7%	97.5%	80.7%	68.1%	92.4%	89.7%
PBA - Technical	95.3%	88.7%	91.1%	89.8%	95.8%	97.5%	87.8%	63.4%	95.5%	89.5%
D. Losses Breakdown										
Grid	2.0%	2.2%	4.3%	2.3%	0.9%	0.3%	4.3%	0.2%	3.3%	2.2%
Breakdown	1.0%	5.7%	0.5%	0.7%	0.8%	0.2%	5.4%	31.3%	0.9%	5.1%
Maintenance	1.1%	0.9%	1.2%	0.8%	0.7%	0.9%	0.5%	2.5%	0.0%	1.0%
Partial Perf.	0.4%	2.0%	2.7%	6.0%	1.6%	0.6%	0.4%	2.6%	0.1%	1.8%
Environmental	0.1%	0.1%	0.1%	0.0%	0.0%	0.1%	0.3%	0.0%	–	0.1%
Data Quality	0.1%	0.2%	0.2%	0.3%	0.0%	0.4%	0.1%	–	–	0.2%
Requested Shutdown	0.0%	0.4%	0.0%	–	–	0.0%	1.4%	–	0.2%	0.3%
Electrical Losses	-7.5%	1.9%	1.6%	1.8%	2.2%	2.0%	1.9%	1.5%	2.4%	0.7%
BoP	0.1%	0.1%	0.0%	0.1%	0.1%	0.1%	0.1%	0.0%	0.1%	0.1%
E. Wind										
Forecasted WS (m/s)	7.1	7.1	6.9	6.6	6.5	6.5	7.3	8.5	7.8	7.1
Measured WS (m/s)	6.6	6.4	6.6	6.3	5.6	6.7	6.9	7.2	5.6	6.4
WindSpeed Deviation	-5.9%	-9.6%	-3.7%	-4.8%	-14.1%	3.6%	-5.1%	-14.8%	-28.4%	-9.1%


PLANT PRODUCTION

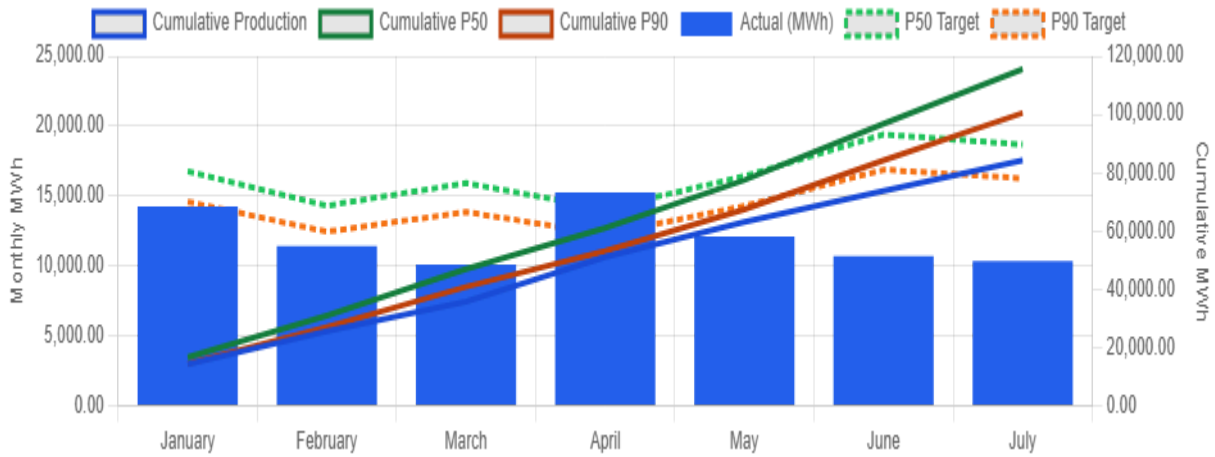


PLANT AVAILABILITY

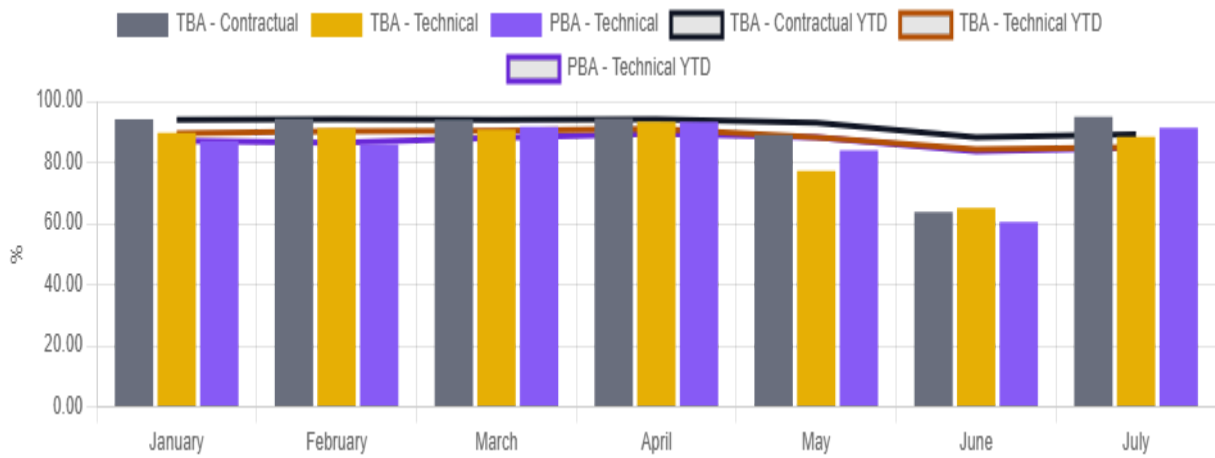

WIND SPEED

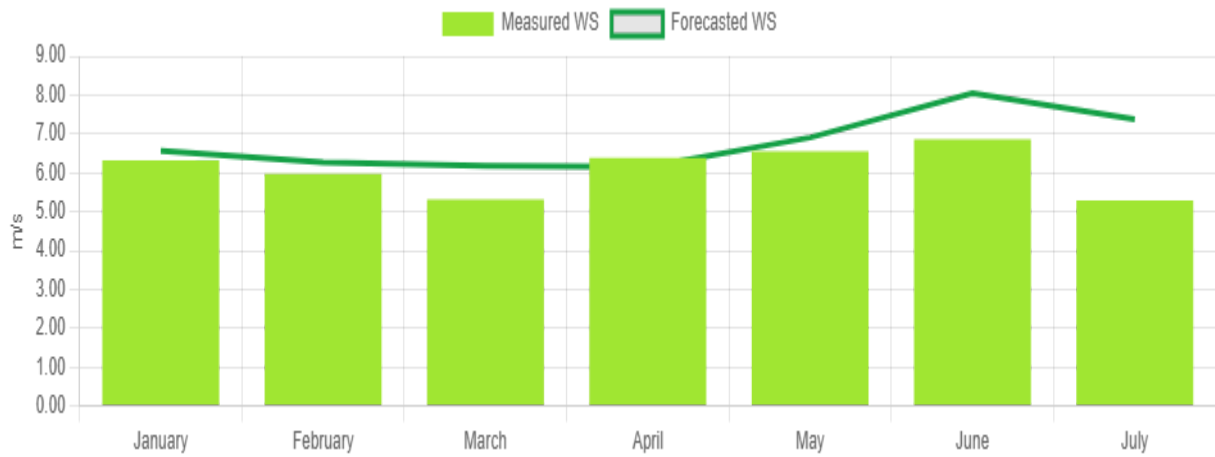

ANNUAL PRODUCTION AND AVAILABILITY PER WT

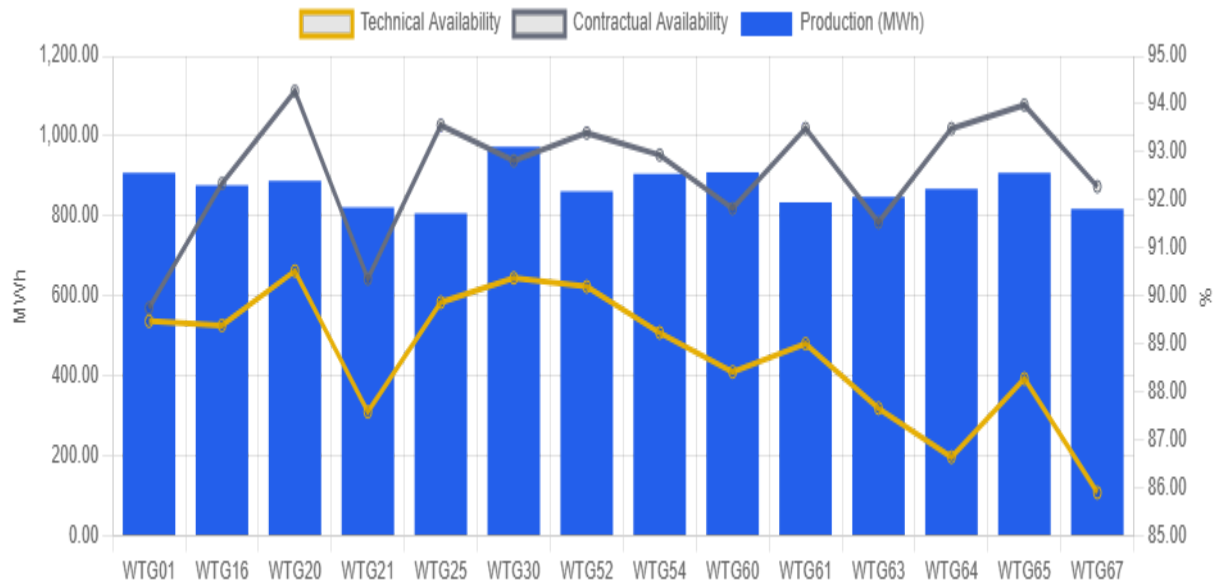

LOSSES BREAKDOWN

