


**Dassiesridge:** the plant produced 13.9 GWh, significantly below P50 and P90 targets. Contractual availability averaged 98.5%, while technical availability was 96.0%. The negative delta in production was visible in the wind resource deviation of -17%.


FULL KPI MATRIX

| CATEGORY             | 2025   | 2026    | JAN    | FEB    | MAR    | APR    | MAY    | JUN    | JUL    | AUG    | TOTAL   |
|----------------------|--------|---------|--------|--------|--------|--------|--------|--------|--------|--------|---------|
| A. Production        |        |         |        |        |        |        |        |        |        |        |         |
| Measured (MWh)       | 14,944 | 101,155 | 14,780 | 11,841 | 10,471 | 15,782 | 12,522 | 11,098 | 10,735 | 13,926 | 116,099 |
| Deviation Historical | –      | –       | –      | –      | –      | –      | –      | –      | –      | –      | –       |
| Deviation P50        | –      | -26.9%  | -14.9% | -20.1% | -36.5% | 8.2%   | -26.3% | -44.7% | -44.5% | -25.7% | -26.9%  |
| Deviation P90        | –      | -16.1%  | -2.2%  | -8.2%  | -27.1% | 24.2%  | -15.4% | -36.5% | -36.3% | -14.6% | -16.1%  |
| Capacity Factor      | 29.5%  | 28.1%   | 32.1%  | 28.5%  | 22.9%  | 35.5%  | 27.3%  | 25.1%  | 23.5%  | 30.3%  | 28.3%   |
| B. Consumption       |        |         |        |        |        |        |        |        |        |        |         |
| Measured (MWh)       | 70     | 482     | 68     | 39     | 43     | 42     | 85     | 94     | 72     | 39     | 552     |
| Ratio to Production  | 0.5%   | 0.5%    | 0.5%   | 0.3%   | 0.4%   | 0.3%   | 0.7%   | 0.8%   | 0.7%   | 0.3%   | 0.5%    |
| C. Availability      |        |         |        |        |        |        |        |        |        |        |         |
| TBA - Contractual    | 98.4%  | 93.9%   | 98.3%  | 98.5%  | 98.1%  | 98.6%  | 92.9%  | 66.7%  | 99.2%  | 98.5%  | 94.4%   |
| TBA - Technical      | 95.1%  | 89.8%   | 93.7%  | 95.2%  | 94.7%  | 97.5%  | 80.7%  | 68.1%  | 92.4%  | 96.0%  | 90.4%   |
| PBA - Technical      | 95.3%  | 89.4%   | 91.1%  | 89.8%  | 95.8%  | 97.5%  | 87.8%  | 63.4%  | 95.5%  | 94.5%  | 90.1%   |
| D. Losses Breakdown  |        |         |        |        |        |        |        |        |        |        |         |
| Grid                 | 2.0%   | 2.4%    | 4.3%   | 2.3%   | 0.9%   | 0.3%   | 4.3%   | 0.2%   | 3.3%   | 3.8%   | 2.4%    |
| Breakdown            | 1.0%   | 5.0%    | 0.5%   | 0.7%   | 0.8%   | 0.2%   | 5.4%   | 31.3%  | 0.9%   | 0.6%   | 4.6%    |
| Maintenance          | 1.1%   | 0.9%    | 1.2%   | 0.8%   | 0.7%   | 0.9%   | 0.5%   | 2.5%   | 0.0%   | 0.8%   | 0.9%    |
| Partial Perf.        | 0.4%   | 1.8%    | 2.7%   | 6.0%   | 1.6%   | 0.6%   | 0.4%   | 2.6%   | 0.1%   | 0.0%   | 1.6%    |
| Environmental        | 0.1%   | 0.1%    | 0.1%   | 0.0%   | 0.0%   | 0.1%   | 0.3%   | 0.0%   | –      | 0.2%   | 0.1%    |
| Data Quality         | 0.1%   | 0.2%    | 0.2%   | 0.3%   | 0.0%   | 0.4%   | 0.1%   | –      | –      | –      | 0.2%    |
| Requested Shutdown   | 0.0%   | 0.4%    | 0.0%   | –      | –      | 0.0%   | 1.4%   | –      | 0.2%   | –      | 0.3%    |
| Electrical Losses    | -7.5%  | 1.9%    | 1.6%   | 1.8%   | 2.2%   | 2.0%   | 1.9%   | 1.5%   | 2.4%   | 2.0%   | 0.9%    |
| BoP                  | 0.1%   | 0.1%    | 0.0%   | 0.1%   | 0.1%   | 0.1%   | 0.1%   | 0.0%   | 0.1%   | 0.1%   | 0.1%    |
| E. Wind              |        |         |        |        |        |        |        |        |        |        |         |
| Forecasted WS (m/s)  | 7.1    | 7.2     | 6.9    | 6.6    | 6.5    | 6.5    | 7.3    | 8.5    | 7.8    | 7.5    | 7.2     |
| Measured WS (m/s)    | 6.6    | 6.4     | 6.6    | 6.3    | 5.6    | 6.7    | 6.9    | 7.2    | 5.6    | 6.2    | 6.4     |
| WindSpeed Deviation  | -5.9%  | -10.6%  | -3.7%  | -4.8%  | -14.1% | 3.6%   | -5.1%  | -14.8% | -28.4% | -17.2% | -10.0%  |


PLANT PRODUCTION

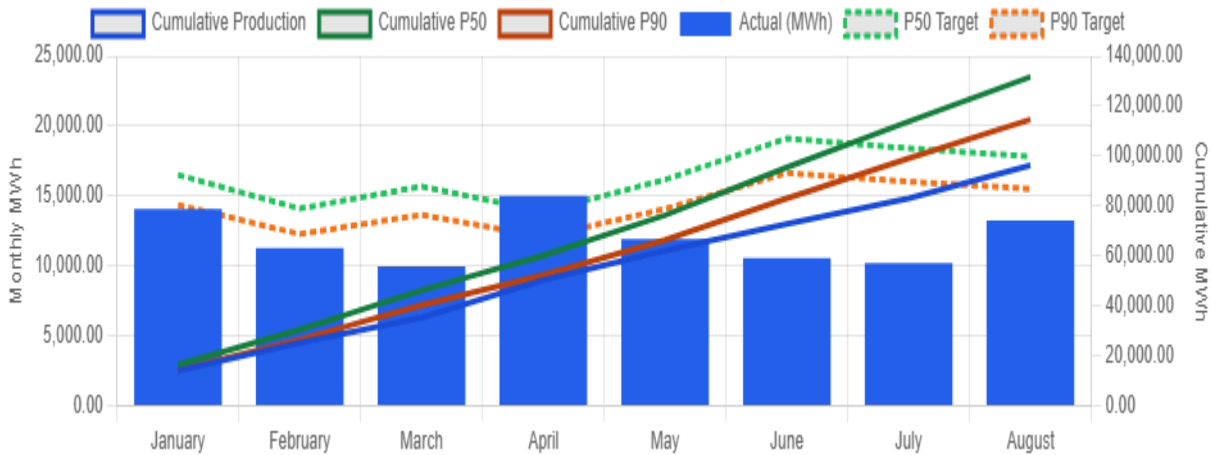


PLANT AVAILABILITY

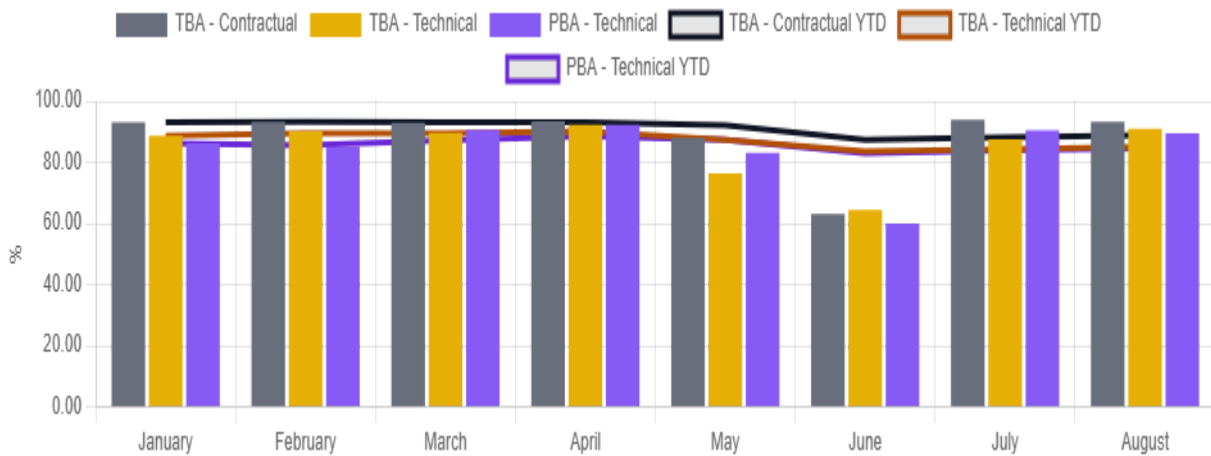

WIND SPEED

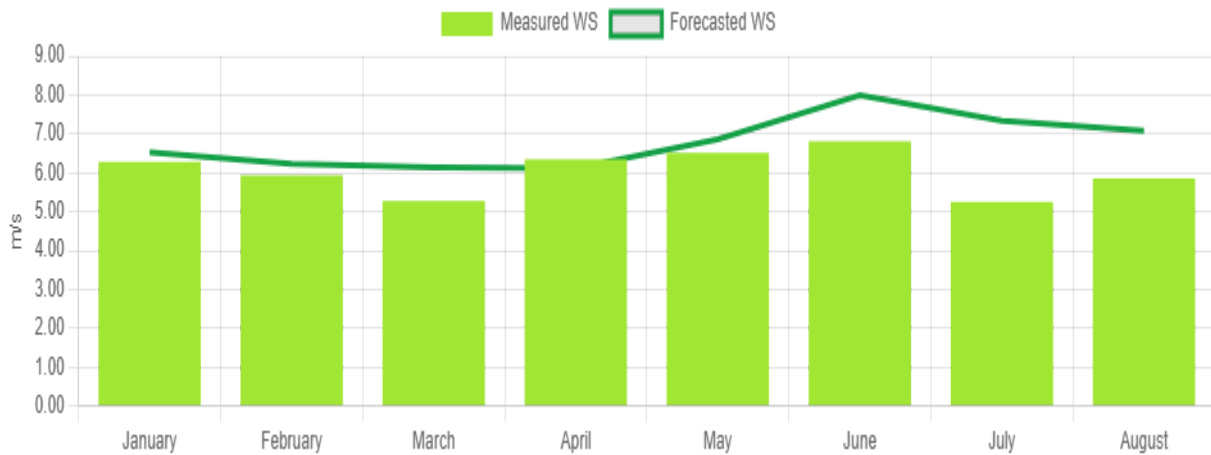

## ANNUAL PRODUCTION AND AVAILABILITY PER WT

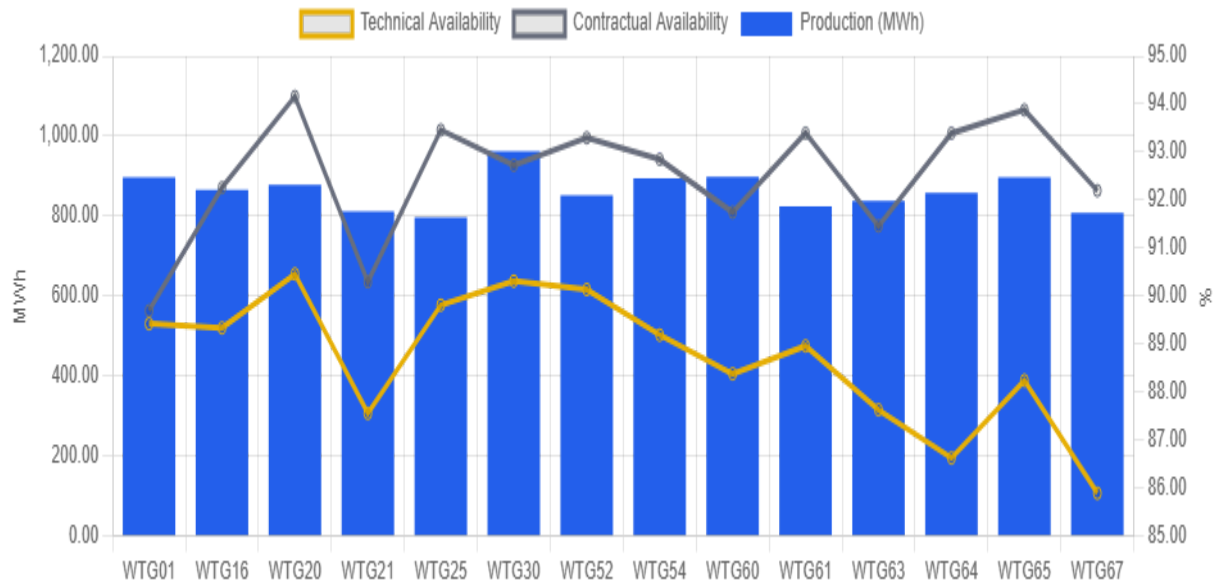

## LOSSES BREAKDOWN

