



FULL KPI MATRIX

CATEGORY		2025	2026	TOTAL
A. Production				
Measured (MWh)		35,859	238,841	274,700
Deviation Historical		-	-	-
Deviation P50		6.1%	-16.4%	-14.1%
Deviation P90		18.8%	-6.4%	-3.7%
Capacity Factor		33.1%	37.8%	37.1%
Electrical Losses		1.4%	0.8%	0.9%
B. Consumption				
Measured Consumption (MWh)		0	120	120
Ratio to Production		0.0%	0.1%	0.1%
C. Availability				
Contractual availability		99.0%	98.1%	98.2%
Technical availability		92.8%	91.3%	91.5%
Technical availability - Energy based		97.9%	96.7%	96.8%
D. Downtime				
Manufacturer		0.000%	0.875%	0.750%
Owner		0.000%	0.029%	0.025%
Environmental		0.000%	0.071%	0.061%
Utility		0.000%	0.064%	0.055%
Bat Curtailment		0.000%	0.000%	0.000%
E. Wind				
Forecasted WS (m/s)		8.4 m/s	8.4 m/s	8.4 m/s
Measured WS (m/s)		8.3 m/s	7.8 m/s	7.8 m/s
WindSpeed Deviation		-1.6%	-7.2%	-6.4%


PRODUCTION VS TARGET

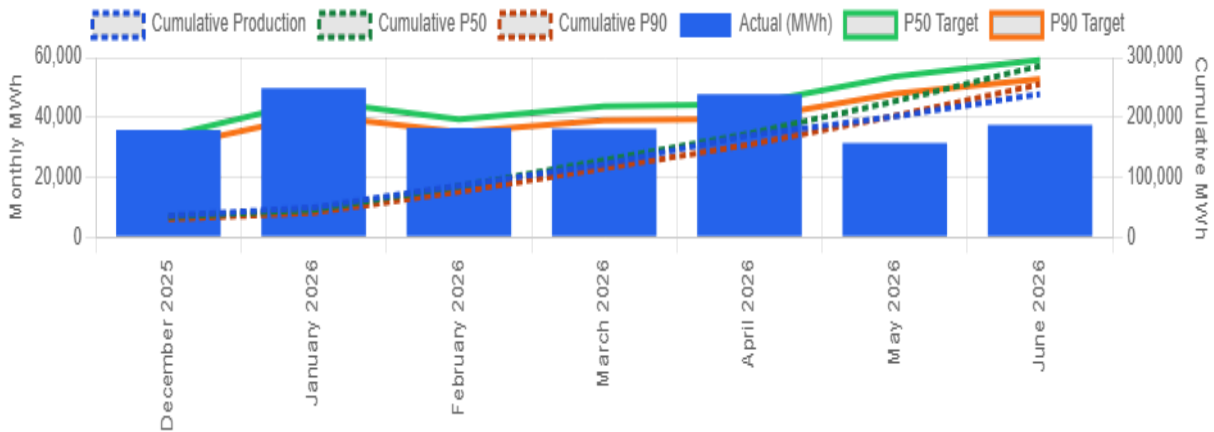


TURBINE-LEVEL PRODUCTION & AVAILABILITY

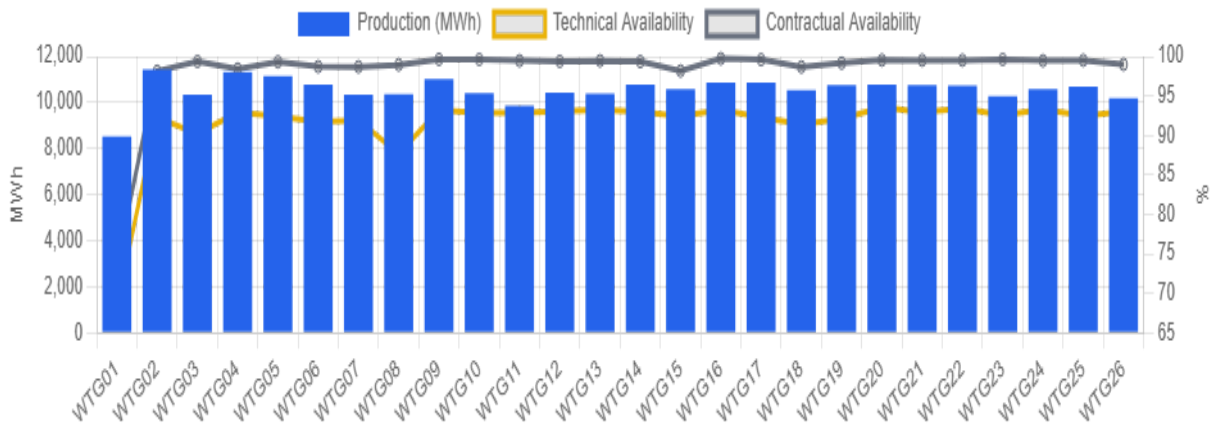


AVAILABILITY TREND

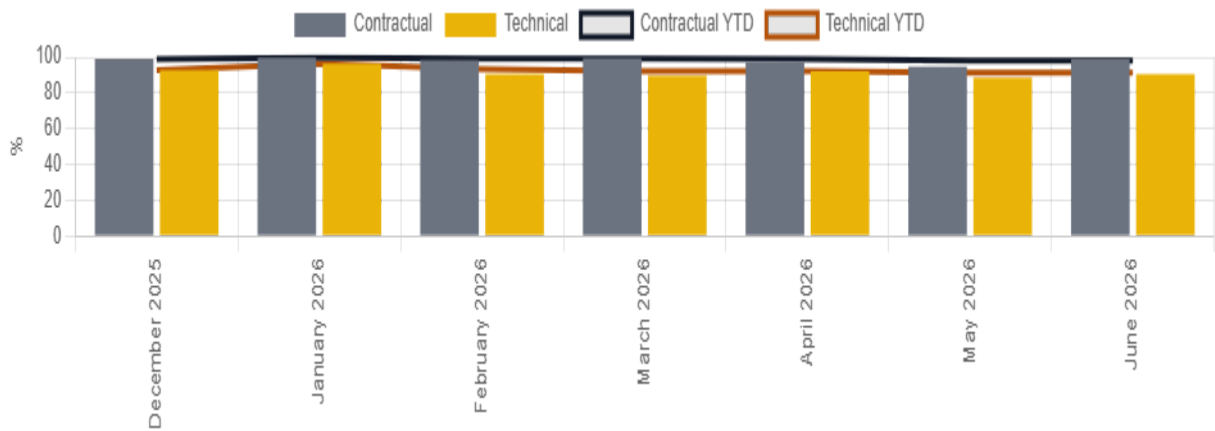

WIND RESOURCE

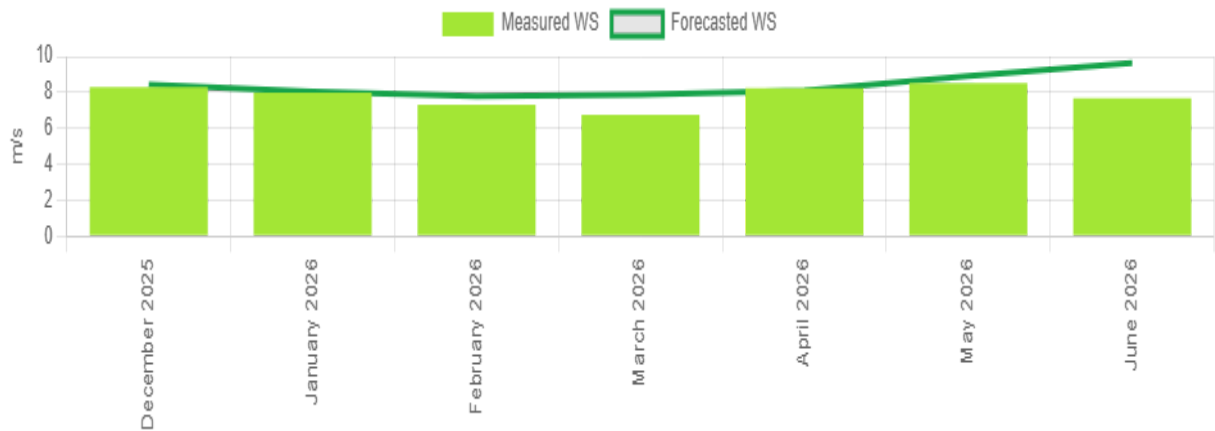

DOWNTIME BY CAUSE

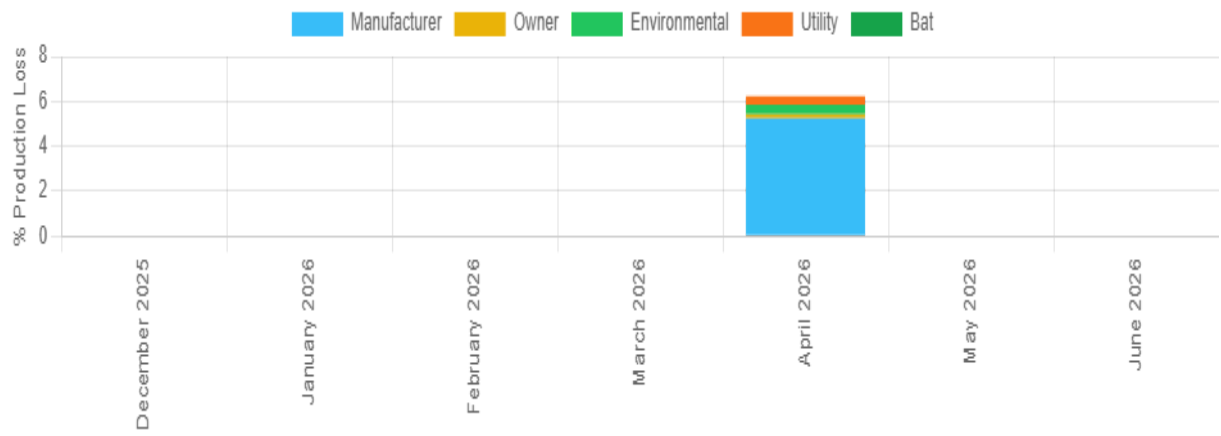

Plant Analysis Reports · San Kraal · Full history · Source: P&O_Custom_Semantic_Model (PowerBI)