



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production								
Measured (MWh)	172,534	8,096	36,822	44,460	33,537	35,741	13,876	172,534
Deviation Historical	–	–	–	–	–	–	–	–
Deviation P50	-39.7%	-33.2%	-22.6%	-6.6%	-40.1%	-40.9%	-77.8%	-39.7%
Deviation P90	-31.9%	-24.7%	-12.7%	5.4%	-32.4%	-33.3%	-74.9%	-31.9%
Capacity Factor	5.5%	1.7%	0.0%	0.0%	0.0%	6.4%	24.8%	5.5%
Electrical Losses	-92.1%	-79.1%	-100.0%	-100.0%	-100.0%	-81.4%	–	-92.1%
B. Consumption								
Measured (MWh)	78	0	28	9	12	29	–	78
Ratio to Production	0.0%	0.0%	0.1%	0.0%	0.0%	0.1%	–	0.0%
C. Availability								
Contractual - Time Based	100.0%	100.0%	100.0%	100.0%	100.0%	99.9%	99.9%	100.0%
TBA - Time Based	99.2%	99.4%	–	100.0%	100.0%	99.2%	97.4%	99.2%
PBA - Energy Based	59.2%	27.2%	0.0%	32.6%	96.3%	99.5%	99.8%	59.2%
D. OLF - Losses								
Manufacturer	40.8%	72.8%	100.0%	67.3%	3.7%	0.5%	0.2%	40.8%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.0%
Environmental	0.5%	0.0%	0.0%	0.0%	0.0%	0.7%	2.5%	0.5%
Utility	7.3%	0.0%	0.0%	0.0%	0.0%	16.9%	26.8%	7.3%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind								
Forecasted WS (m/s)	8	7.5	7.5	7.5	8.1	8.7	8.5	8
Measured WS (m/s)	7.6	6	–	–	–	9.1	7.7	7.6
WindSpeed Deviation	-54.0%	-20.3%	-100.0%	-100.0%	-100.0%	5.4%	-8.9%	-54.0%


PLANT PRODUCTION

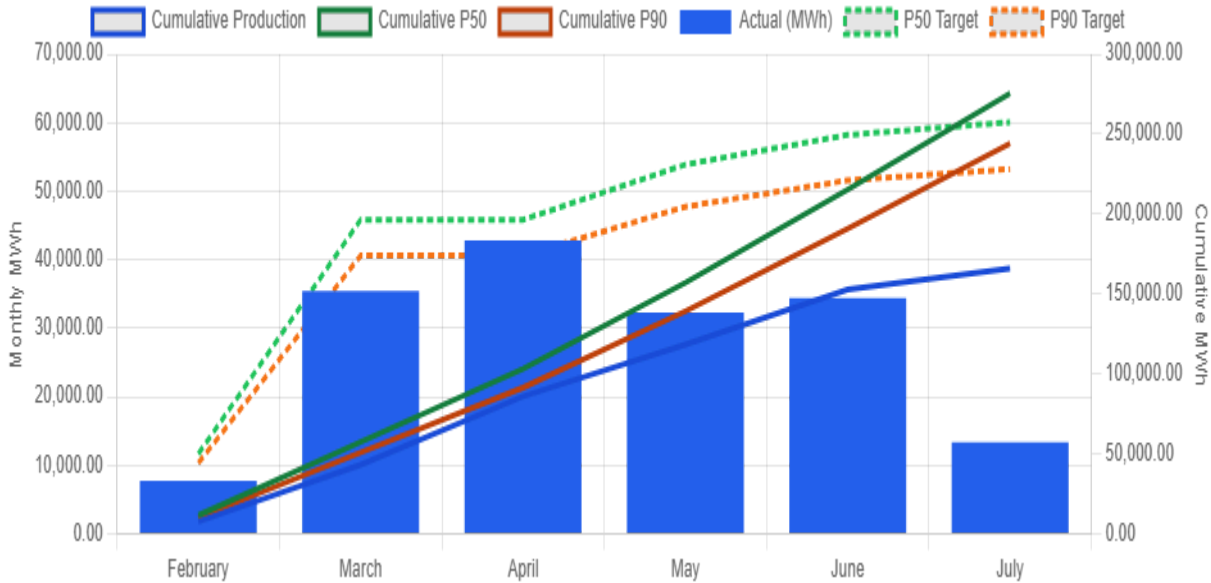


ANNUAL PRODUCTION AND AVAILABILITY PER WT

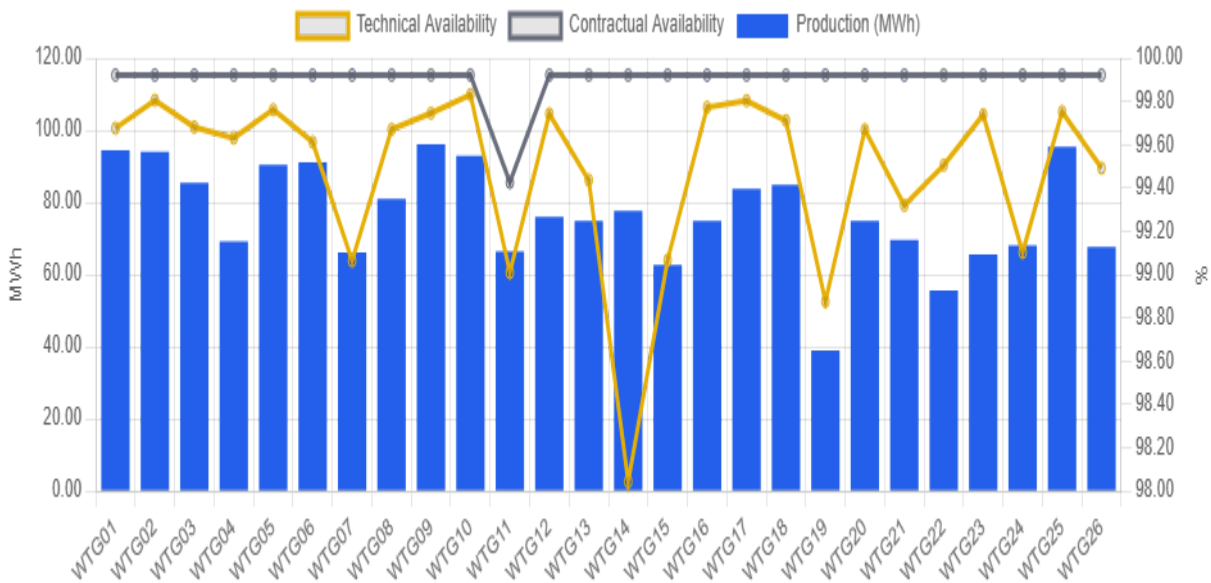

PLANT AVAILABILITY

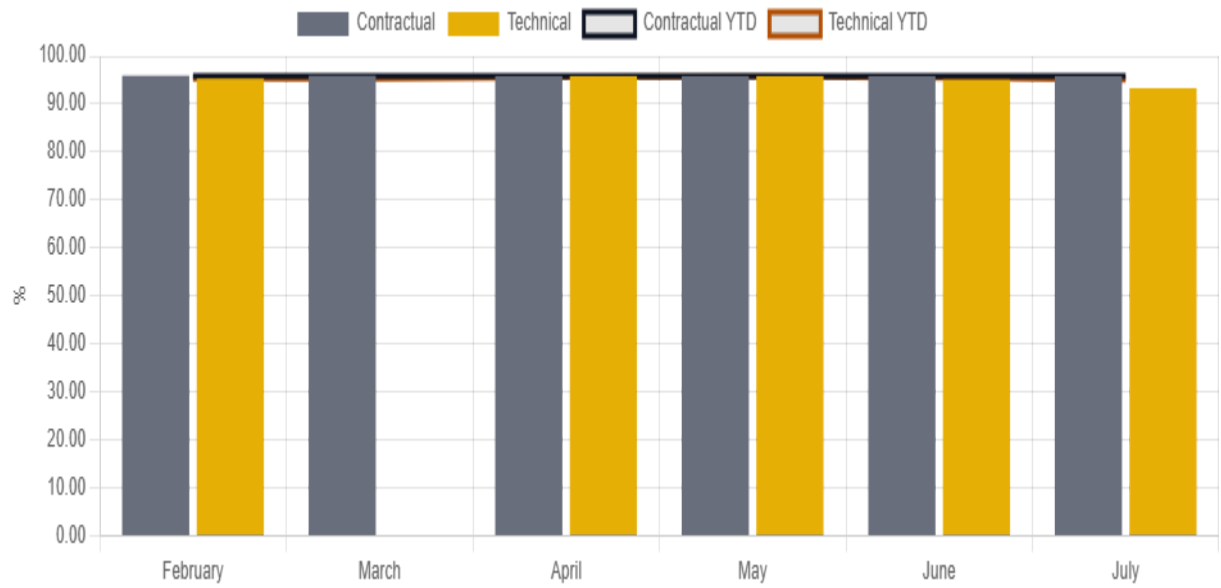

OPERATIONAL LOSS FACTORS

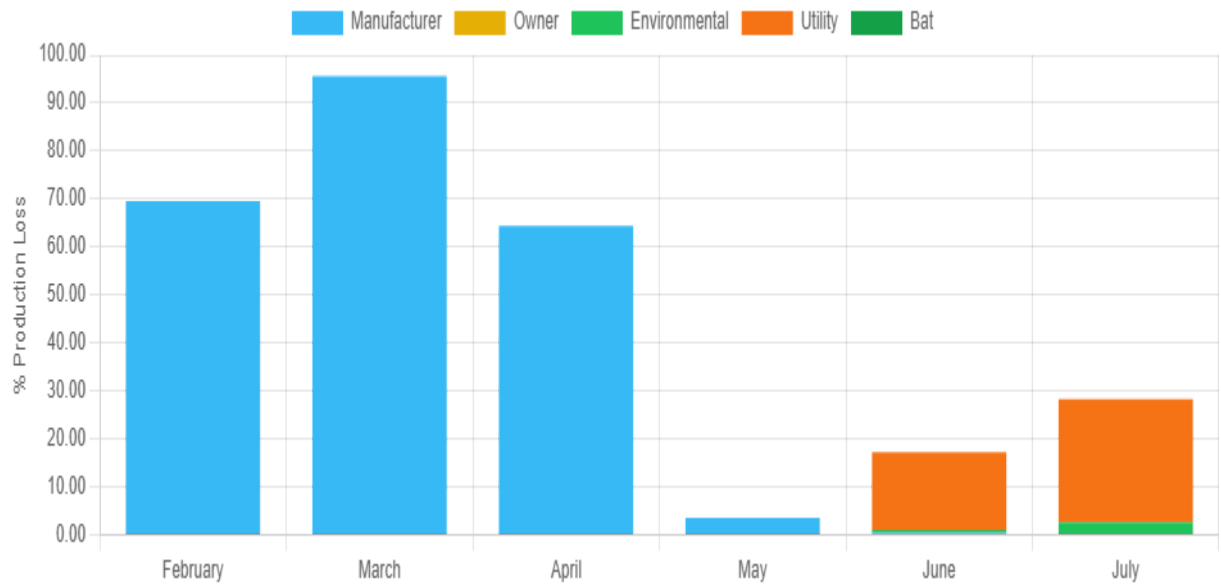

WIND SPEED

