



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production								
Measured (MWh)	182,309	31,758	34,015	41,027	29,164	32,348	13,996	182,309
Deviation Historical	–	–	–	–	–	–	–	–
Deviation P50	-40.7%	-18.7%	-29.5%	-13.8%	-46.7%	-44.7%	-76.3%	-40.7%
Deviation P90	-34.3%	-9.9%	-21.9%	-4.5%	-40.9%	-38.8%	-73.8%	-34.3%
Capacity Factor	30.1%	32.8%	26.4%	37.9%	27.2%	31.3%	25.0%	30.1%
Electrical Losses	-3.1%	1.2%	-15.8%	-3.2%	1.1%	1.3%	–	-3.1%
B. Consumption								
Measured (MWh)	113	38	15	15	14	31	–	113
Ratio to Production	0.1%	0.1%	0.0%	0.0%	0.0%	0.1%	–	0.1%
C. Availability								
Contractual - Time Based	99.9%	100.0%	100.0%	100.0%	100.0%	100.0%	99.5%	99.9%
TBA - Time Based	97.6%	97.3%	99.4%	98.6%	97.1%	97.3%	95.9%	97.6%
PBA - Energy Based	94.3%	94.5%	81.3%	96.6%	95.8%	98.3%	99.1%	94.3%
D. OLF - Losses								
Manufacturer	17.4%	5.9%	21.3%	14.7%	34.1%	15.7%	12.6%	17.4%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.2%	0.0%
Environmental	1.1%	0.0%	0.0%	1.1%	3.5%	0.6%	1.6%	1.1%
Utility	3.6%	0.0%	0.0%	0.0%	0.0%	9.6%	11.8%	3.6%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind								
Forecasted WS (m/s)	8.5	8	8	8	8.7	9.3	9.1	8.5
Measured WS (m/s)	7.4	7.3	6.8	8.3	8.1	7.4	6.7	7.4
WindSpeed Deviation	-12.0%	-8.3%	-14.0%	3.3%	-6.2%	-20.6%	-26.4%	-12.0%


PLANT PRODUCTION

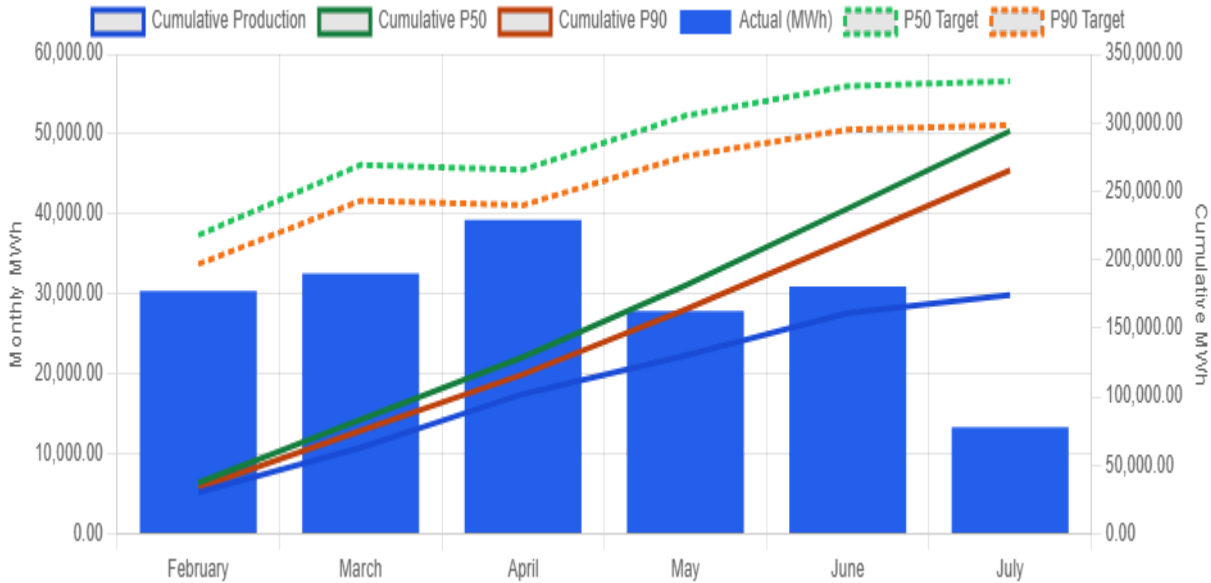


ANNUAL PRODUCTION AND AVAILABILITY PER WT

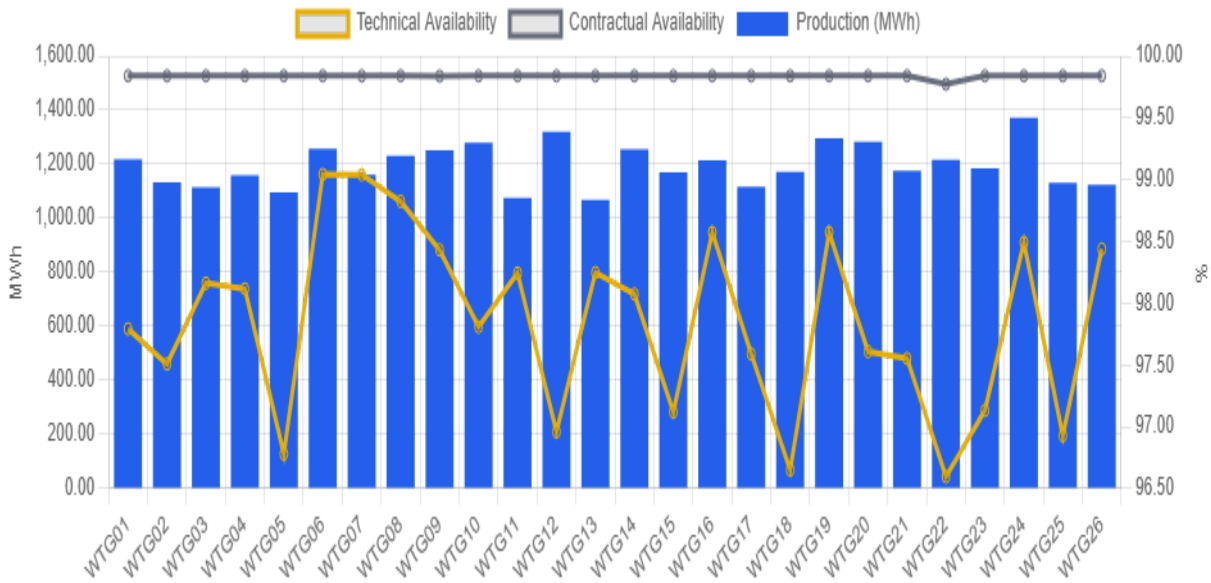

PLANT AVAILABILITY

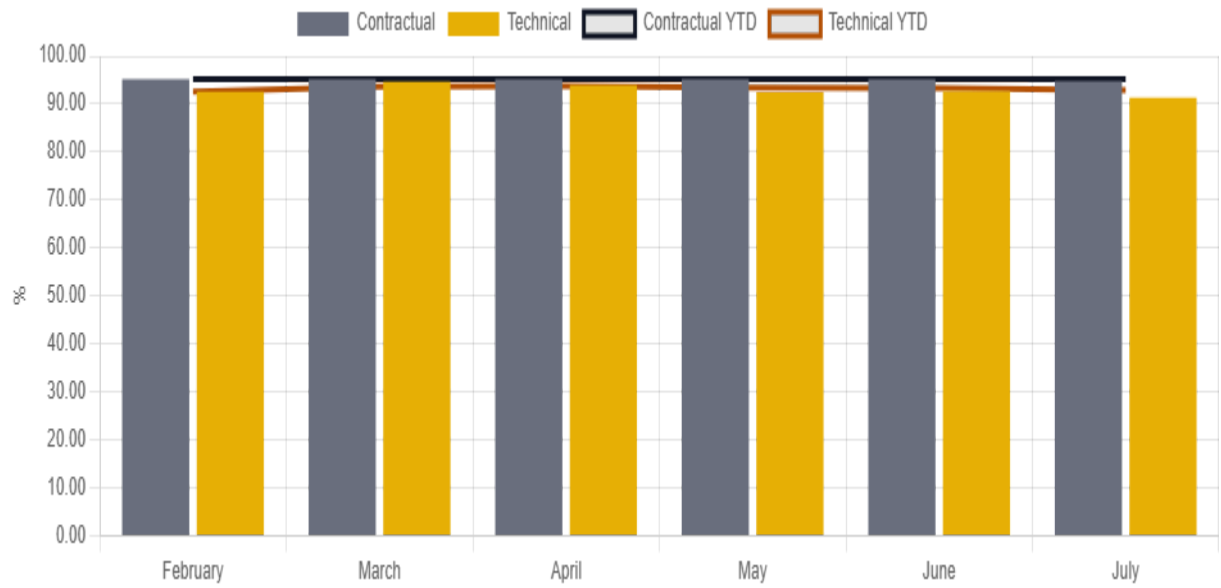

OPERATIONAL LOSS FACTORS

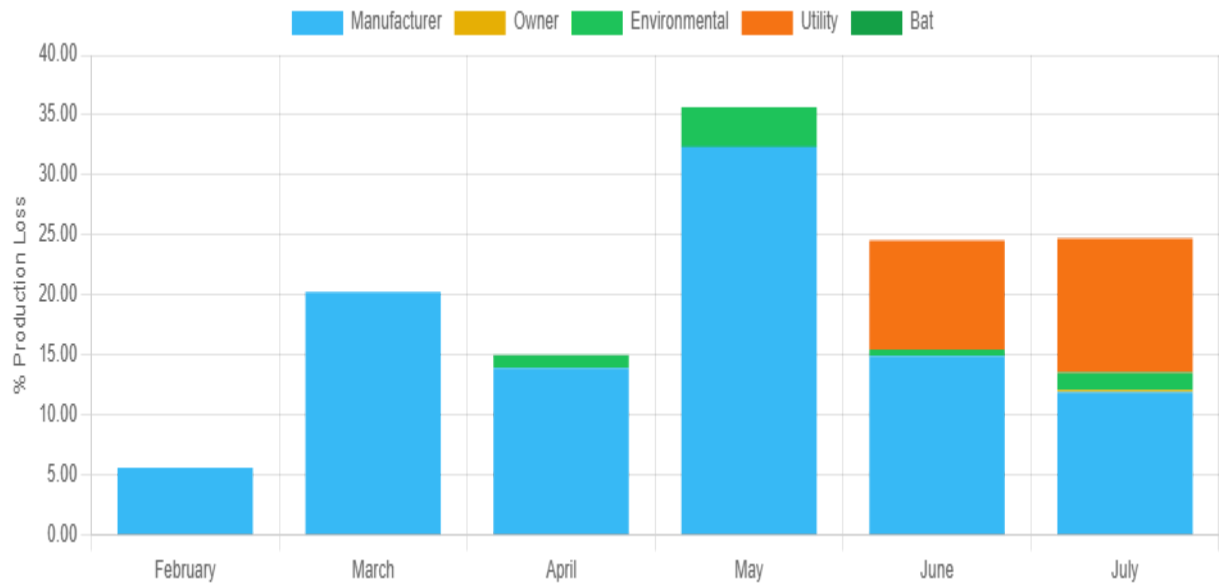

WIND SPEED

