



FULL KPI MATRIX

CATEGORY	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production										
Measured (MWh)	35,374	251,869	49,138	36,763	35,552	46,951	31,244	37,114	15,106	287,243
Deviation Historical	–	–	–	–	–	–	–	–	–	–
Deviation P50	4.6%	-27.4%	7.8%	-6.8%	-18.7%	5.9%	-41.7%	-37.2%	-75.2%	-24.5%
Deviation P90	17.2%	-18.6%	20.8%	4.5%	-8.9%	18.6%	-34.7%	-29.7%	-72.3%	-15.5%
Capacity Factor	33.1%	36.2%	45.9%	37.3%	33.3%	45.5%	29.0%	35.7%	27.0%	35.9%
Electrical Losses	1.4%	0.8%	1.1%	-0.7%	1.5%	1.6%	0.7%	0.9%	–	0.9%
B. Consumption										
Measured (MWh)	0	162	28	26	34	16	16	42	–	162
Ratio to Production	0.0%	0.1%	0.1%	0.1%	0.1%	0.0%	0.1%	0.1%	–	0.1%
C. Availability										
Contractual - Time Based	99.0%	98.3%	99.8%	98.4%	99.6%	97.2%	94.6%	98.8%	99.5%	98.4%
TBA - Time Based	92.8%	92.0%	96.3%	90.4%	89.7%	92.1%	88.5%	90.4%	96.4%	92.1%
PBA - Energy Based	97.9%	97.0%	98.9%	96.8%	98.8%	96.1%	91.0%	98.3%	98.8%	97.1%
D. OLF - Losses										
Manufacturer	1.5%	7.3%	1.1%	2.9%	1.4%	5.2%	31.3%	8.5%	0.9%	6.6%
Owner	0.1%	0.5%	0.0%	0.1%	0.2%	0.2%	2.8%	0.2%	0.3%	0.5%
Environmental	1.0%	1.1%	0.2%	1.1%	0.9%	0.6%	3.9%	0.5%	0.4%	1.1%
Utility	0.3%	5.1%	0.0%	0.3%	0.4%	0.4%	0.2%	10.3%	24.0%	4.5%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind										
Forecasted WS (m/s)	8.4	8.5	8.1	7.8	7.9	8.1	8.9	9.6	9.4	8.5
Measured WS (m/s)	8.3	7.7	8	7.3	6.8	8.3	8.5	7.7	7	7.7
WindSpeed Deviation	-1.6%	-9.8%	-0.7%	-5.9%	-14.1%	2.0%	-4.4%	-20.3%	-25.4%	-8.8%


PLANT PRODUCTION

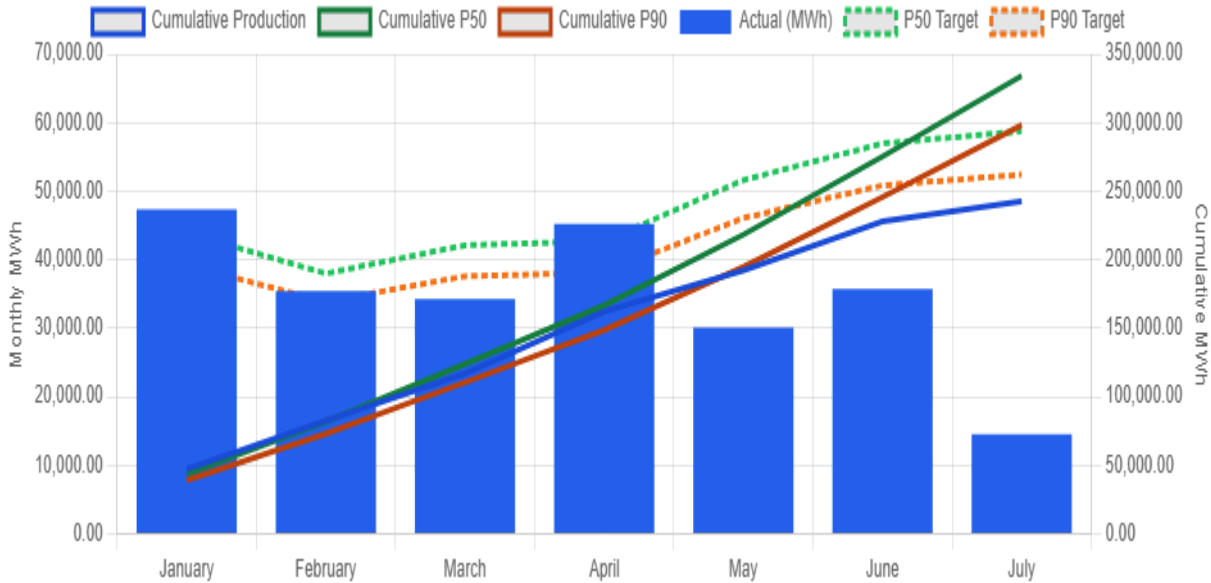


ANNUAL PRODUCTION AND AVAILABILITY PER WT

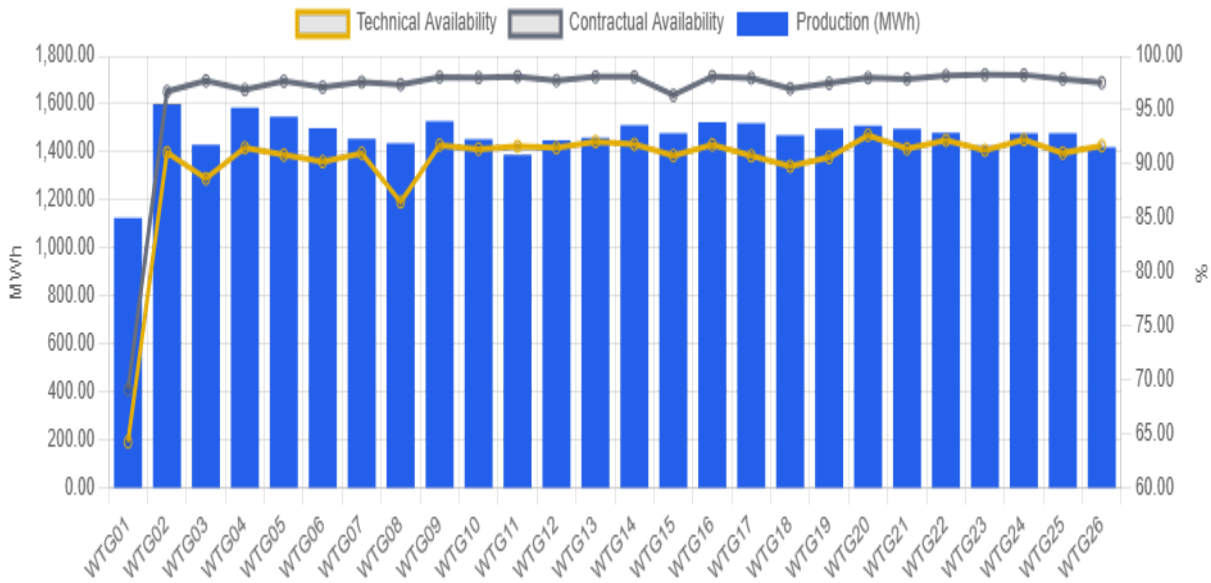

PLANT AVAILABILITY

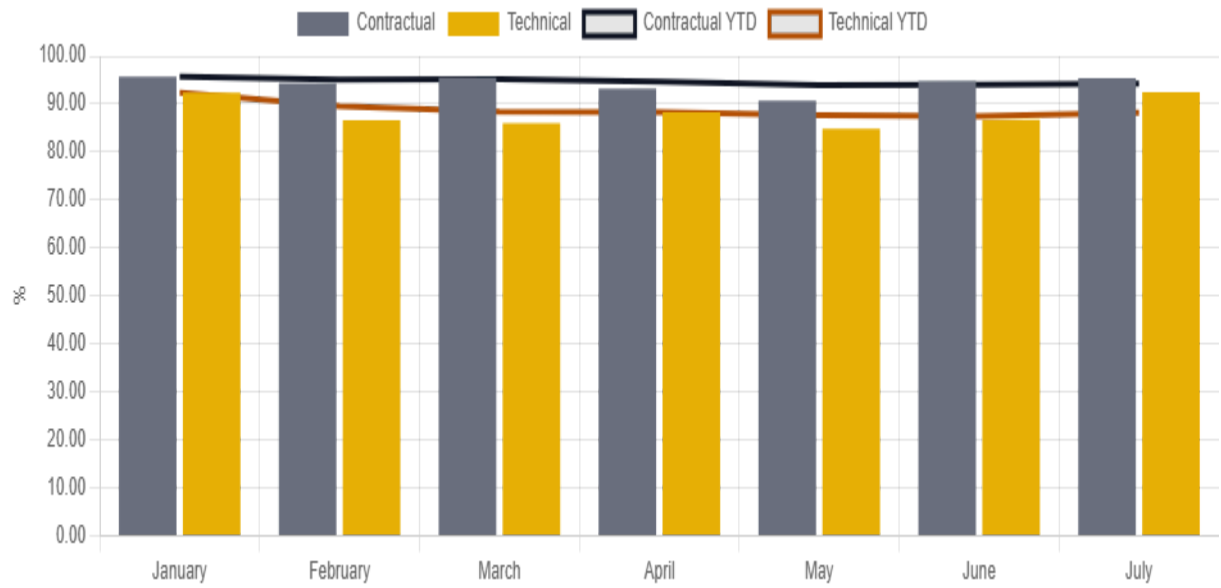

OPERATIONAL LOSS FACTORS

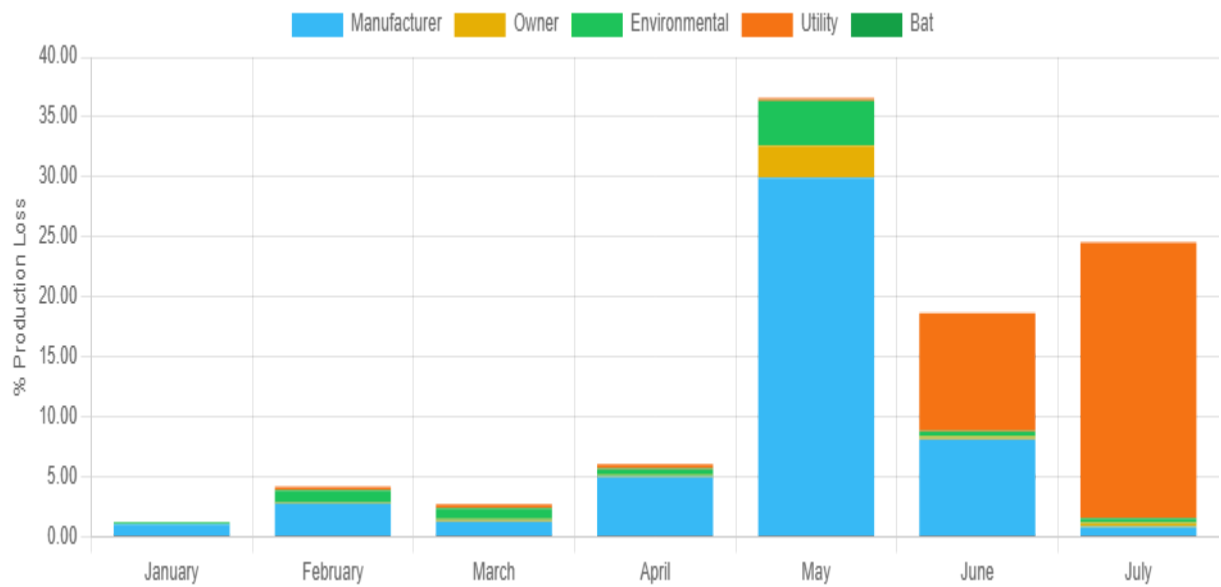

WIND SPEED

