



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production							
Measured (MWh)	82,951	32,127	28,644	20,163	0	2,017	82,951
Deviation Historical	–	–	–	–	–	–	–
Deviation P50	-66.6%	-17.7%	-40.6%	-57.6%	-100.0%	-96.6%	-66.6%
Deviation P90	-63.0%	-8.9%	-34.2%	-53.1%	-100.0%	-96.2%	-63.0%
Capacity Factor	16.1%	32.8%	26.4%	19.2%	0.0%	1.9%	16.1%
Electrical Losses	-41.4%	1.2%	-15.8%	-50.9%	-100.0%	–	-41.4%
B. Consumption							
Measured Consumption (MWh)	82	38	15	15	14	–	82
Ratio to Production	0.1%	0.1%	0.0%	0.0%	0.0%	–	0.1%
C. Availability							
Contractual availability	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%
Technical availability	98.9%	97.3%	99.4%	99.5%	100.0%	98.5%	98.9%
Technical availability - Energy based	69.1%	94.5%	81.3%	51.4%	34.1%	84.2%	69.1%
D. Downtime							
Manufacturer	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
Owner	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
Environmental	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
Utility	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
Bat Curtailment	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%	0.000%
E. Wind							
Forecasted WS (m/s)	8.4 m/s	8 m/s	8 m/s	8 m/s	8.7 m/s	9.3 m/s	8.4 m/s
Measured WS (m/s)	7.7 m/s	7.3 m/s	6.8 m/s	8.2 m/s	–	8.3 m/s	7.7 m/s
WindSpeed Deviation	-26.1%	-8.3%	-14.0%	2.2%	-100.0%	-10.5%	-26.1%


PRODUCTION VS TARGET

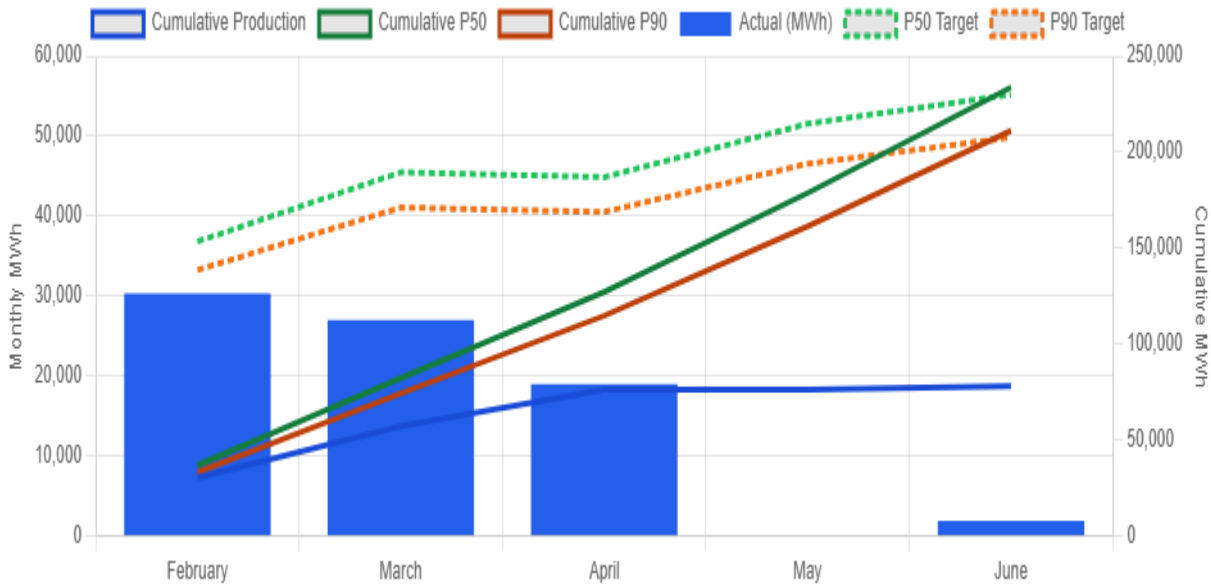


TURBINE-LEVEL PRODUCTION & AVAILABILITY

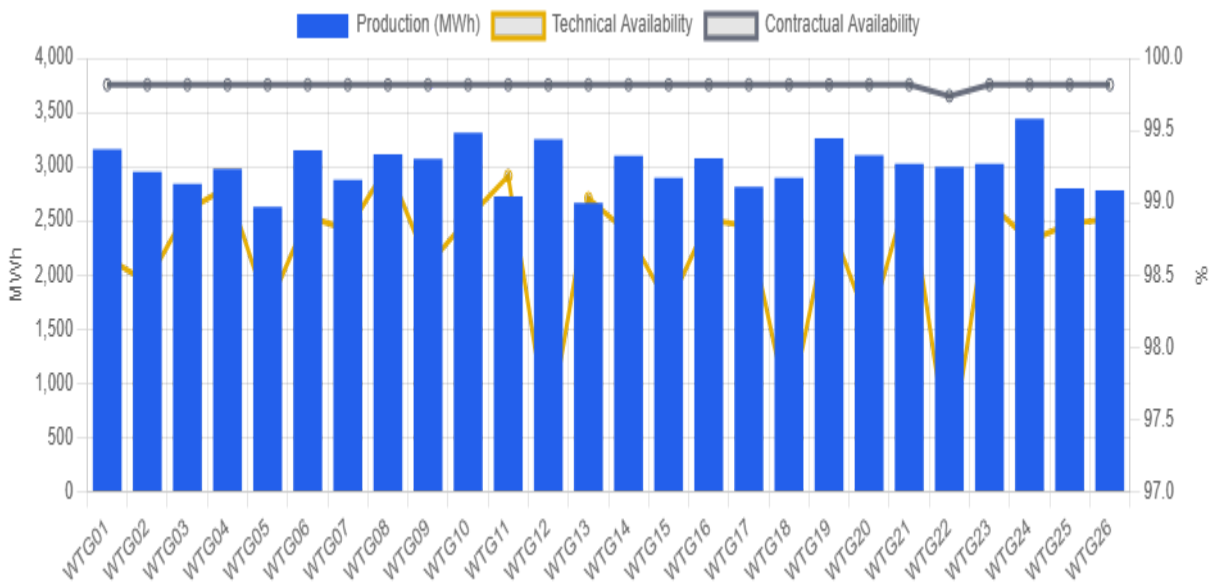

AVAILABILITY TREND

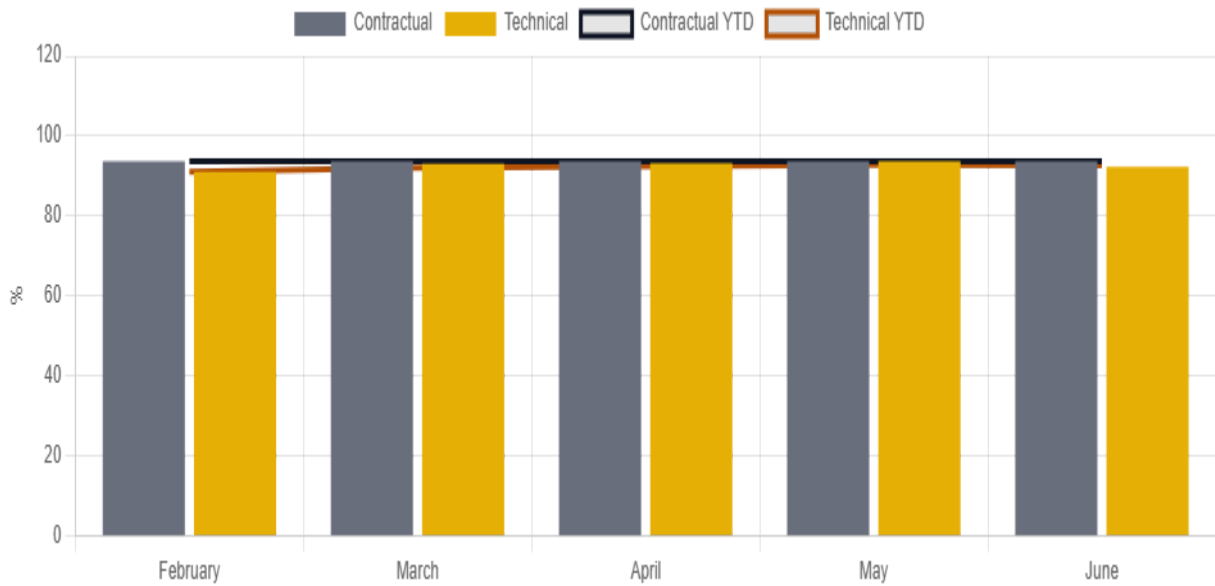

DOWNTIME BY CAUSE

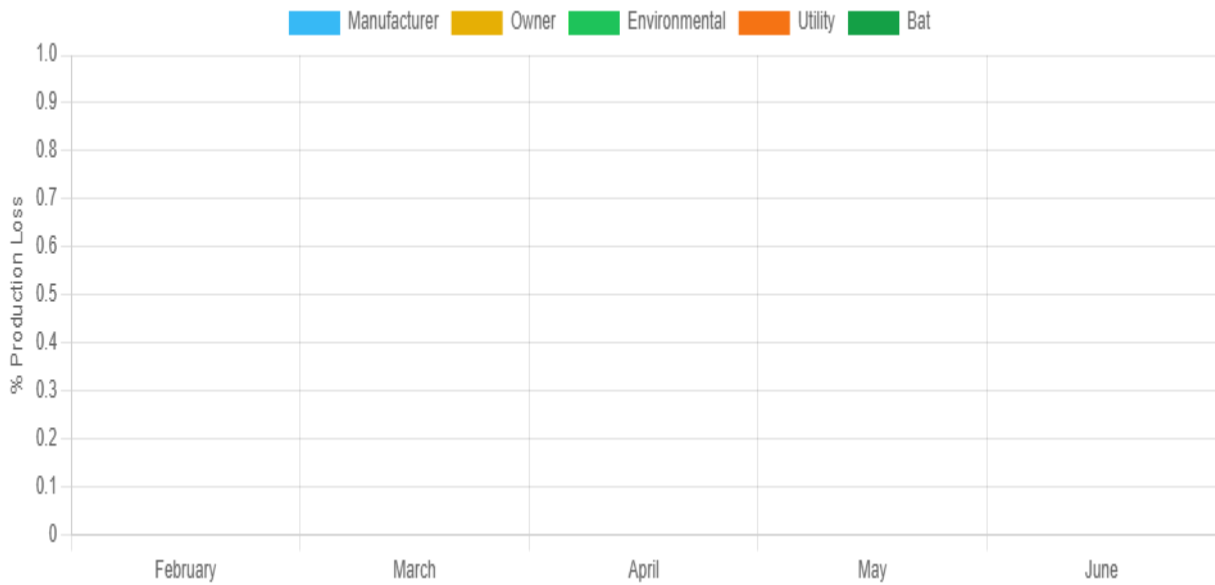

WIND RESOURCE

