



FULL KPI MATRIX

| CATEGORY                 | 2026    | FEB    | MAR     | APR     | MAY     | JUN    | JUL    | TOTAL   |
|--------------------------|---------|--------|---------|---------|---------|--------|--------|---------|
| A. Production            |         |        |         |         |         |        |        |         |
| Measured (MWh)           | 172,534 | 8,096  | 36,822  | 44,460  | 33,537  | 35,741 | 13,876 | 172,534 |
| Deviation Historical     | –       | –      | –       | –       | –       | –      | –      | –       |
| Deviation P50            | -39.7%  | -33.2% | -22.6%  | -6.6%   | -40.1%  | -40.9% | -77.8% | -39.7%  |
| Deviation P90            | -31.9%  | -24.7% | -12.7%  | 5.4%    | -32.4%  | -33.3% | -74.9% | -31.9%  |
| Capacity Factor          | 5.5%    | 1.7%   | 0.0%    | 0.0%    | 0.0%    | 6.4%   | 24.8%  | 5.5%    |
| Electrical Losses        | -92.1%  | -79.1% | -100.0% | -100.0% | -100.0% | -81.4% | –      | -92.1%  |
| B. Consumption           |         |        |         |         |         |        |        |         |
| Measured (MWh)           | 78      | 0      | 28      | 9       | 12      | 29     | –      | 78      |
| Ratio to Production      | 0.0%    | 0.0%   | 0.1%    | 0.0%    | 0.0%    | 0.1%   | –      | 0.0%    |
| C. Availability          |         |        |         |         |         |        |        |         |
| Contractual - Time Based | 100.0%  | 100.0% | 100.0%  | 100.0%  | 100.0%  | 99.9%  | 99.9%  | 100.0%  |
| TBA - Time Based         | 99.2%   | 99.4%  | –       | 100.0%  | 100.0%  | 99.2%  | 97.4%  | 99.2%   |
| PBA - Energy Based       | 59.2%   | 27.2%  | 0.0%    | 32.6%   | 96.3%   | 99.5%  | 99.8%  | 59.2%   |
| D. OLF - Losses          |         |        |         |         |         |        |        |         |
| Manufacturer             | 40.8%   | 72.8%  | 100.0%  | 67.3%   | 3.7%    | 0.5%   | 0.2%   | 40.8%   |
| Owner                    | 0.0%    | 0.0%   | 0.0%    | 0.0%    | 0.0%    | 0.0%   | 0.1%   | 0.0%    |
| Environmental            | 0.5%    | 0.0%   | 0.0%    | 0.0%    | 0.0%    | 0.7%   | 2.5%   | 0.5%    |
| Utility                  | 7.3%    | 0.0%   | 0.0%    | 0.0%    | 0.0%    | 16.9%  | 26.8%  | 7.3%    |
| Bat Curtailment          | 0.0%    | 0.0%   | 0.0%    | 0.0%    | 0.0%    | 0.0%   | 0.0%   | 0.0%    |
| E. Wind                  |         |        |         |         |         |        |        |         |
| Forecasted WS (m/s)      | 8       | 7.5    | 7.5     | 7.5     | 8.1     | 8.7    | 8.5    | 8       |
| Measured WS (m/s)        | 7.6     | 6      | –       | –       | –       | 9.1    | 7.7    | 7.6     |
| WindSpeed Deviation      | -54.0%  | -20.3% | -100.0% | -100.0% | -100.0% | 5.4%   | -8.9%  | -54.0%  |


PLANT PRODUCTION

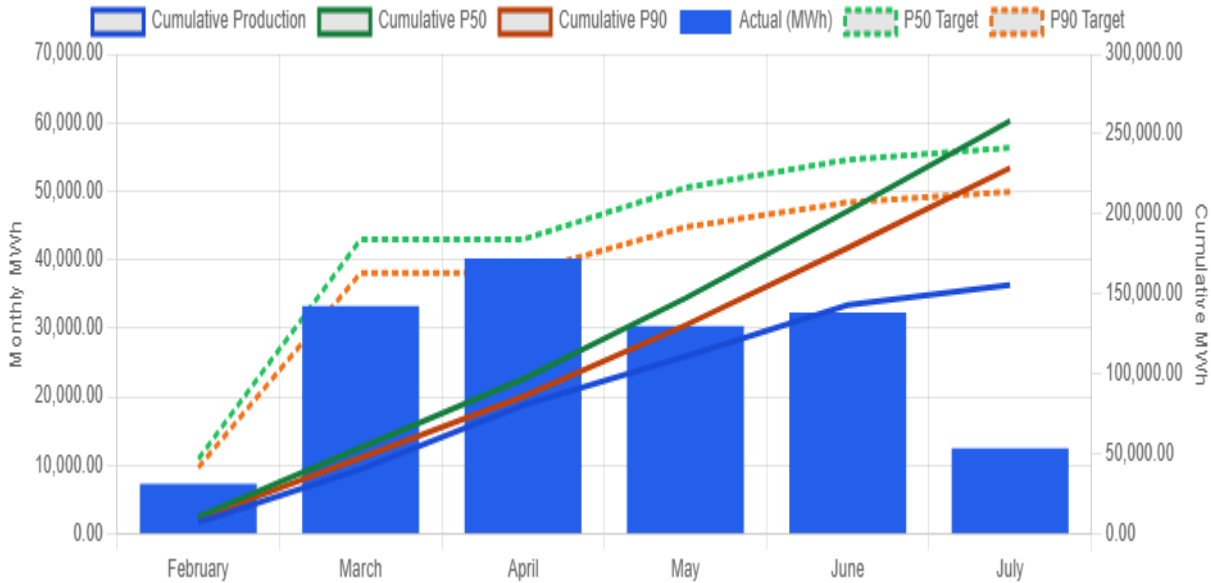


ANNUAL PRODUCTION AND AVAILABILITY PER WT

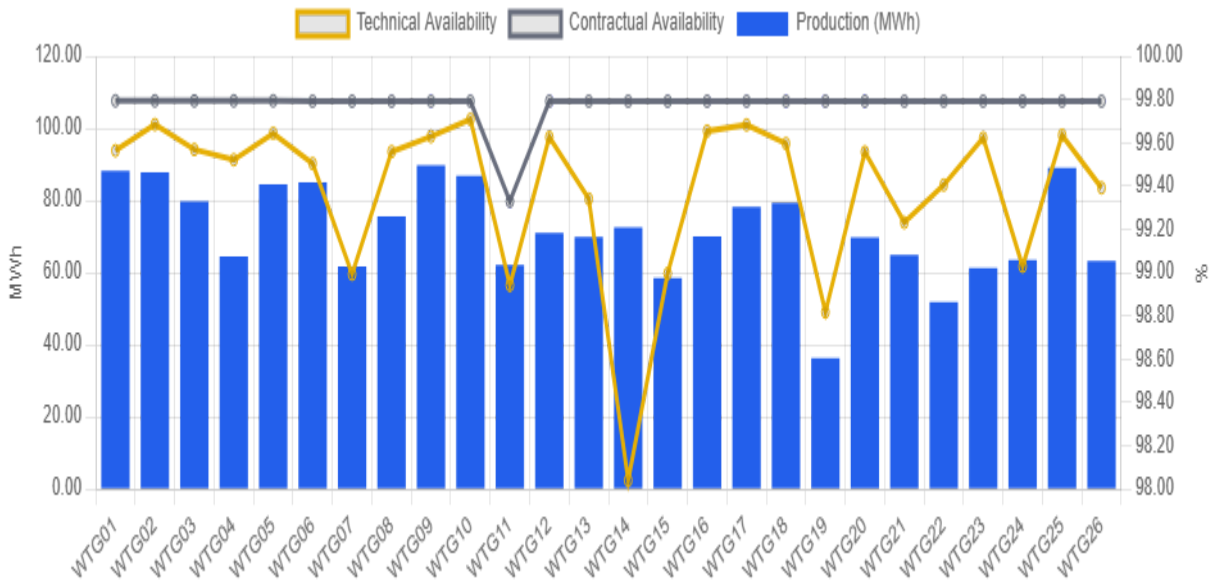

## PLANT AVAILABILITY

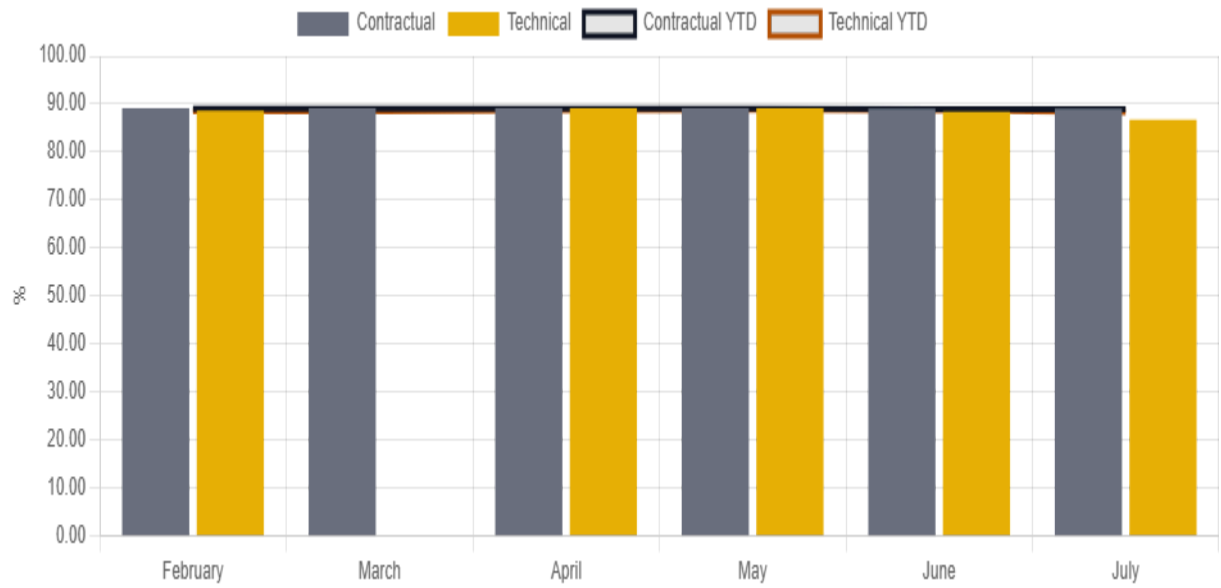

## OPERATIONAL LOSS FACTORS

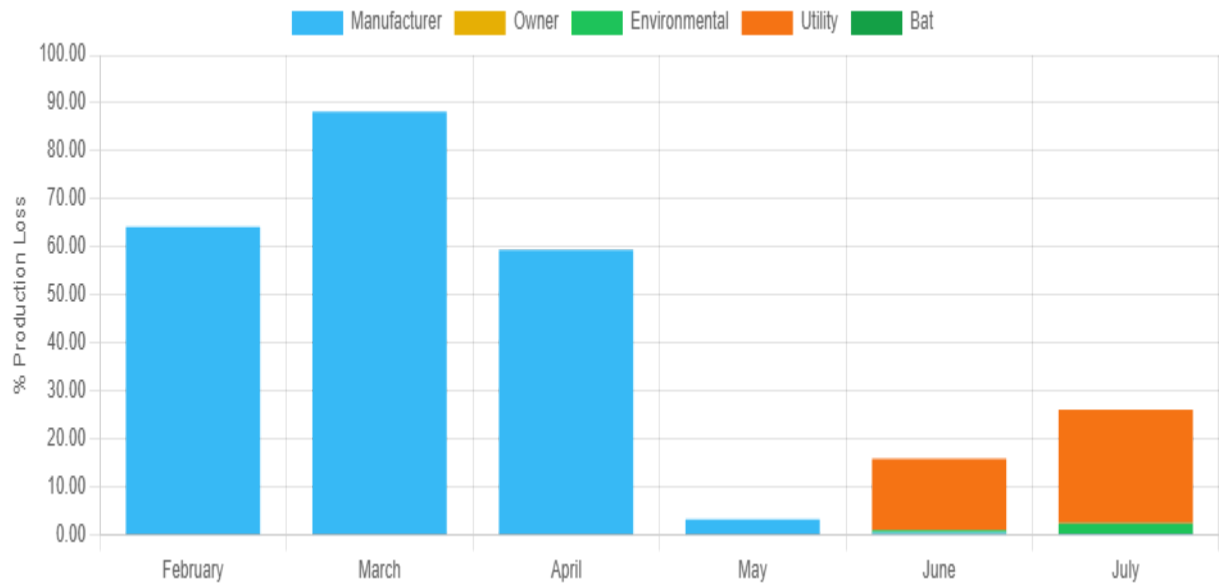

WIND SPEED

