


Wesley: the plant produced 7.8 GWh, significantly below historical, P50 and P90 targets. Contractual availability averaged 97.6%, while technical availability was 97.5%. Losses were dominated by grid curtailments (recoverable losses).


FULL KPI MATRIX

CATEGORY	2022	2023	2024	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	TOTAL
A. Production													
Measured (MWh)	129,047	132,295	132,220	127,062	64,973	10,049	10,554	10,719	9,132	8,946	7,787	7,787	585,597
Deviation Historical	-	2.5%	1.2%	-3.1%	-12.4%	-7.8%	6.7%	-3.7%	-10.9%	2.7%	-32.9%	-33.4%	-1.8%
Deviation P50	-8.6%	-6.3%	-6.3%	-10.0%	-17.0%	-12.2%	2.3%	-6.3%	-15.0%	-19.9%	-32.8%	-32.8%	-8.9%
Deviation P90	2.7%	5.3%	5.2%	1.1%	-6.8%	-1.4%	14.9%	5.2%	-4.5%	-10.0%	-24.5%	-24.5%	2.3%
Capacity Factor	1.8%	36.8%	44.4%	42.5%	36.8%	39.7%	45.6%	42.4%	37.4%	33.2%	31.5%	28.0%	32.1%
Electrical Losses	-95.8%	-15.5%	1.6%	0.9%	-1.0%	1.4%	0.1%	1.6%	1.7%	-4.6%	0.5%	-7.8%	-23.9%
B. Consumption													
Measured (MWh)	172	174	186	166	136	17	16	19	16	20	23	25	833
Ratio to Production	0.1%	0.1%	0.1%	0.1%	0.2%	0.2%	0.1%	0.2%	0.2%	0.2%	0.3%	0.3%	0.1%
C. Availability													
TBA - Contractual	-	97.3%	96.5%	97.9%	98.3%	99.1%	97.4%	99.3%	98.7%	98.1%	97.9%	97.6%	97.4%
TBA - Technical	-	96.6%	95.5%	97.3%	97.5%	99.0%	97.3%	99.0%	94.5%	97.9%	97.1%	97.5%	96.6%
PBA - Technical	4.3%	96.0%	96.6%	98.2%	98.3%	99.0%	97.1%	99.7%	97.7%	98.3%	98.7%	97.4%	76.9%
D. OLF - Losses													
Manufacturer	0.0%	4.2%	4.2%	2.1%	1.8%	1.0%	2.9%	0.4%	2.3%	1.7%	1.4%	2.9%	2.5%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Environmental	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Utility	0.0%	0.4%	1.0%	3.4%	7.1%	0.8%	0.7%	7.2%	15.0%	9.7%	10.8%	5.5%	2.0%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind													
Forecasted WS (m/s)	8.3	8.3	8.3	8.3	7.9	8.1	7.3	8.1	7.6	7.9	8.2	8.2	8.3
Measured WS (m/s)	7.8	7.9	8	7.8	7.3	7.3	7.9	7.9	7.7	7.4	6.8	6.4	7.8
WindSpeed Deviation	-6.3%	-5.3%	-3.7%	-6.0%	-6.8%	-9.4%	8.8%	-2.0%	0.9%	-6.4%	-17.0%	-22.5%	-5.5%


PLANT PRODUCTION

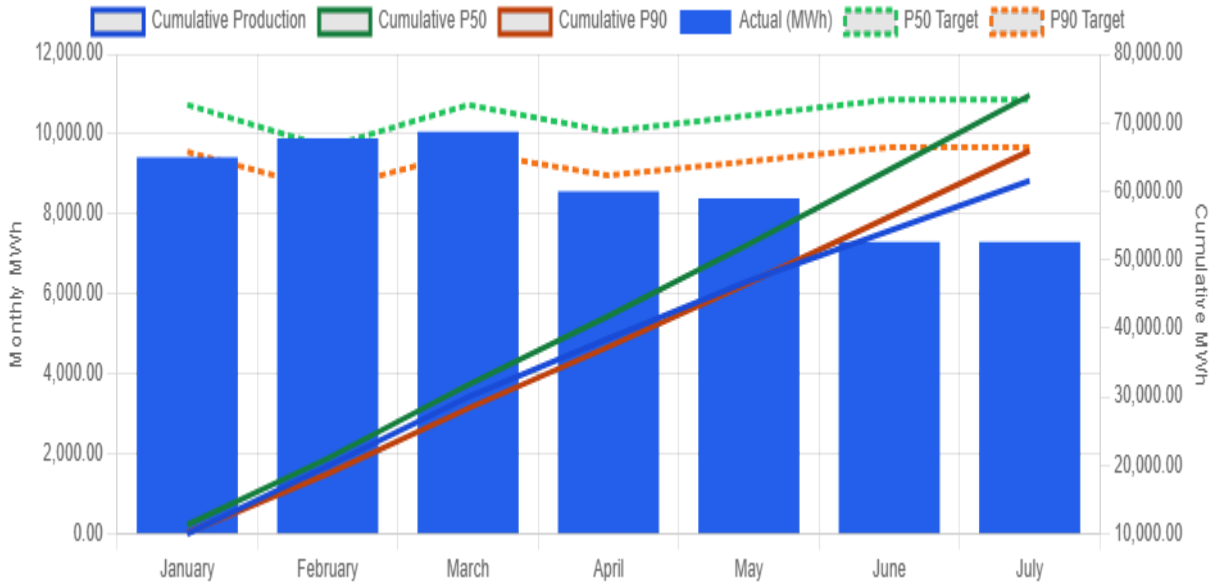


ANNUAL PRODUCTION AND AVAILABILITY PER WT

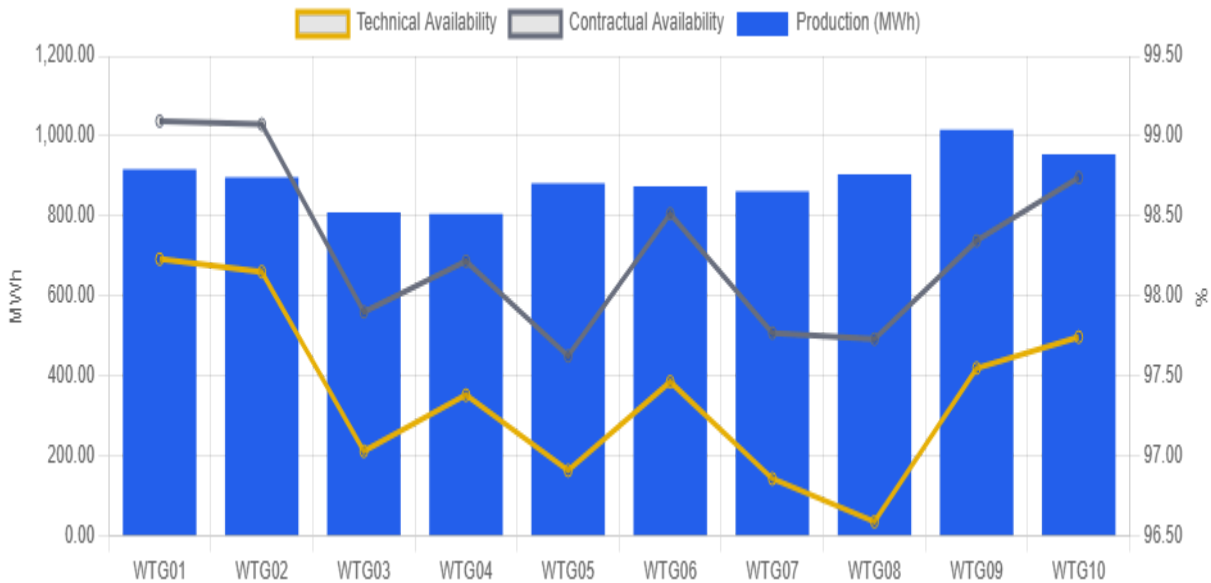

PLANT AVAILABILITY

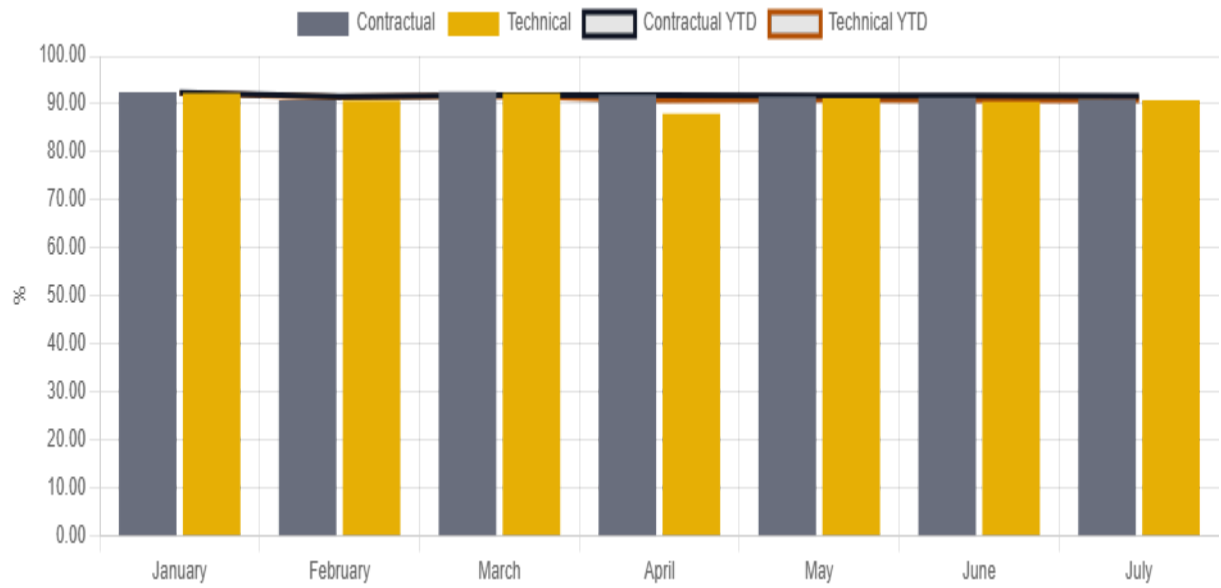

OPERATIONAL LOSS FACTORS

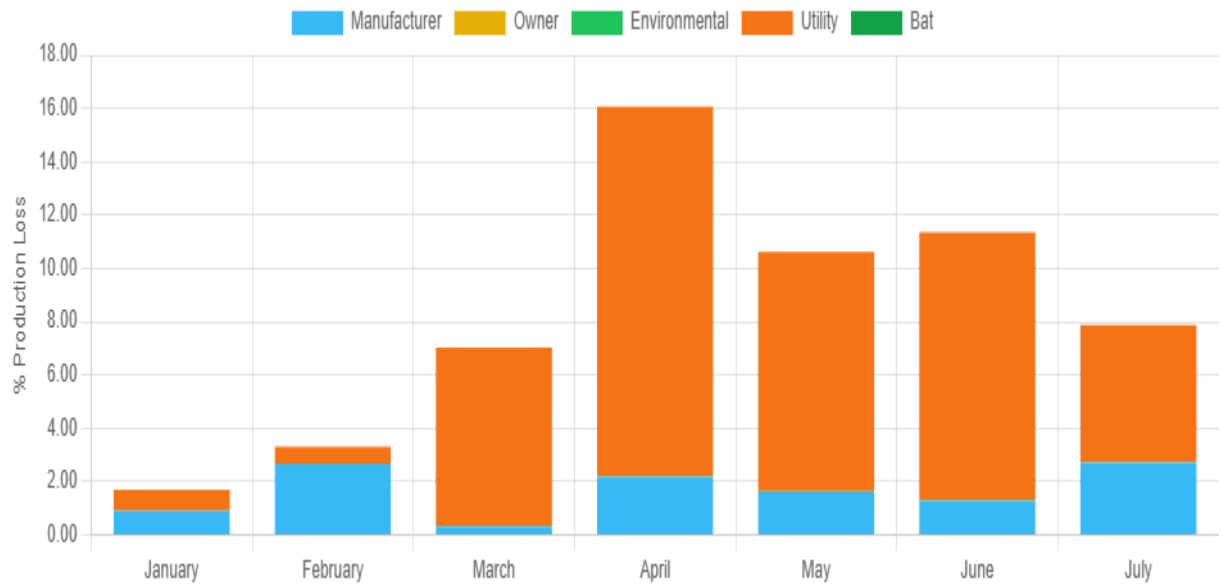

WIND SPEED

