



FULL KPI MATRIX

| CATEGORY                 | 2026    | FEB     | MAR     | APR     | MAY     | JUN     | TOTAL   |
|--------------------------|---------|---------|---------|---------|---------|---------|---------|
| A. Production            |         |         |         |         |         |         |         |
| Measured (MWh)           | 8,358   | 1,694   | 0       | 0       | 0       | 6,663   | 8,358   |
| Deviation Historical     | –       | –       | –       | –       | –       | –       | –       |
| Deviation P50            | -96.3%  | -86.0%  | -100.0% | -100.0% | -100.0% | -89.0%  | -96.3%  |
| Deviation P90            | -95.8%  | -84.2%  | -100.0% | -100.0% | -100.0% | -87.6%  | -95.8%  |
| Capacity Factor          | 1.6%    | 1.7%    | 0.0%    | 0.0%    | 0.0%    | 6.4%    | 1.6%    |
| Electrical Losses        | -92.1%  | -79.1%  | -100.0% | -100.0% | -100.0% | -81.4%  | -92.1%  |
| B. Consumption           |         |         |         |         |         |         |         |
| Measured (MWh)           | 78      | 0       | 28      | 9       | 12      | 29      | 78      |
| Ratio to Production      | 0.0%    | 0.0%    | 0.1%    | 0.0%    | 0.0%    | 0.1%    | 0.0%    |
| C. Availability          |         |         |         |         |         |         |         |
| Contractual - Time Based | 100.0%  | 100.0%  | 100.0%  | 100.0%  | 100.0%  | 99.9%   | 100.0%  |
| TBA - Time Based         | 99.7%   | 99.4%   | –       | 100.0%  | 100.0%  | 99.2%   | 99.7%   |
| PBA - Energy Based       | 51.1%   | 27.2%   | 0.0%    | 32.6%   | 96.3%   | 99.5%   | 51.1%   |
| D. OLF - Losses          |         |         |         |         |         |         |         |
| Manufacturer             | 48.9%   | 72.8%   | 100.0%  | 67.3%   | 3.7%    | 0.5%    | 48.9%   |
| Owner                    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    |
| Environmental            | 0.1%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.7%    | 0.1%    |
| Utility                  | 3.4%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 16.9%   | 3.4%    |
| Bat Curtailment          | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    | 0.0%    |
| E. Wind                  |         |         |         |         |         |         |         |
| Forecasted WS (m/s)      | 7.8 m/s | 7.5 m/s | 7.5 m/s | 7.5 m/s | 8.1 m/s | 8.7 m/s | 7.8 m/s |
| Measured WS (m/s)        | 7.6 m/s | 6 m/s   | –       | –       | –       | 9.1 m/s | 7.6 m/s |
| WindSpeed Deviation      | -63.0%  | -20.3%  | -100.0% | -100.0% | -100.0% | 5.4%    | -63.0%  |


PLANT PRODUCTION

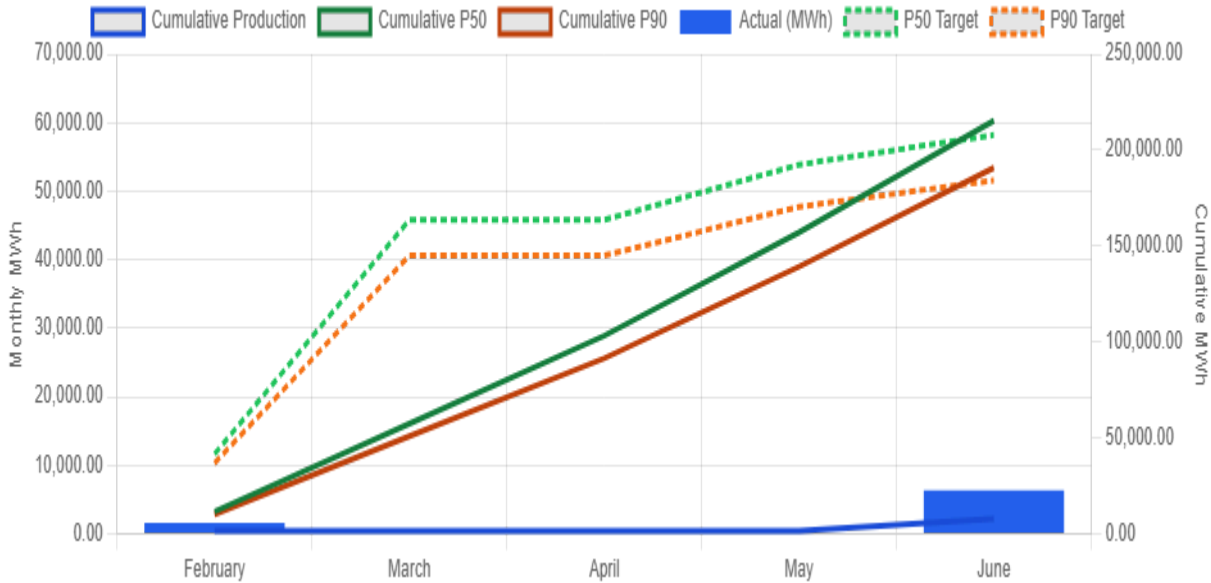


ANNUAL PRODUCTION AND AVAILABILITY PER WT

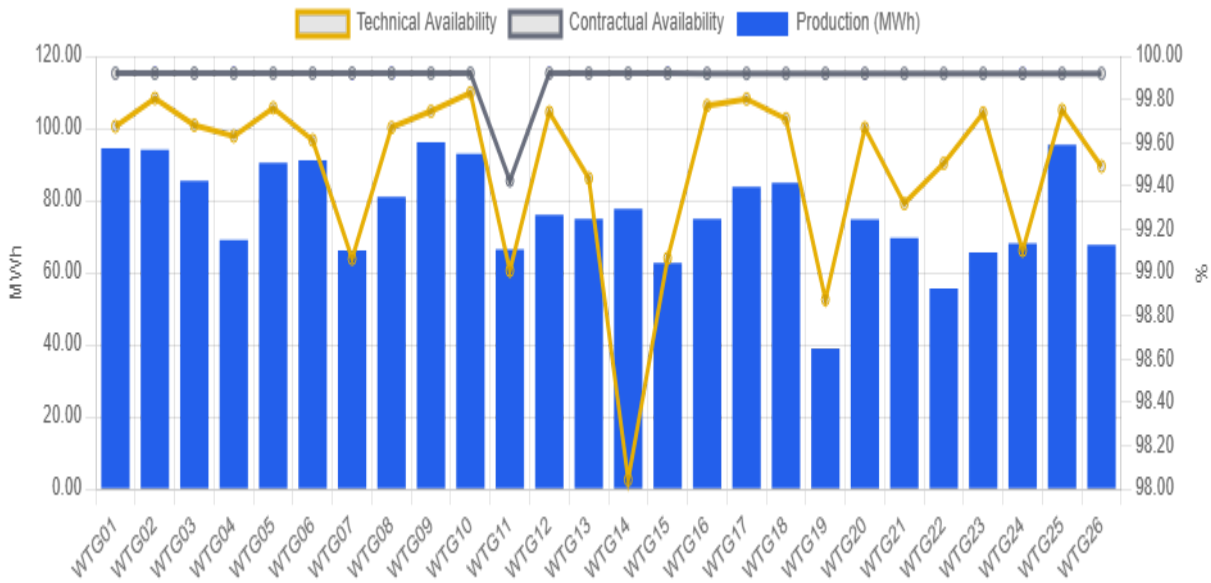

## PLANT AVAILABILITY

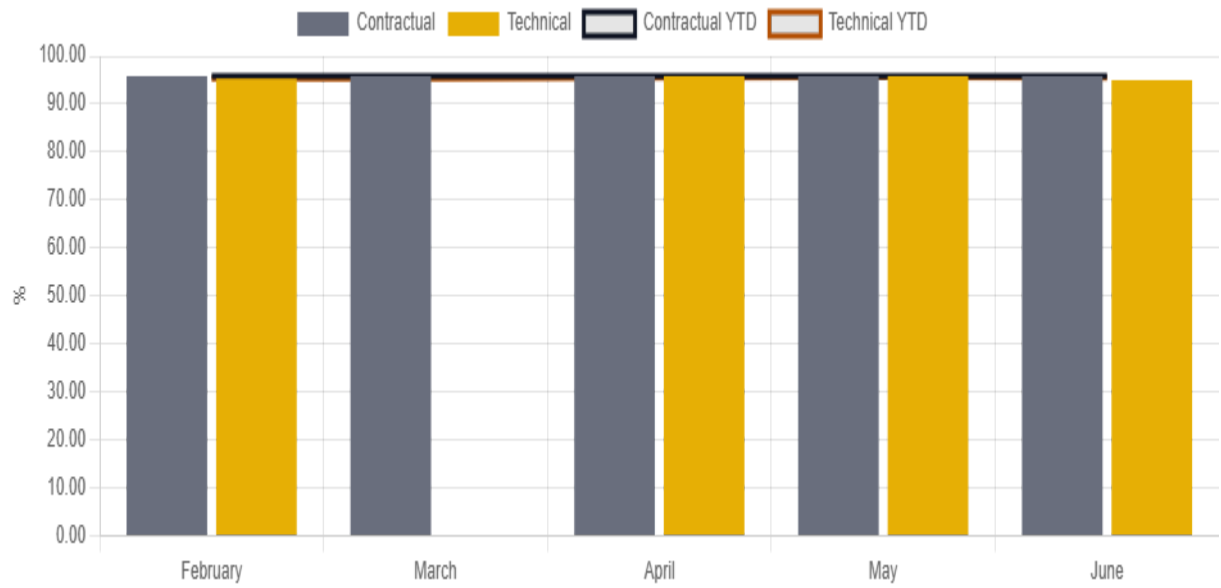

## OPERATIONAL LOSS FACTORS

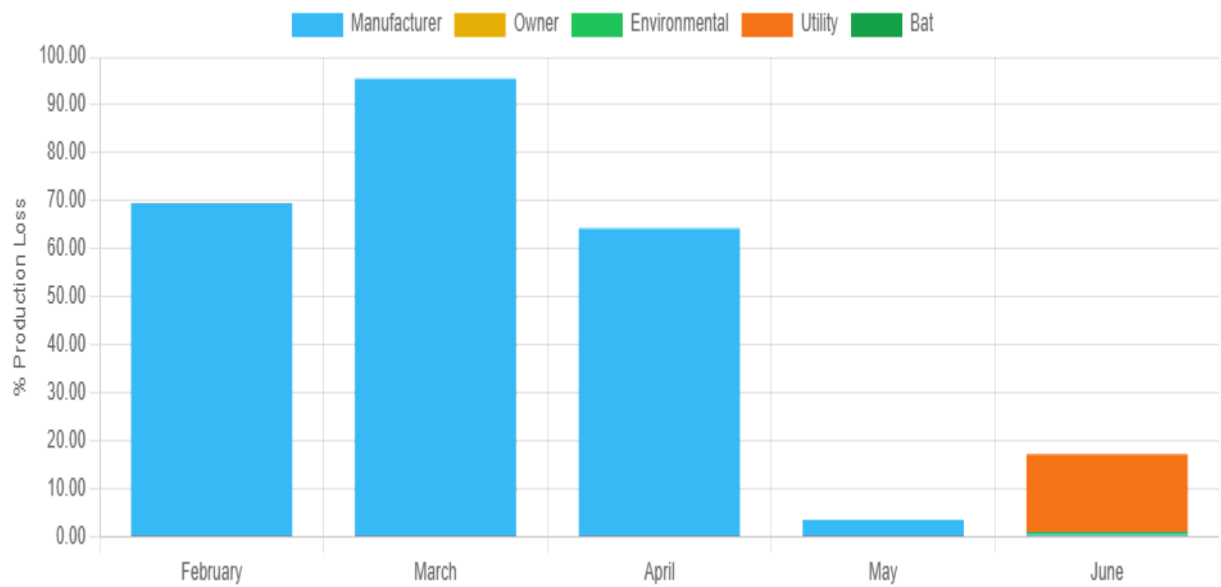

WIND SPEED

