



FULL KPI MATRIX

CATEGORY	2026	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production							
Measured (MWh)	162,744	32,127	28,644	39,730	29,475	32,768	162,744
Deviation Historical	–	–	–	–	–	–	–
Deviation P50	-34.4%	-17.7%	-40.6%	-16.5%	-46.1%	-44.0%	-34.4%
Deviation P90	-27.4%	-8.9%	-34.2%	-7.6%	-40.3%	-38.0%	-27.4%
Capacity Factor	31.1%	32.8%	26.4%	37.9%	27.2%	31.3%	31.1%
Electrical Losses	-3.1%	1.2%	-15.8%	-3.2%	1.1%	1.3%	-3.1%
B. Consumption							
Measured (MWh)	113	38	15	15	14	31	113
Ratio to Production	0.1%	0.1%	0.0%	0.0%	0.0%	0.1%	0.1%
C. Availability							
Contractual - Time Based	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%
TBA - Time Based	97.9%	97.3%	99.4%	98.6%	97.1%	97.3%	97.9%
PBA - Energy Based	93.3%	94.5%	81.3%	96.6%	95.8%	98.3%	93.3%
D. OLF - Losses							
Manufacturer	18.3%	5.9%	21.3%	14.7%	34.1%	15.7%	18.3%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Environmental	1.0%	0.0%	0.0%	1.1%	3.5%	0.6%	1.0%
Utility	1.9%	0.0%	0.0%	0.0%	0.0%	9.6%	1.9%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind							
Forecasted WS (m/s)	8.4 m/s	8 m/s	8 m/s	8 m/s	8.7 m/s	9.3 m/s	8.4 m/s
Measured WS (m/s)	7.6 m/s	7.3 m/s	6.8 m/s	8.3 m/s	8.1 m/s	7.4 m/s	7.6 m/s
WindSpeed Deviation	-9.2%	-8.3%	-14.0%	3.3%	-6.2%	-20.6%	-9.2%


PLANT PRODUCTION

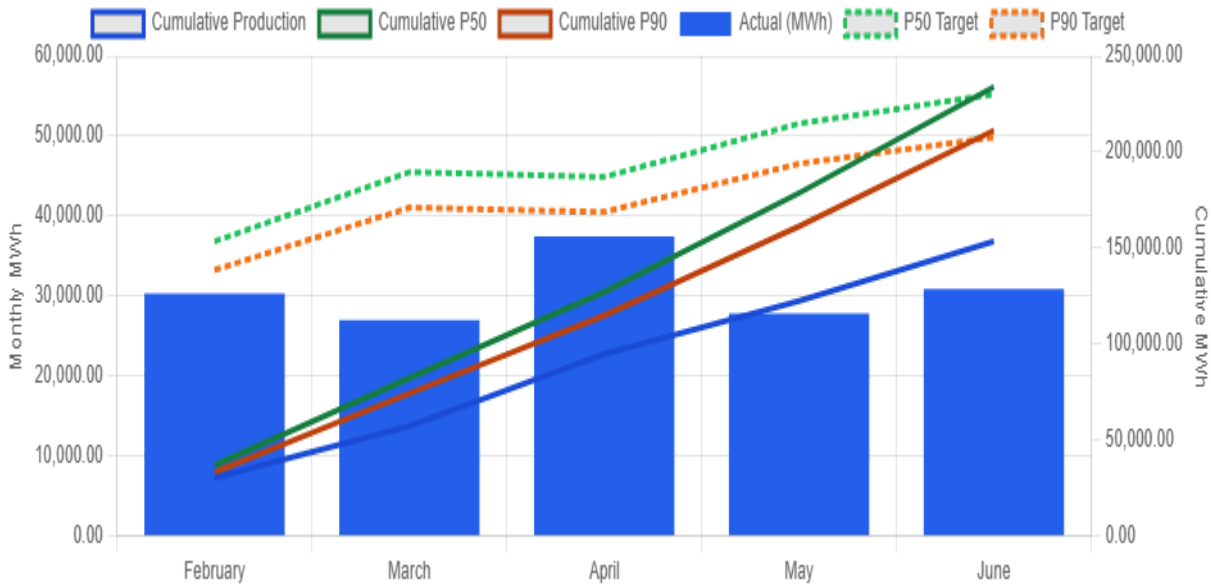


ANNUAL PRODUCTION AND AVAILABILITY PER WT

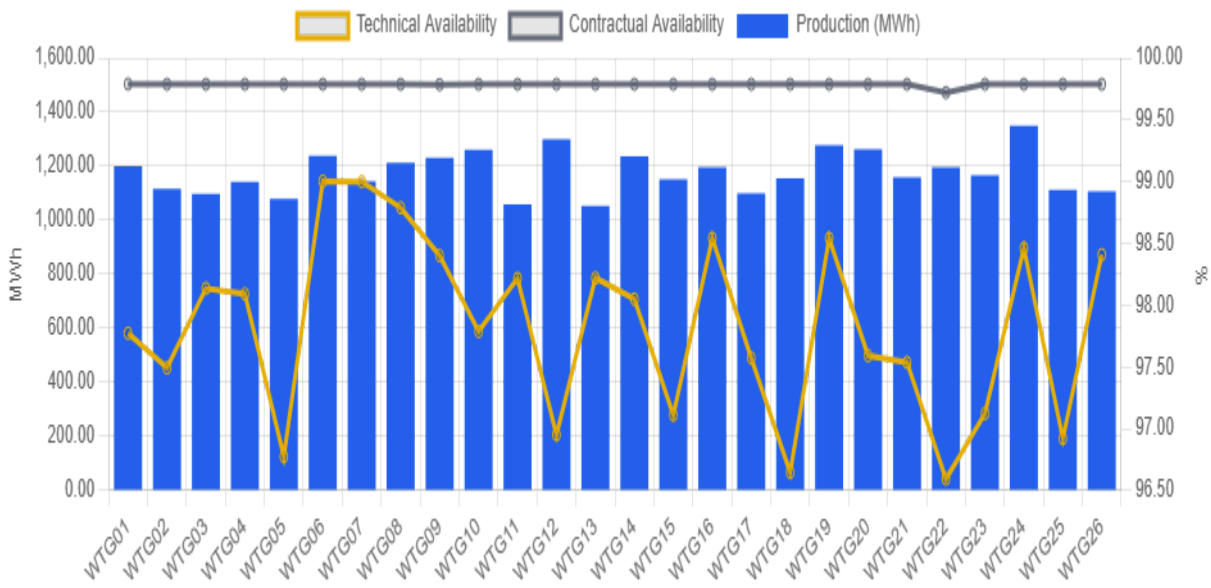

PLANT AVAILABILITY

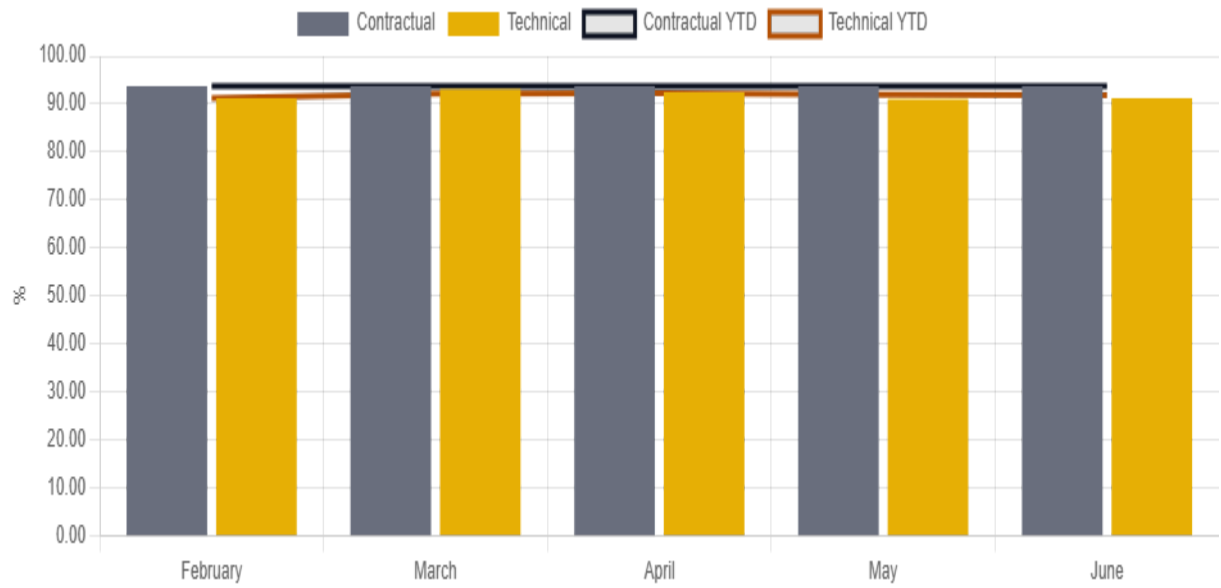

OPERATIONAL LOSS FACTORS

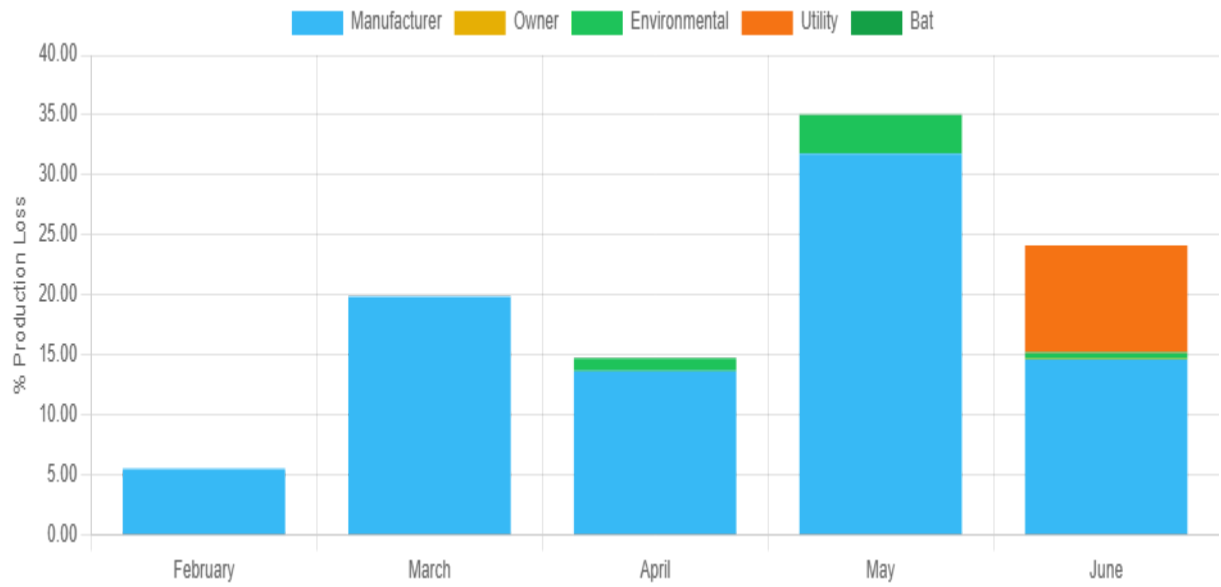

WIND SPEED

