



FULL KPI MATRIX

CATEGORY	2022	2023	2024	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production												
Measured (MWh)	91,310	93,813	93,177	87,626	39,791	6,458	5,488	5,741	7,302	6,946	7,856	405,717
Deviation Historical	-	3.9%	1.8%	-4.5%	-5.8%	3.3%	-4.2%	-16.1%	6.5%	3.0%	-19.9%	-0.4%
Deviation P50	-10.7%	-54.1%	-54.4%	-57.2%	-59.5%	-60.0%	-59.3%	-59.9%	-53.6%	-61.0%	-62.0%	-50.2%
Deviation P90	2.6%	5.4%	4.7%	-1.6%	-6.9%	-8.2%	-6.6%	-7.9%	6.5%	-10.3%	-12.6%	1.7%
Capacity Factor	42.4%	43.4%	43.1%	40.6%	37.2%	35.3%	33.2%	31.4%	41.2%	38.0%	44.4%	41.8%
Electrical Losses	1.2%	1.0%	1.2%	0.6%	1.2%	1.1%	1.1%	1.2%	1.2%	1.2%	1.1%	1.0%
B. Consumption												
Measured (MWh)	100	83	117	118	90	15	12	19	19	17	8	508
Ratio to Production	0.1%	0.1%	0.1%	0.1%	0.2%	0.2%	0.2%	0.3%	0.3%	0.3%	0.1%	0.1%
C. Availability												
Contractual - Time Based	93.9%	88.5%	96.3%	96.9%	95.7%	96.9%	90.2%	92.8%	98.0%	99.5%	97.0%	94.1%
TBA - Time Based	93.7%	88.7%	92.9%	92.3%	91.4%	93.0%	86.8%	86.6%	92.1%	92.6%	97.1%	91.9%
PBA - Energy Based	97.2%	95.6%	95.5%	95.4%	95.7%	97.9%	89.5%	92.6%	98.3%	98.7%	97.5%	95.9%
D. OLF - Losses												
Manufacturer	2.8%	4.4%	2.6%	2.6%	4.3%	2.2%	10.5%	7.4%	1.7%	1.3%	2.5%	3.2%
Owner	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.0%	0.0%	0.0%	0.0%
Environmental	0.0%	0.0%	1.9%	1.9%	0.8%	1.6%	1.1%	1.7%	0.0%	0.0%	0.0%	0.9%
Utility	0.1%	0.0%	0.4%	1.7%	3.6%	1.5%	0.1%	1.4%	10.0%	8.0%	0.8%	0.9%
Bat Curtailment	0.0%	0.0%	0.1%	0.4%	0.2%	0.1%	0.2%	0.2%	0.3%	0.3%	0.0%	0.1%
E. Wind												
Forecasted WS (m/s)	8.2 m/s	8.2 m/s	8.2 m/s	8.2 m/s	8.1 m/s	7.9 m/s	7.8 m/s	7.6 m/s	7.4 m/s	8.4 m/s	9.3 m/s	8.2 m/s
Measured WS (m/s)	7.6 m/s	8 m/s	7.8 m/s	7.7 m/s	7.4 m/s	6.9 m/s	7 m/s	6.7 m/s	7.9 m/s	7.9 m/s	7.8 m/s	7.7 m/s
WindSpeed Deviation	-7.2%	-3.1%	-4.7%	-6.8%	-8.4%	-12.8%	-10.1%	-11.7%	6.3%	-5.6%	-16.5%	-5.8%


PLANT PRODUCTION

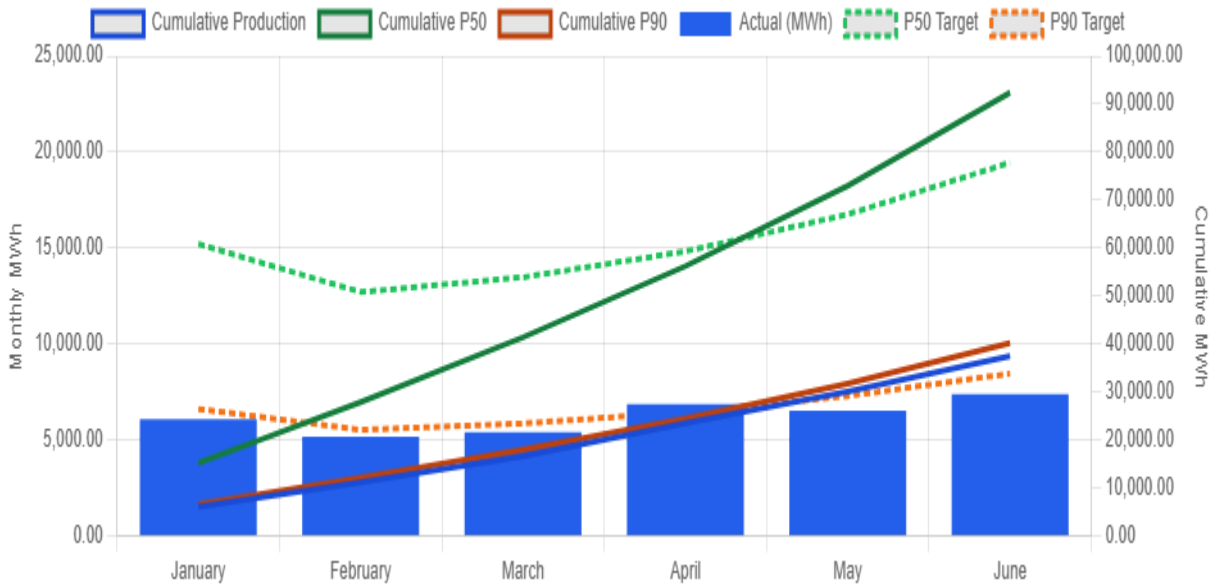


ANNUAL PRODUCTION AND AVAILABILITY PER WT

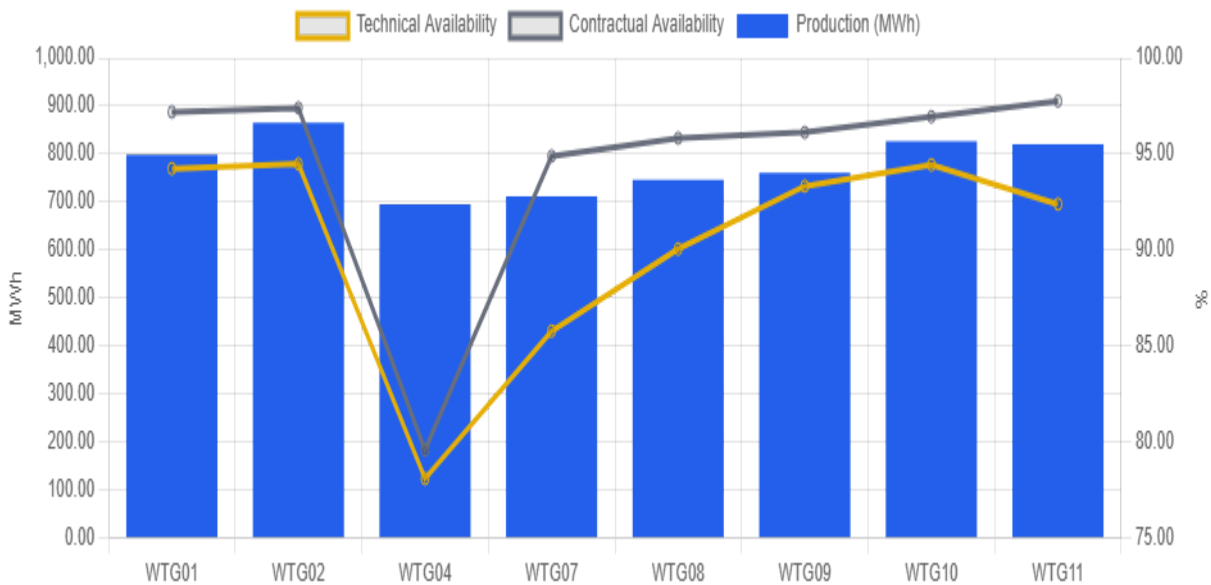

PLANT AVAILABILITY

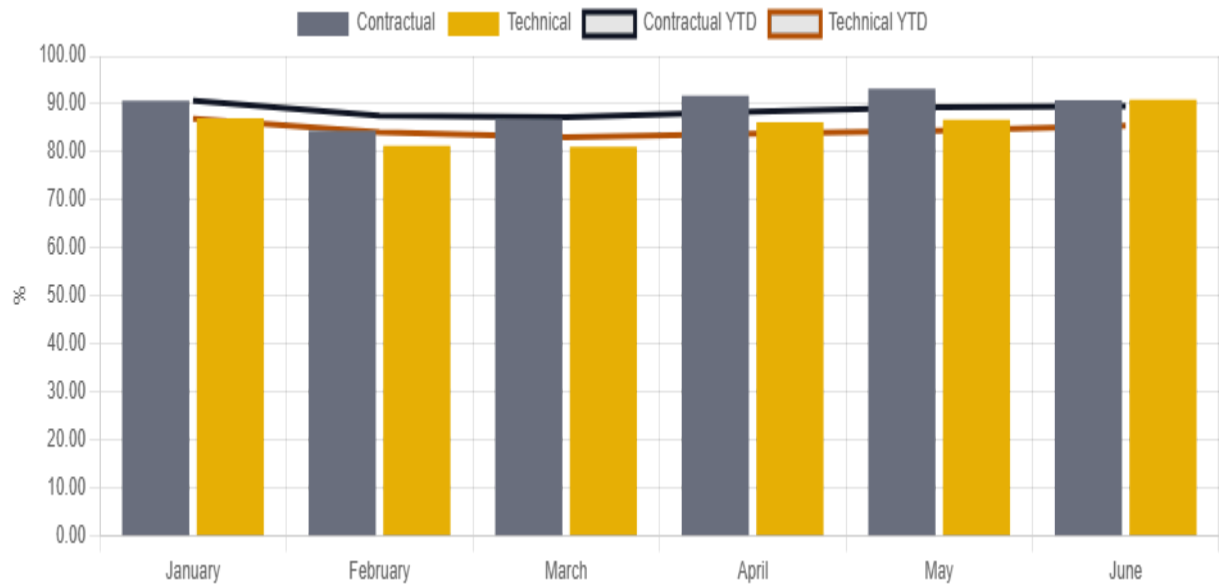

OPERATIONAL LOSS FACTORS

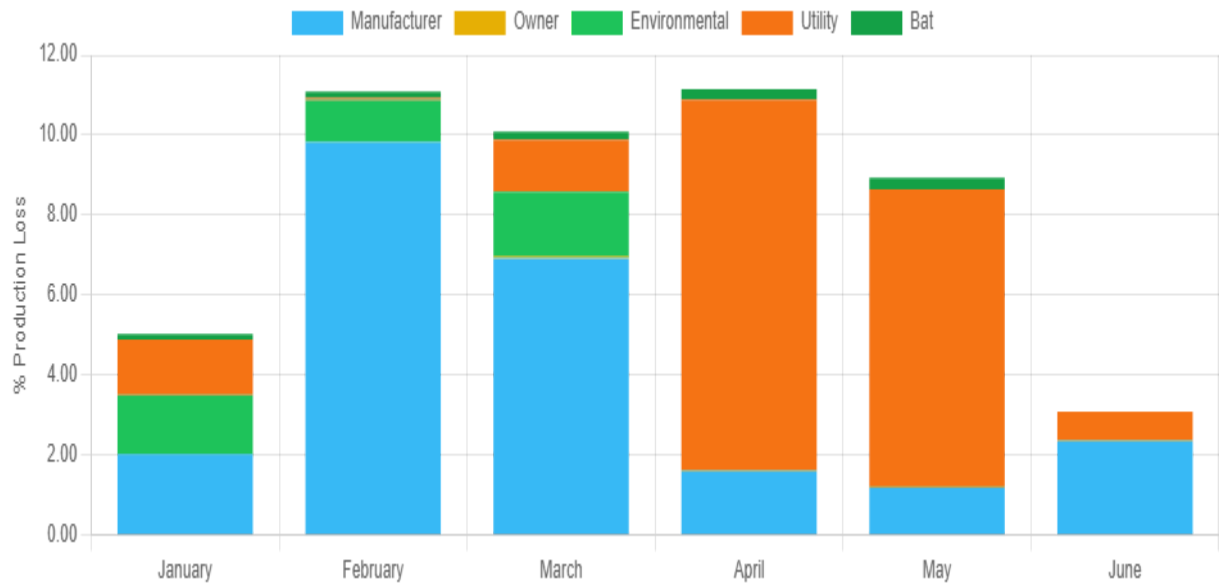

WIND SPEED

