


**San Kraal:** the plant produced 26.0 GWh, significantly below P50 and P90 targets. Contractual availability averaged 85.2%, while technical availability was lower at 81.8%. The negative delta in production was visible in the wind resource deviation of -24%.


FULL KPI MATRIX

| CATEGORY             | 2025   | 2026    | JAN    | FEB    | MAR    | APR    | MAY    | JUN    | JUL    | AUG    | TOTAL   |
|----------------------|--------|---------|--------|--------|--------|--------|--------|--------|--------|--------|---------|
| A. Production        |        |         |        |        |        |        |        |        |        |        |         |
| Measured (MWh)       | 35,374 | 300,204 | 49,138 | 36,763 | 35,552 | 46,951 | 31,244 | 37,114 | 37,409 | 26,032 | 335,578 |
| Deviation Historical | -      | -       | -      | -      | -      | -      | -      | -      | -      | -      | -       |
| Deviation P50        | 4.6%   | -26.7%  | 7.8%   | -6.8%  | -18.7% | 5.9%   | -41.7% | -37.2% | -38.7% | -58.6% | -24.3%  |
| Deviation P90        | 17.2%  | -17.9%  | 20.8%  | 4.5%   | -8.9%  | 18.6%  | -34.7% | -29.7% | -31.3% | -53.6% | -15.2%  |
| Capacity Factor      | 33.1%  | 35.9%   | 46.0%  | 38.1%  | 33.3%  | 45.5%  | 29.0%  | 35.7%  | 35.0%  | 24.3%  | 35.6%   |
| Electrical Losses    | 1.4%   | 1.3%    | 1.5%   | 1.4%   | 1.5%   | 1.6%   | 0.7%   | 0.9%   | 1.2%   | 1.3%   | 1.3%    |
| B. Consumption       |        |         |        |        |        |        |        |        |        |        |         |
| Measured (MWh)       | 0      | 228     | 28     | 26     | 34     | 16     | 16     | 42     | 27     | 40     | 228     |
| Ratio to Production  | 0.0%   | 0.1%    | 0.1%   | 0.1%   | 0.1%   | 0.0%   | 0.1%   | 0.1%   | 0.1%   | 0.2%   | 0.1%    |
| C. Availability      |        |         |        |        |        |        |        |        |        |        |         |
| TBA - Contractual    | 98.9%  | 96.5%   | 99.8%  | 98.2%  | 99.4%  | 97.1%  | 94.0%  | 98.7%  | 99.5%  | 85.2%  | 96.8%   |
| TBA - Technical      | 95.8%  | 93.1%   | 97.8%  | 94.4%  | 94.5%  | 94.8%  | 90.6%  | 95.7%  | 95.6%  | 81.8%  | 93.4%   |
| PBA - Technical      | 97.1%  | 81.9%   | 99.0%  | 95.8%  | 97.1%  | 91.9%  | 59.8%  | 80.2%  | 76.8%  | 54.7%  | 83.6%   |
| D. Losses Breakdown  |        |         |        |        |        |        |        |        |        |        |         |
| Grid                 | 0.3%   | 12.1%   | 0.0%   | 0.3%   | 0.8%   | 3.6%   | 31.0%  | 17.6%  | 21.8%  | 22.0%  | 10.8%   |
| Breakdown            | 1.3%   | 4.8%    | 0.1%   | 2.5%   | 0.5%   | 3.7%   | 6.4%   | 1.1%   | 0.3%   | 23.5%  | 4.4%    |
| Maintenance          | 0.2%   | 0.3%    | -      | 0.3%   | 0.5%   | 0.1%   | 0.4%   | 0.5%   | 0.2%   | 0.0%   | 0.3%    |
| Partial Perf.        | 0.0%   | 0.1%    | 0.0%   | 0.0%   | 0.1%   | 0.2%   | 0.1%   | 0.0%   | 0.0%   | 0.1%   | 0.1%    |
| Environmental        | 0.1%   | 0.1%    | 0.1%   | 0.1%   | 0.1%   | 0.1%   | 0.1%   | 0.0%   | 0.1%   | 0.1%   | 0.1%    |
| Data Quality         | 0.5%   | 0.3%    | 0.7%   | 0.1%   | 0.0%   | -      | -      | -      | -      | -      | 0.3%    |
| Requested Shutdown   | 0.4%   | 0.6%    | 0.1%   | 0.4%   | 0.5%   | 0.4%   | 1.9%   | 0.4%   | 0.8%   | 0.4%   | 0.6%    |
| BoP                  | 0.6%   | 0.3%    | 0.1%   | 0.6%   | 0.4%   | 0.1%   | 0.6%   | 0.1%   | 0.1%   | 0.1%   | 0.3%    |
| Icing                | -      | 0.0%    | -      | -      | -      | 0.0%   | -      | -      | 0.0%   | -      | 0.0%    |
| E. Wind              |        |         |        |        |        |        |        |        |        |        |         |
| Forecasted WS (m/s)  | 8.4    | 8.7     | 8.1    | 7.8    | 7.9    | 8.1    | 8.9    | 9.6    | 9.4    | 9.6    | 8.6     |
| Measured WS (m/s)    | 8.3    | 7.7     | 8      | 7.3    | 6.8    | 8.3    | 8.5    | 7.7    | 7.6    | 7.3    | 7.8     |
| WindSpeed Deviation  | -1.6%  | -10.8%  | -0.7%  | -5.7%  | -14.1% | 2.0%   | -4.4%  | -20.3% | -19.3% | -24.0% | -9.8%   |


PLANT PRODUCTION

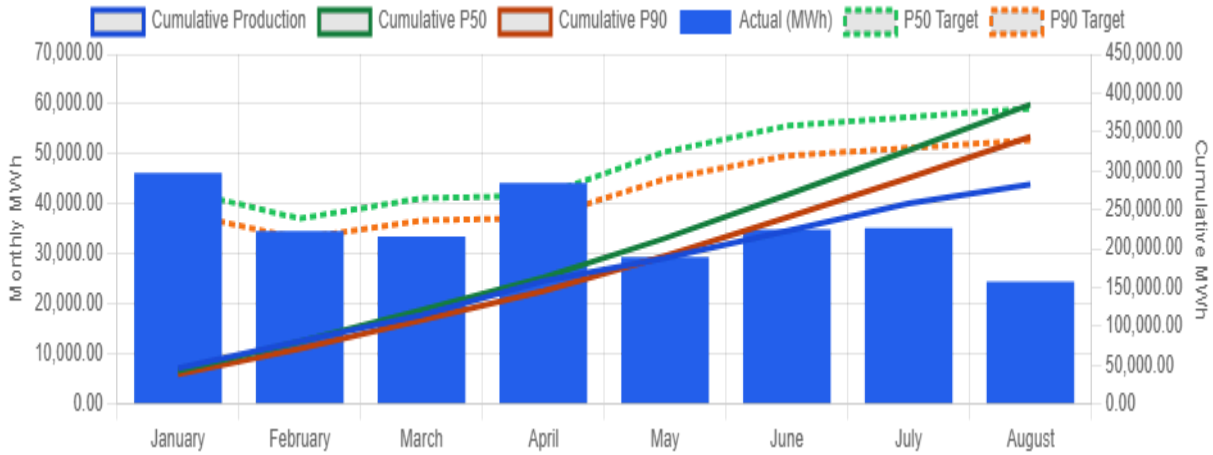


PLANT AVAILABILITY

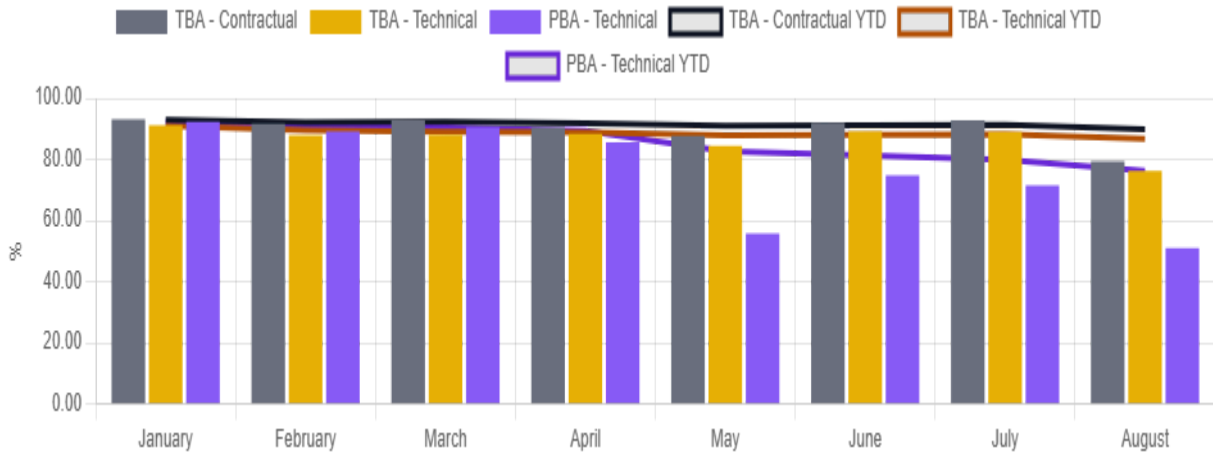

WIND SPEED

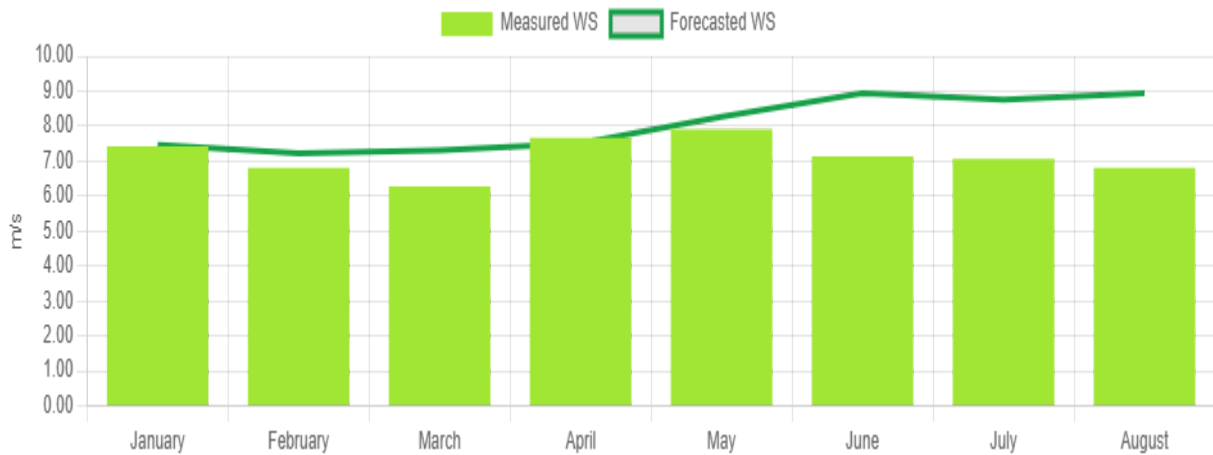

## ANNUAL PRODUCTION AND AVAILABILITY PER WT

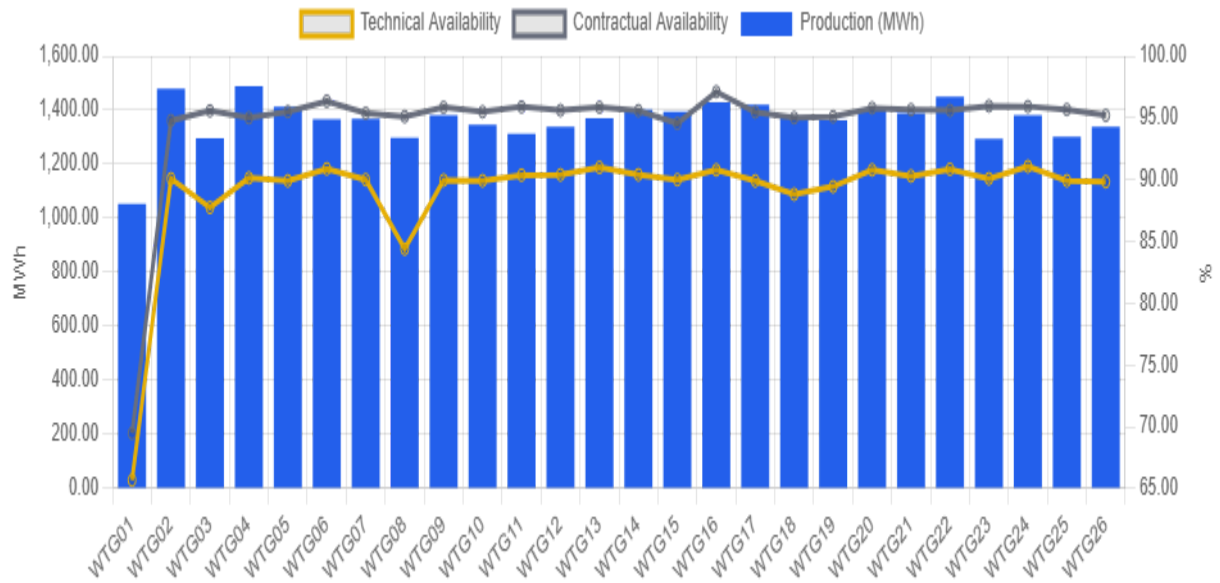

## LOSSES BREAKDOWN

