



FULL KPI MATRIX

CATEGORY	2025	2026	JAN	FEB	MAR	APR	MAY	JUN	TOTAL
A. Production									
Measured (MWh)	35,374	236,763	49,138	36,763	35,552	46,951	31,244	37,114	272,137
Deviation Historical	–	–	–	–	–	–	–	–	–
Deviation P50	4.6%	-17.2%	7.8%	-6.8%	-18.7%	5.9%	-41.7%	-37.2%	-14.9%
Deviation P90	17.2%	-7.2%	20.8%	4.5%	-8.9%	18.6%	-34.7%	-29.7%	-4.6%
Capacity Factor	33.1%	37.8%	45.9%	37.3%	33.3%	45.5%	29.0%	35.7%	37.1%
Electrical Losses	1.4%	0.8%	1.1%	-0.7%	1.5%	1.6%	0.7%	0.9%	0.9%
B. Consumption									
Measured (MWh)	0	162	28	26	34	16	16	42	162
Ratio to Production	0.0%	0.1%	0.1%	0.1%	0.1%	0.0%	0.1%	0.1%	0.1%
C. Availability									
Contractual - Time Based	99.0%	98.1%	99.8%	98.4%	99.6%	97.2%	94.6%	98.8%	98.2%
TBA - Time Based	92.8%	91.3%	96.3%	90.4%	89.7%	92.1%	88.5%	90.4%	91.5%
PBA - Energy Based	97.9%	96.7%	98.9%	96.8%	98.8%	96.1%	91.0%	98.3%	96.8%
D. OLF - Losses									
Manufacturer	1.5%	8.4%	1.1%	2.9%	1.4%	5.2%	31.3%	8.5%	7.4%
Owner	0.1%	0.6%	0.0%	0.1%	0.2%	0.2%	2.8%	0.2%	0.5%
Environmental	1.0%	1.2%	0.2%	1.1%	0.9%	0.6%	3.9%	0.5%	1.2%
Utility	0.3%	1.9%	0.0%	0.3%	0.4%	0.4%	0.2%	10.3%	1.7%
Bat Curtailment	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
E. Wind									
Forecasted WS (m/s)	8.4	8.4	8.1	7.8	7.9	8.1	8.9	9.6	8.4
Measured WS (m/s)	8.3	7.8	8	7.3	6.8	8.3	8.5	7.7	7.8
WindSpeed Deviation	-1.6%	-7.2%	-0.7%	-5.9%	-14.1%	2.0%	-4.4%	-20.3%	-6.4%


PLANT PRODUCTION

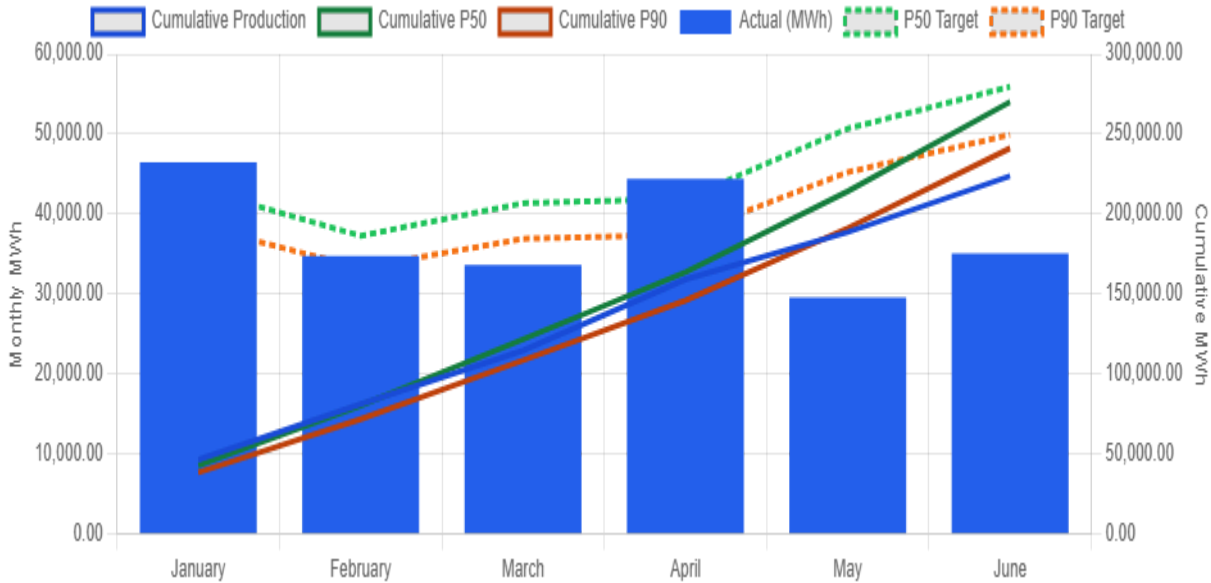


ANNUAL PRODUCTION AND AVAILABILITY PER WT

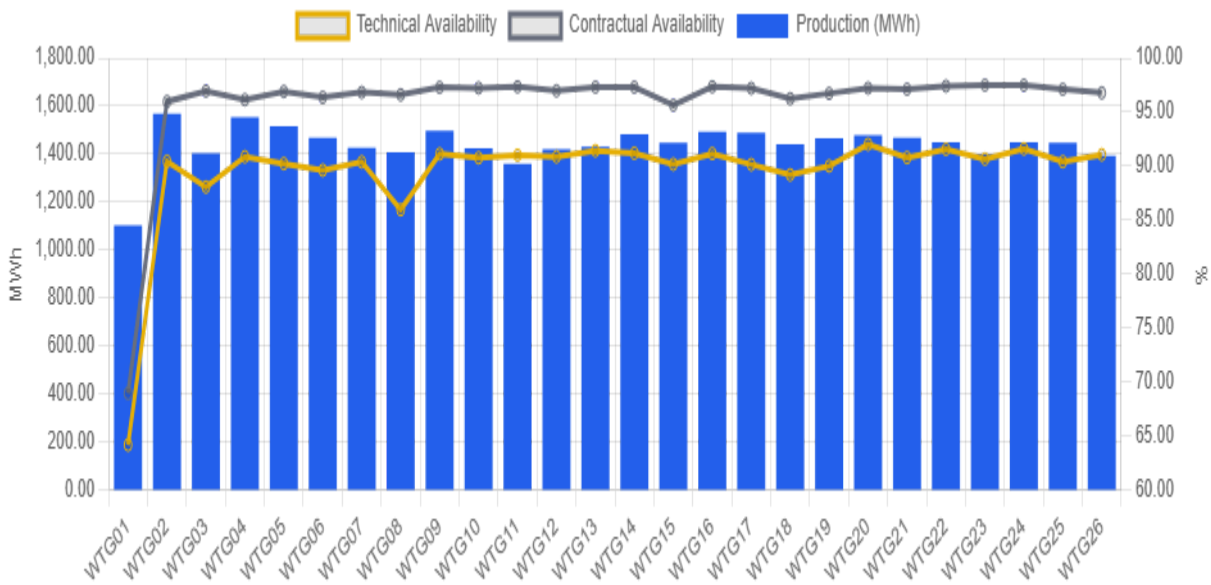

PLANT AVAILABILITY

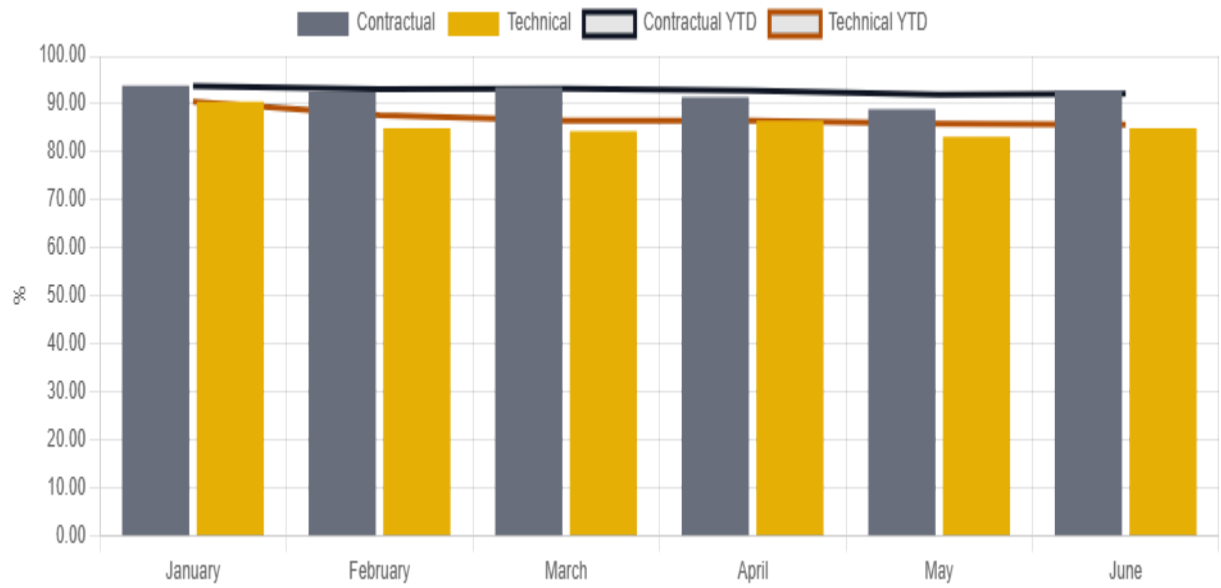

OPERATIONAL LOSS FACTORS

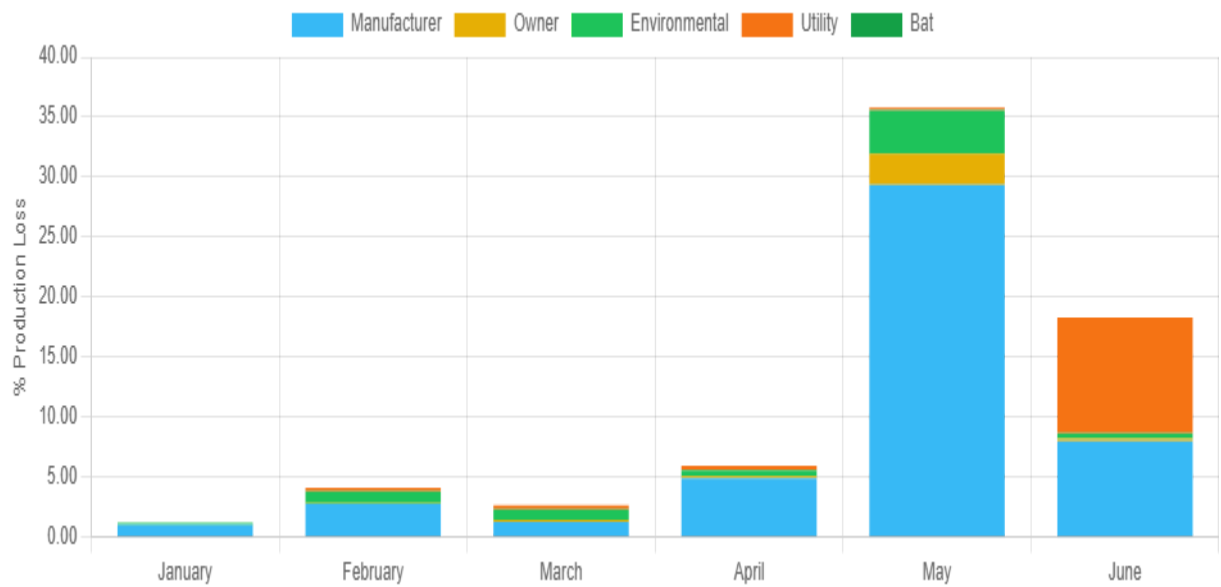

WIND SPEED

