
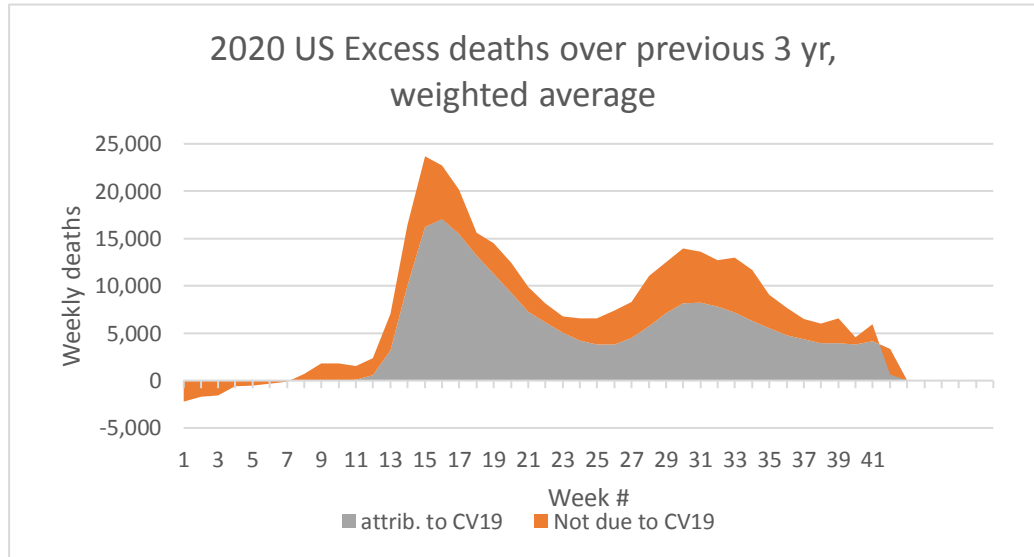
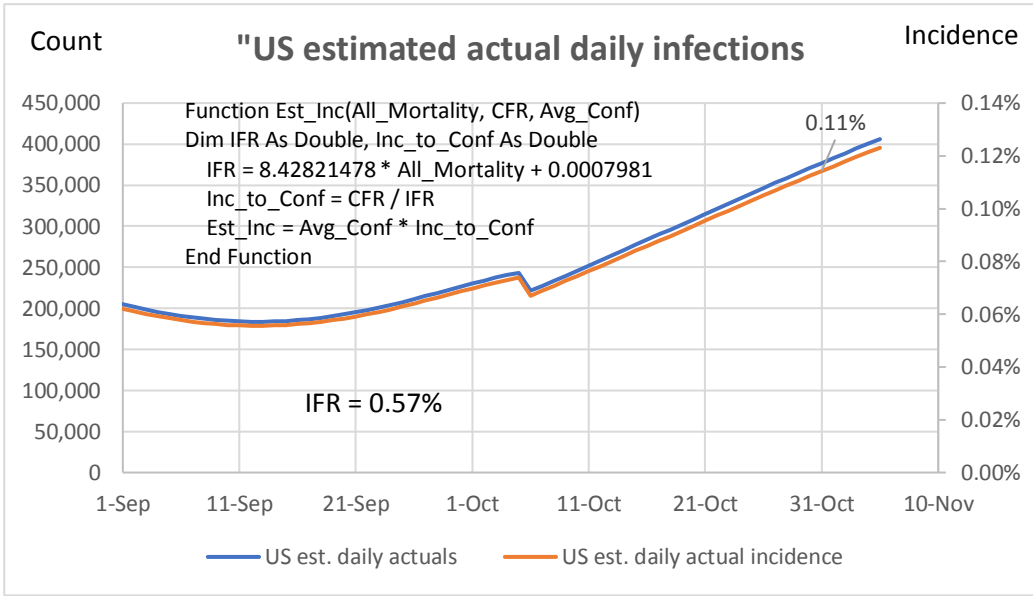
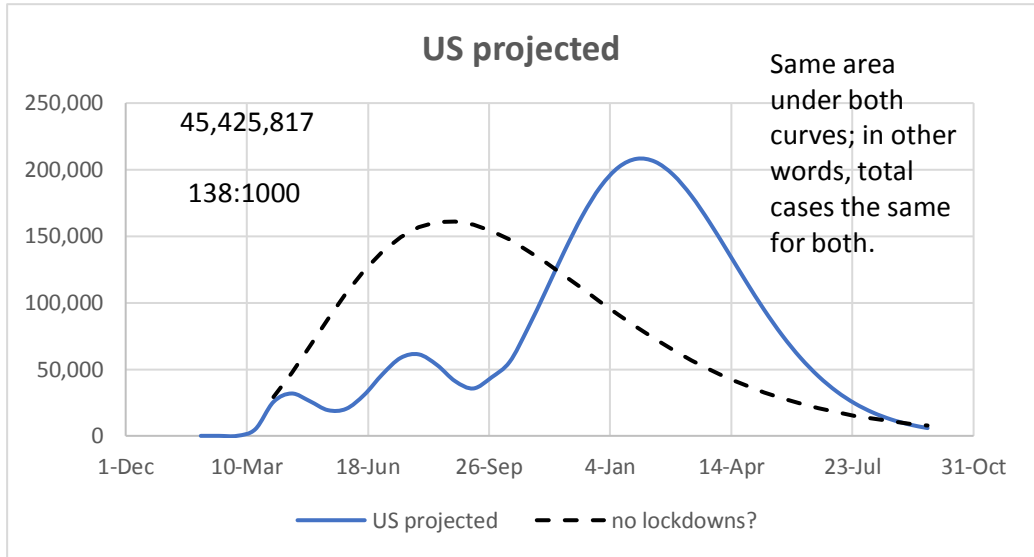
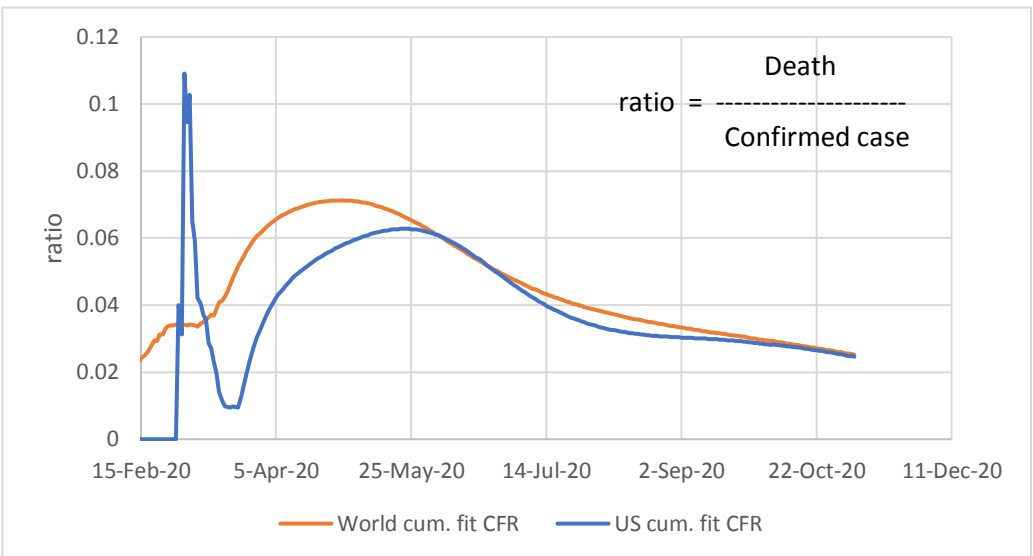
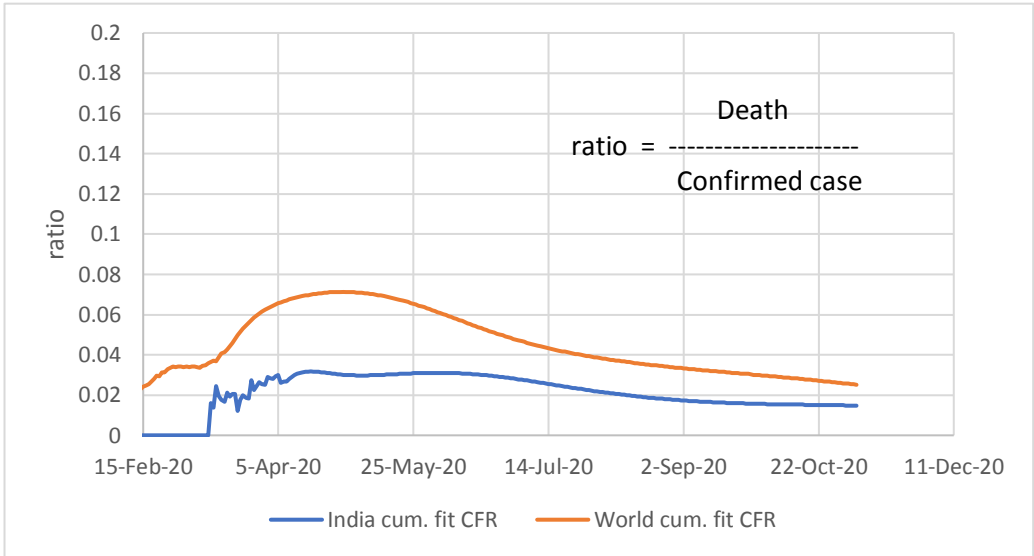
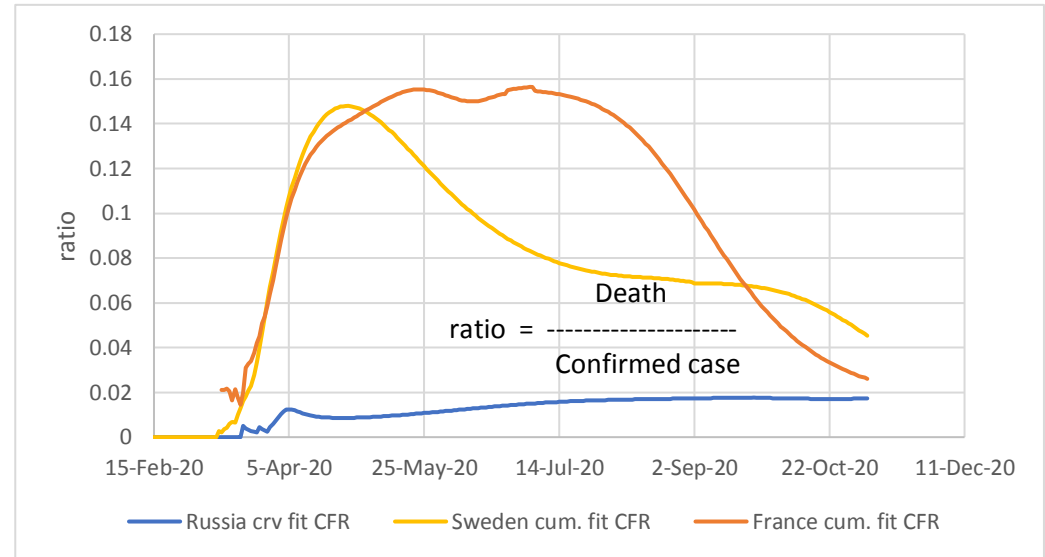
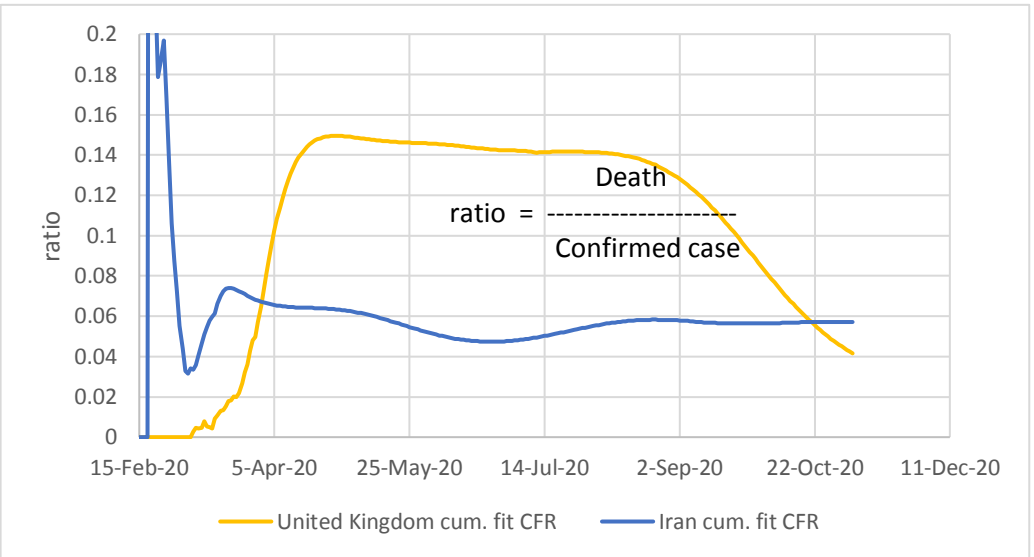
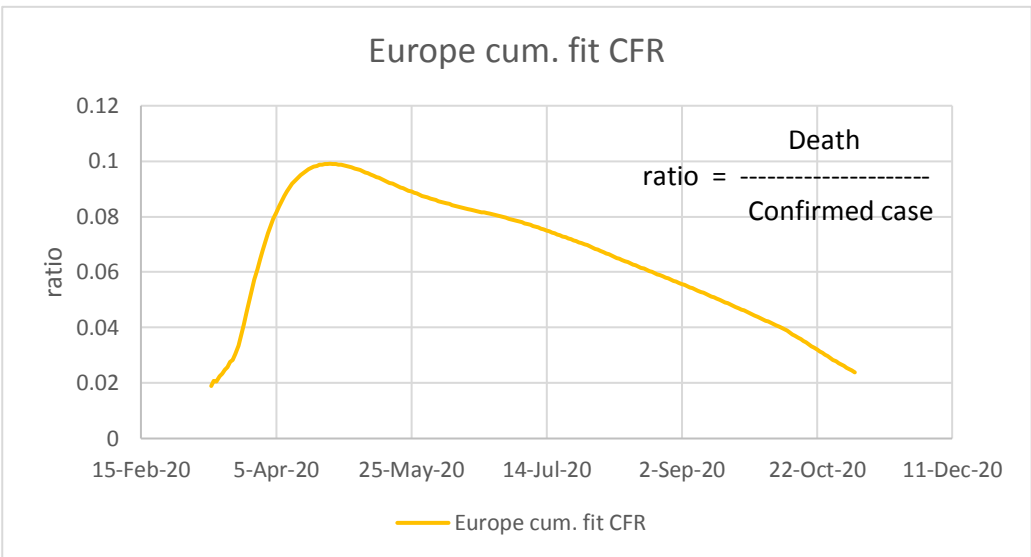


Experimental page : ratios of curve fit deaths to curve fit confirmed cases

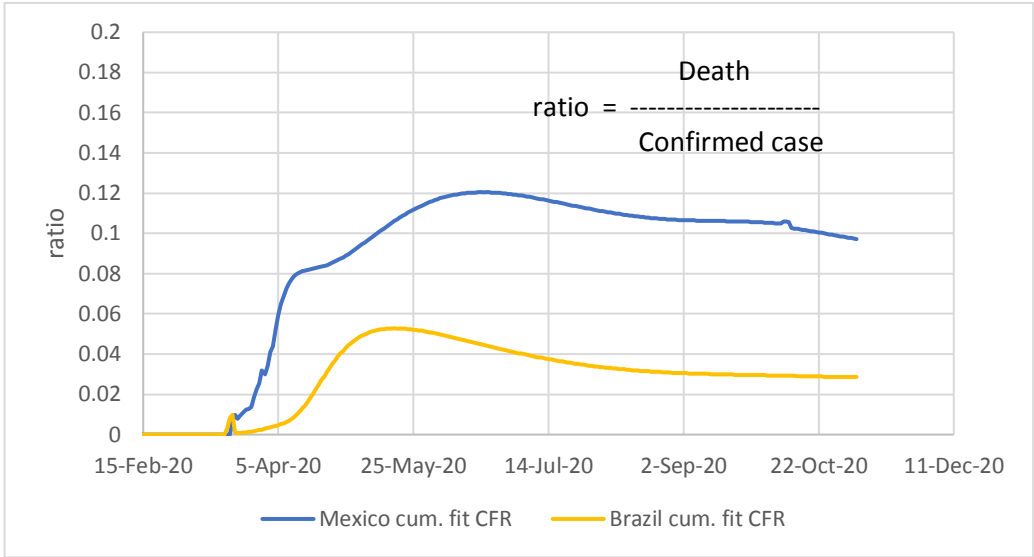

False Positives Demonstration

Use 0.10% from US est. incidence above as estimated daily incidence

Prevalence estimated as avg. inf period of 2 weeks X incidence

99% accuracy of test 0.11% X 14 = 1.540%

	Positive	Negative	
test pos	1.5246%	0.9846%	2.51%
test neg	0.0154%	97.4754%	97.49%
	1.5400%	98.4600%	100.00%

False pos. is 2/5ths of total positives!

TRUE	1.525%/2.51%	60.8%
FALSE	0.985%/2.51%	39.2%
Total	-----	100.00%

Counter-act this tendency by increasing test sensitivity. However this may increase false negatives, the recipients of which may be positive, think they're negative, and go spread it around some more.