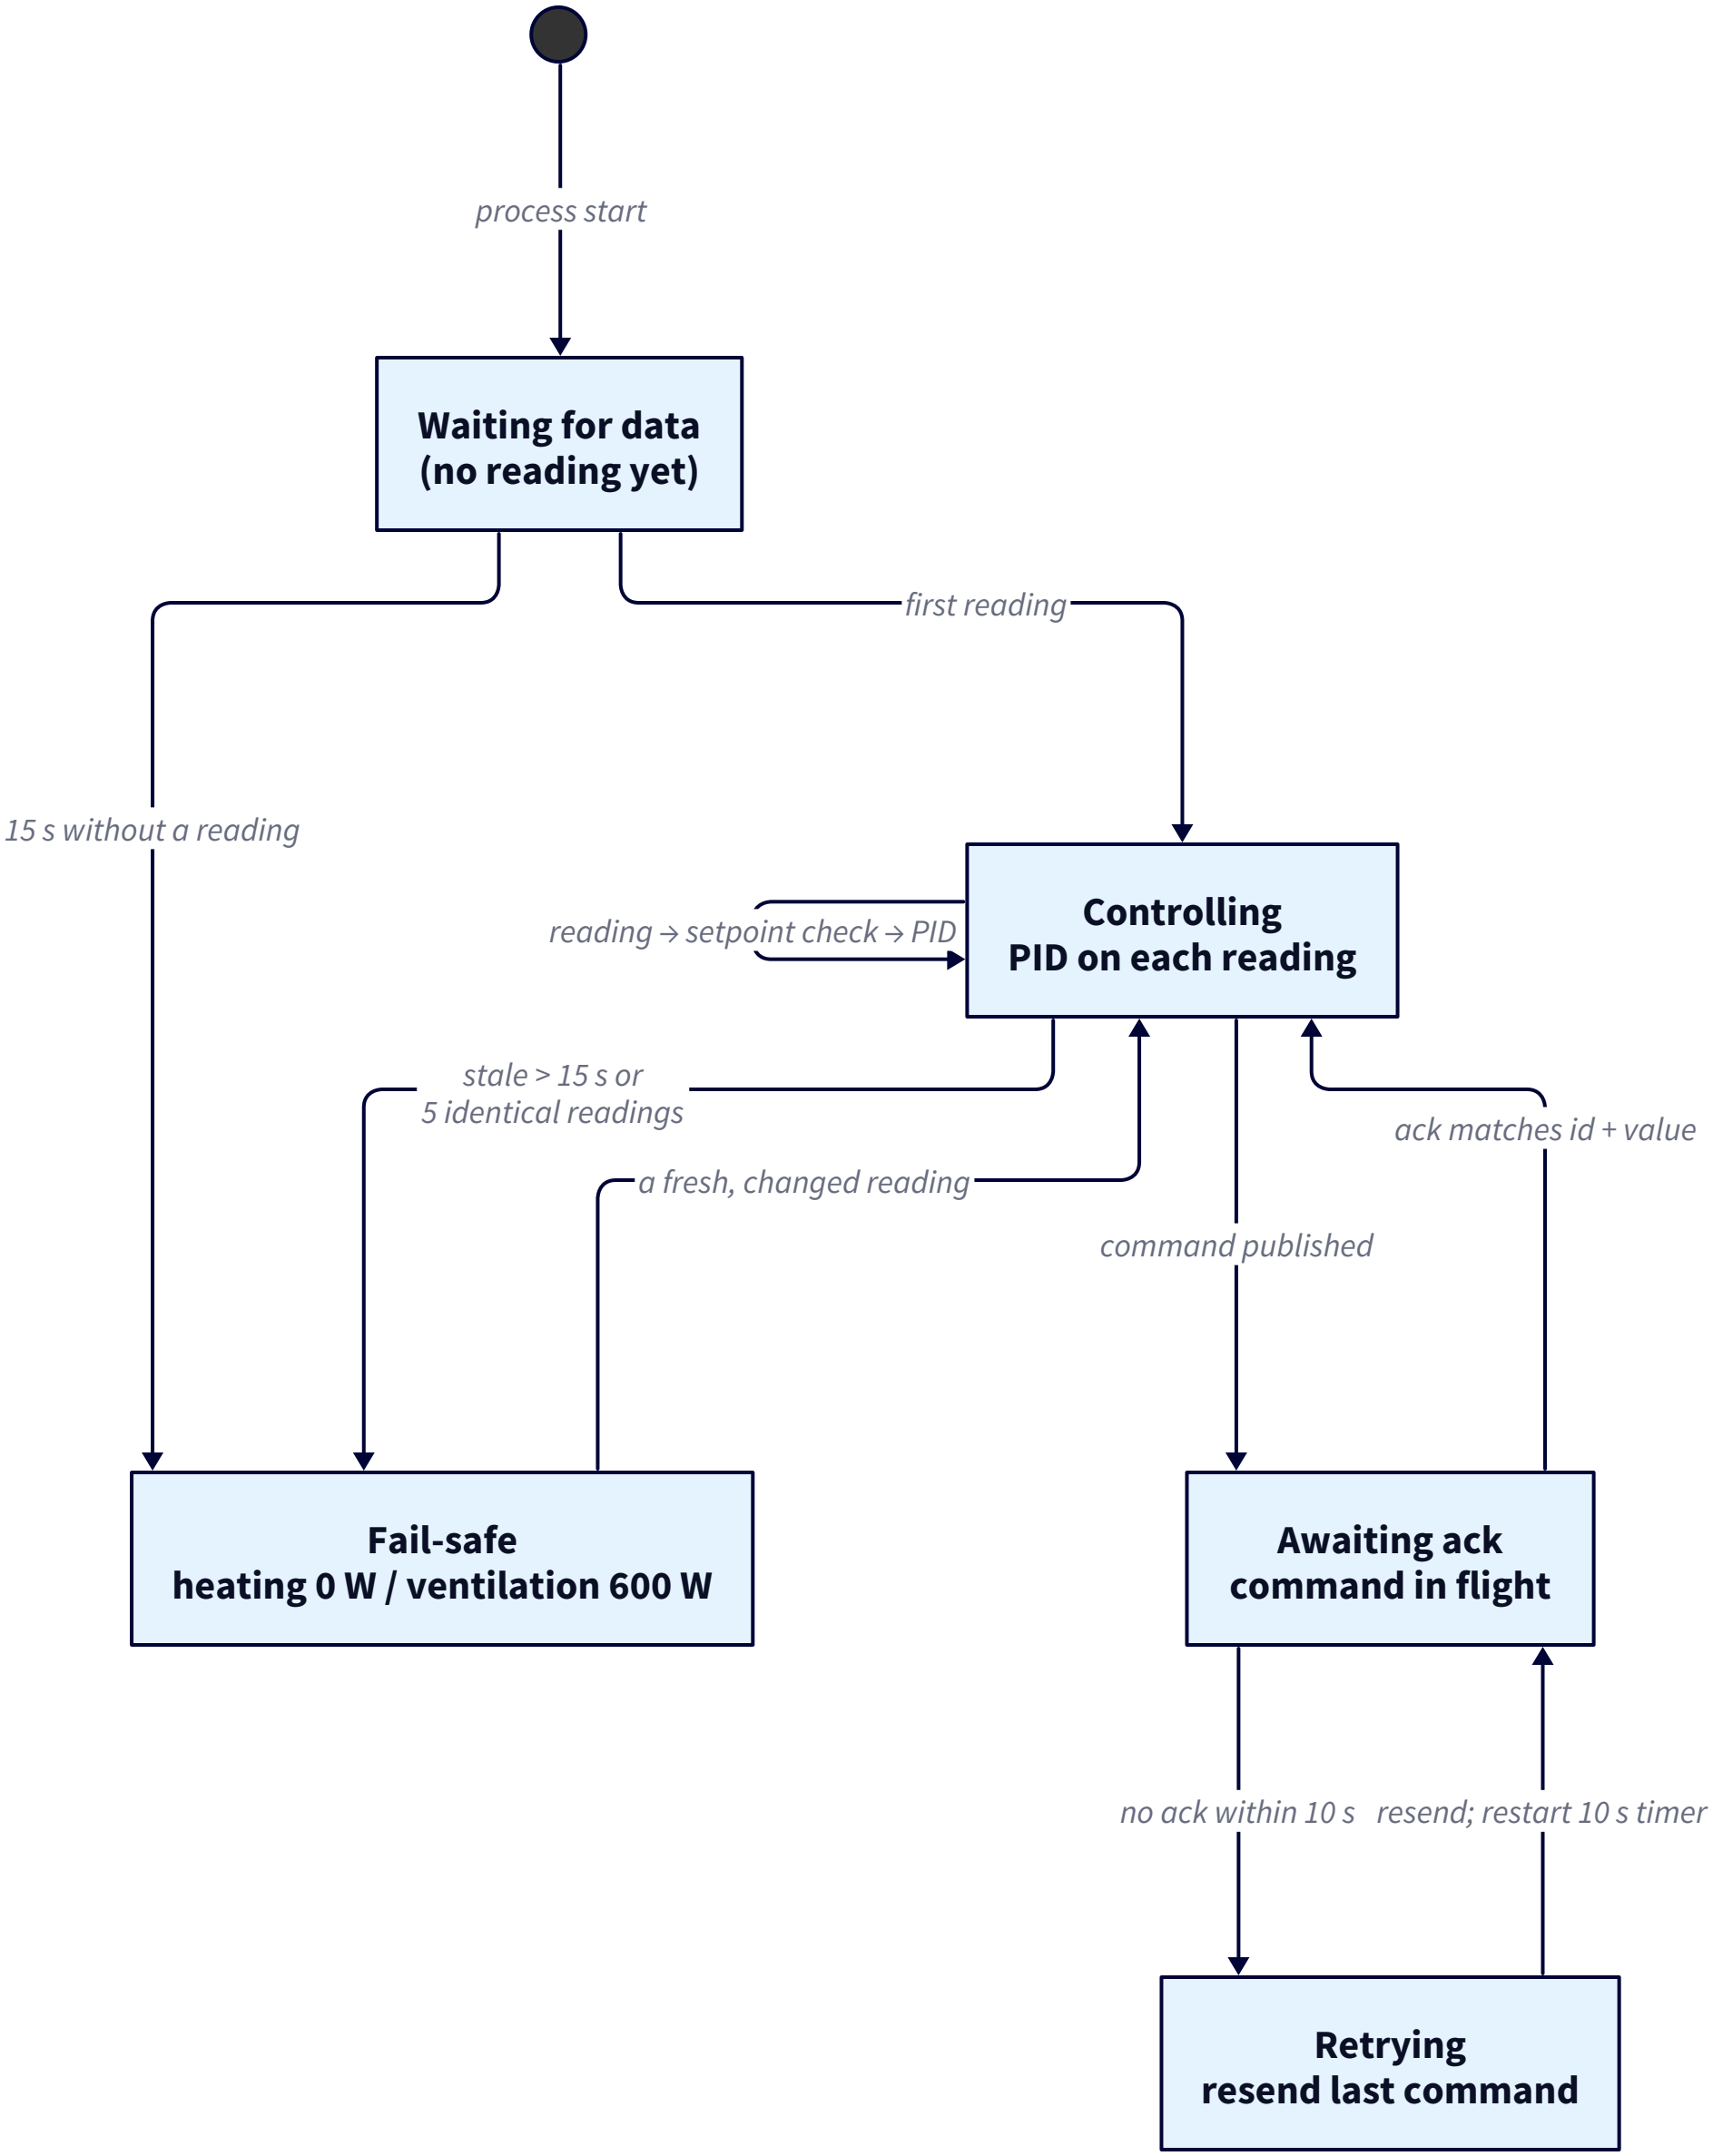

process start
Waiting for data
(no reading yet)
first reading
15 s without a reading
reading → setpoint check → PID
Controlling
PID on each reading
stale > 15 s or
5 identical readings
a fresh, changed reading
command published
ack matches id + value
Fail-safe
heating 0 W / ventilation 600 W
Awaiting ack
command in flight
no ack within 10 s
resend; restart 10 s timer
Retrying
resend last command