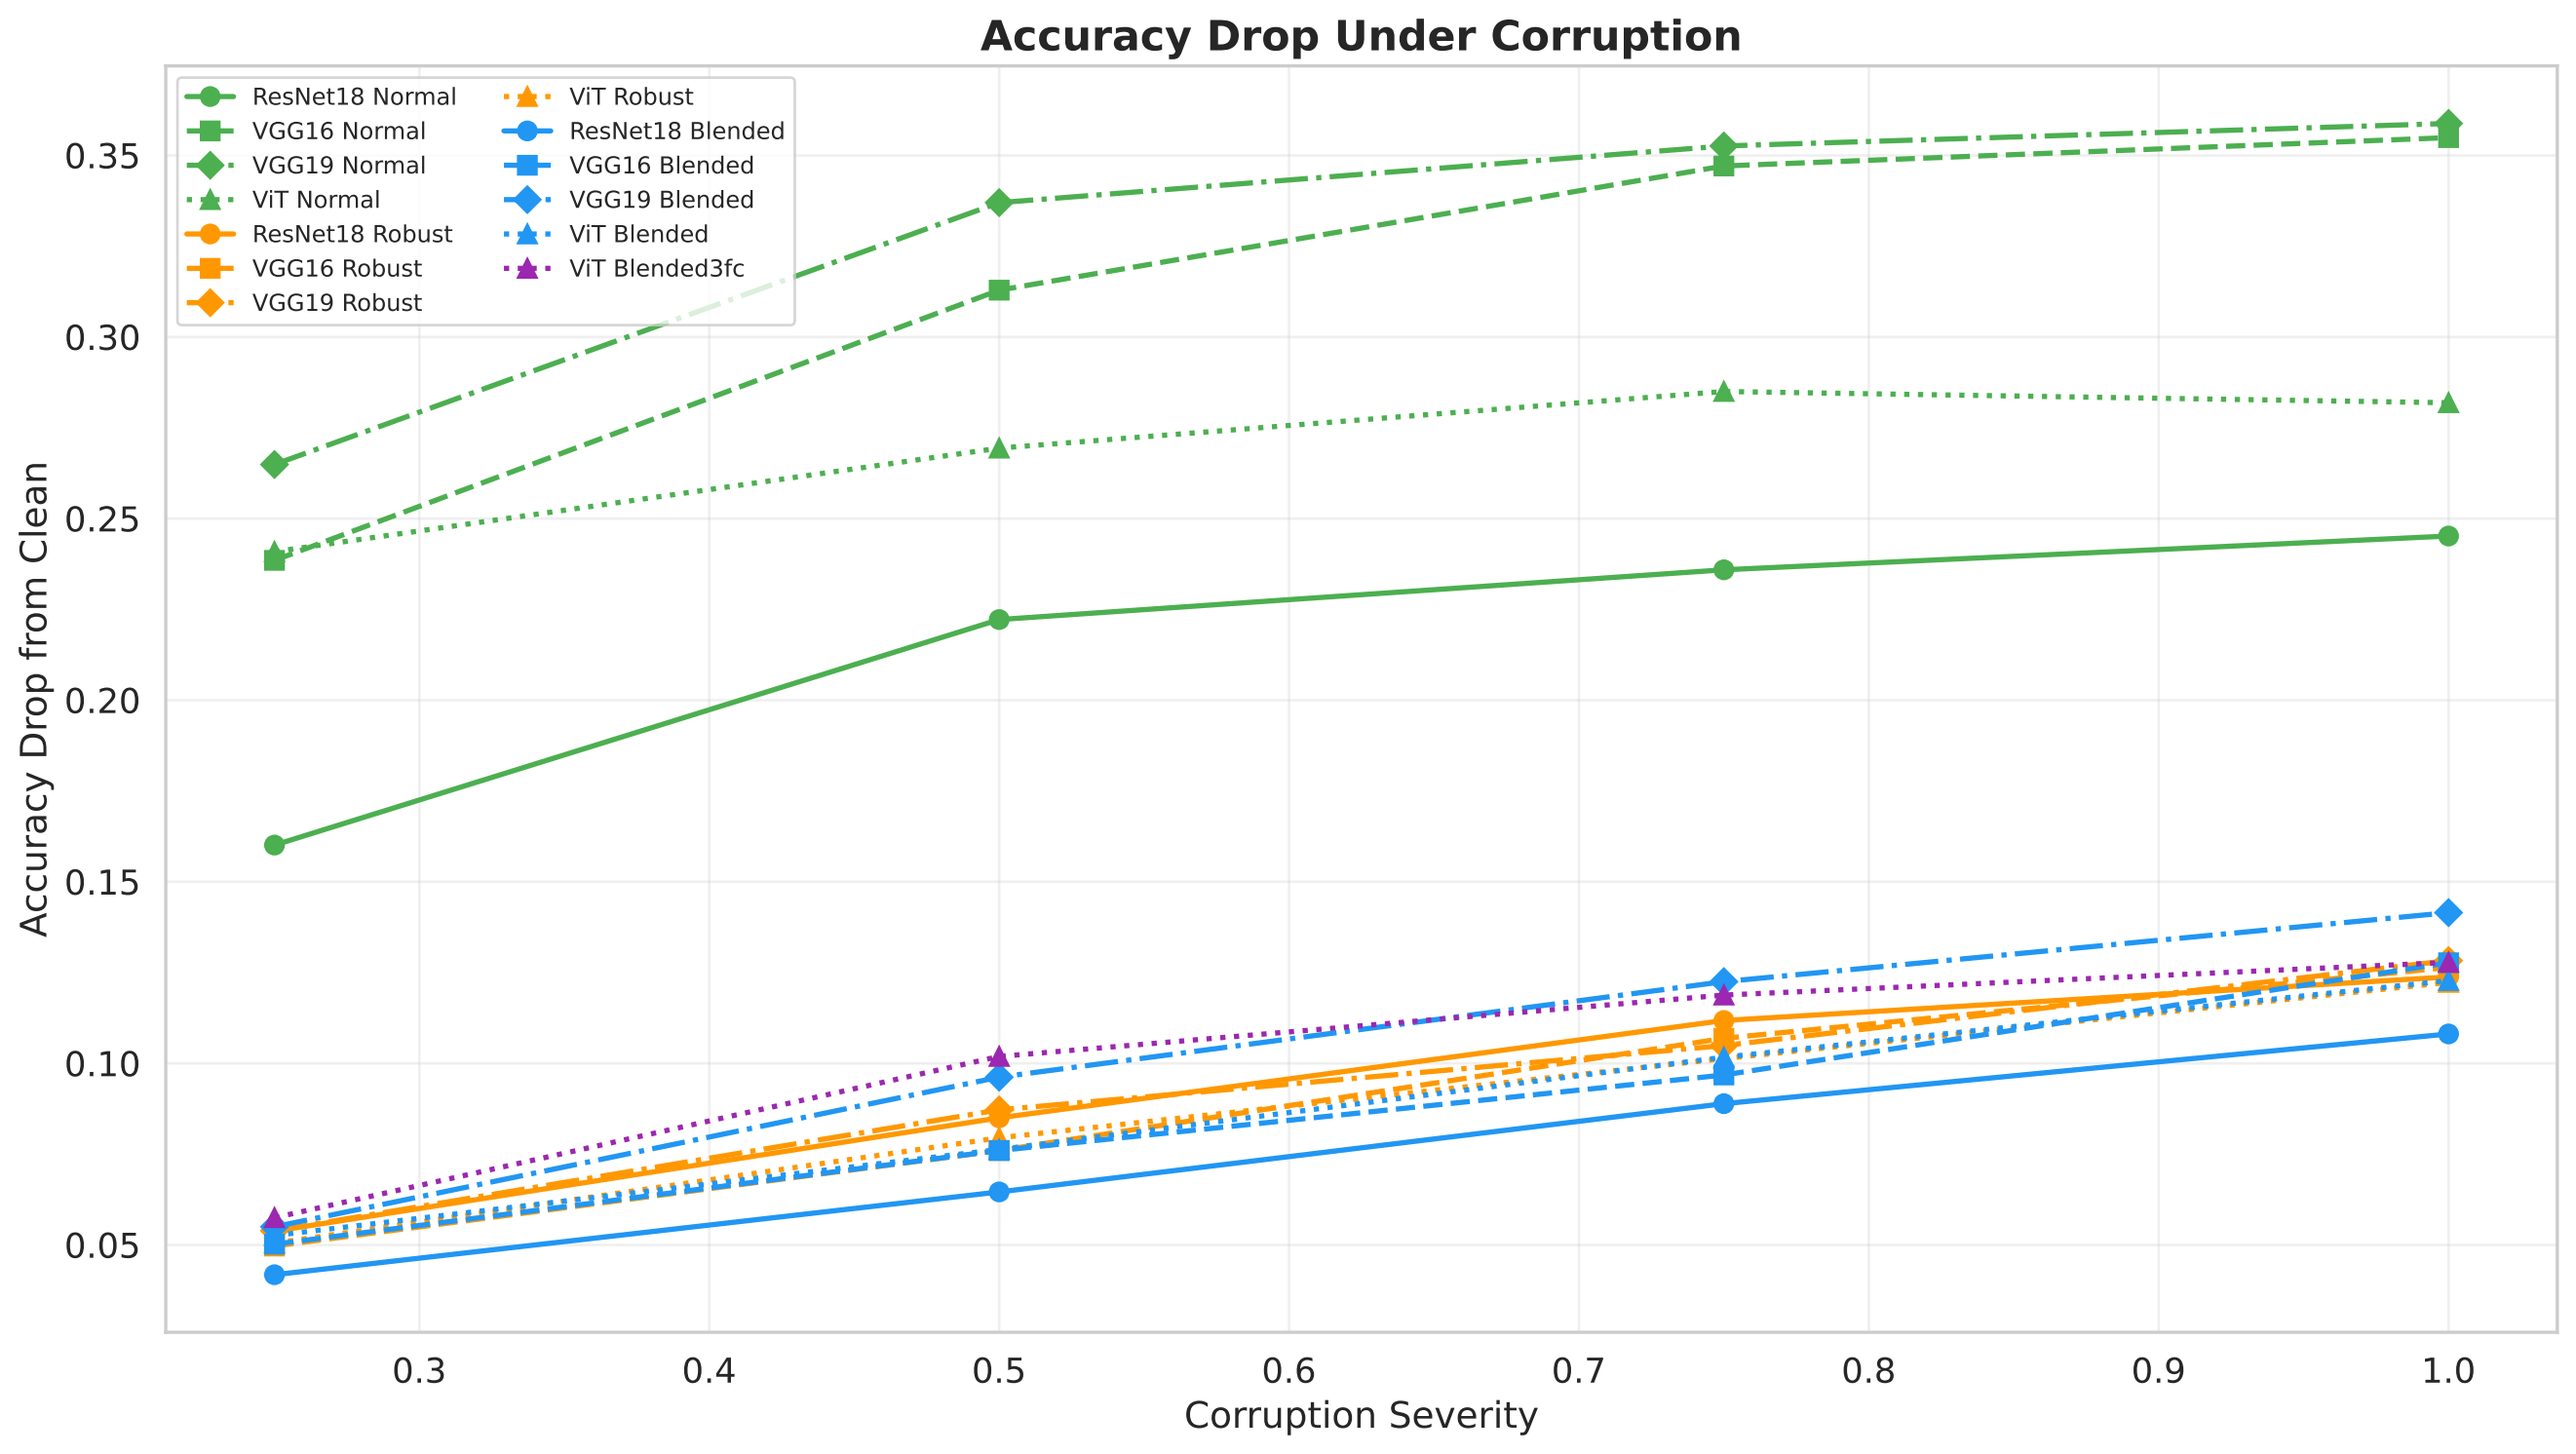
Accuracy Drop Under Corruption
ResNet18 Normal
VGG16 Normal
VGG19 Normal
ViT Normal
ResNet18 Robust
VGG16 Robust
VGG19 Robust
ViT Robust
ResNet18 Blended
VGG16 Blended
VGG19 Blended
ViT Blended
ViT Blended3fc
Accuracy Drop from Clean
0.05
0.10
0.15
0.20
0.25
0.30
0.35
0.3
0.4
0.5
0.6
0.7
0.8
0.9
1.0
Corruption Severity