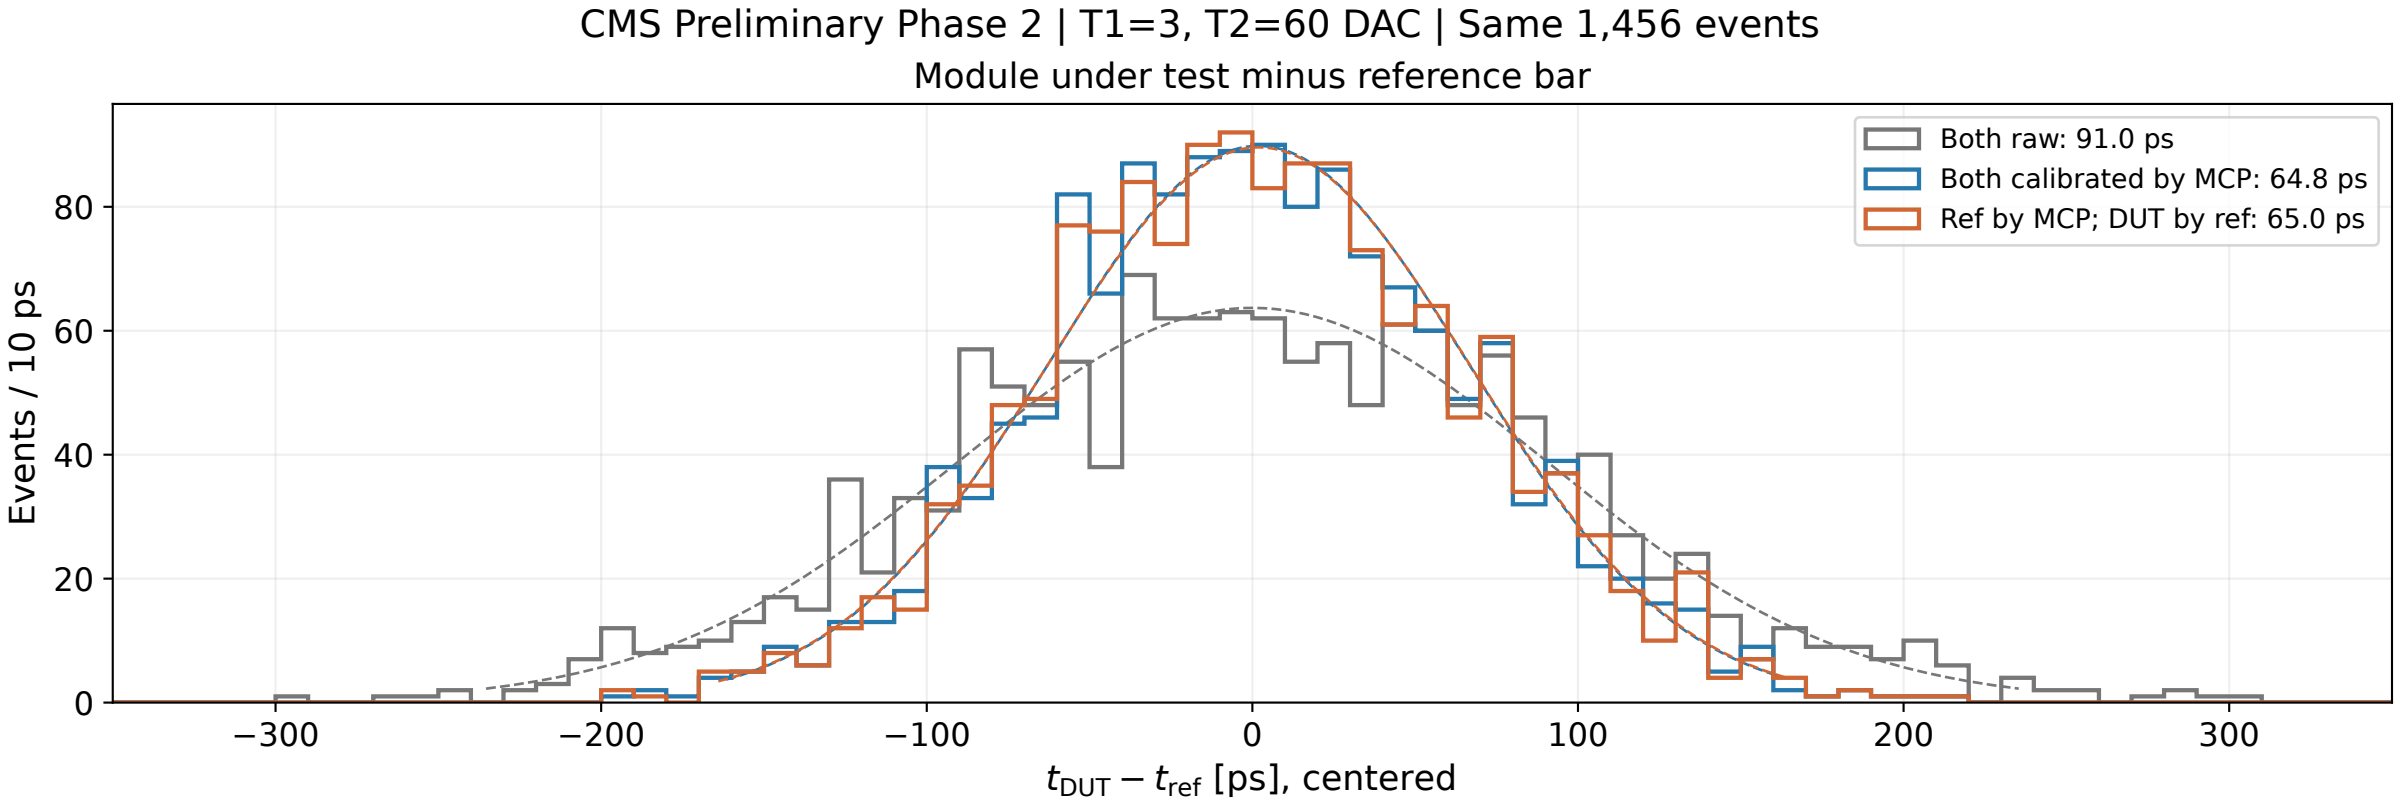
CMS Preliminary Phase 2 | T1=3, T2=60 DAC | Same 1,456 events
Module under test minus reference bar
Both raw: 91.0 ps
Both calibrated by MCP: 64.8 ps
Ref by MCP; DUT by ref: 65.0 ps
Events / 10 ps
0
20
40
60
80
−300
−200
−100
0
100
200
300
$t_{DUT} - t_{ref}$ [ps], centered