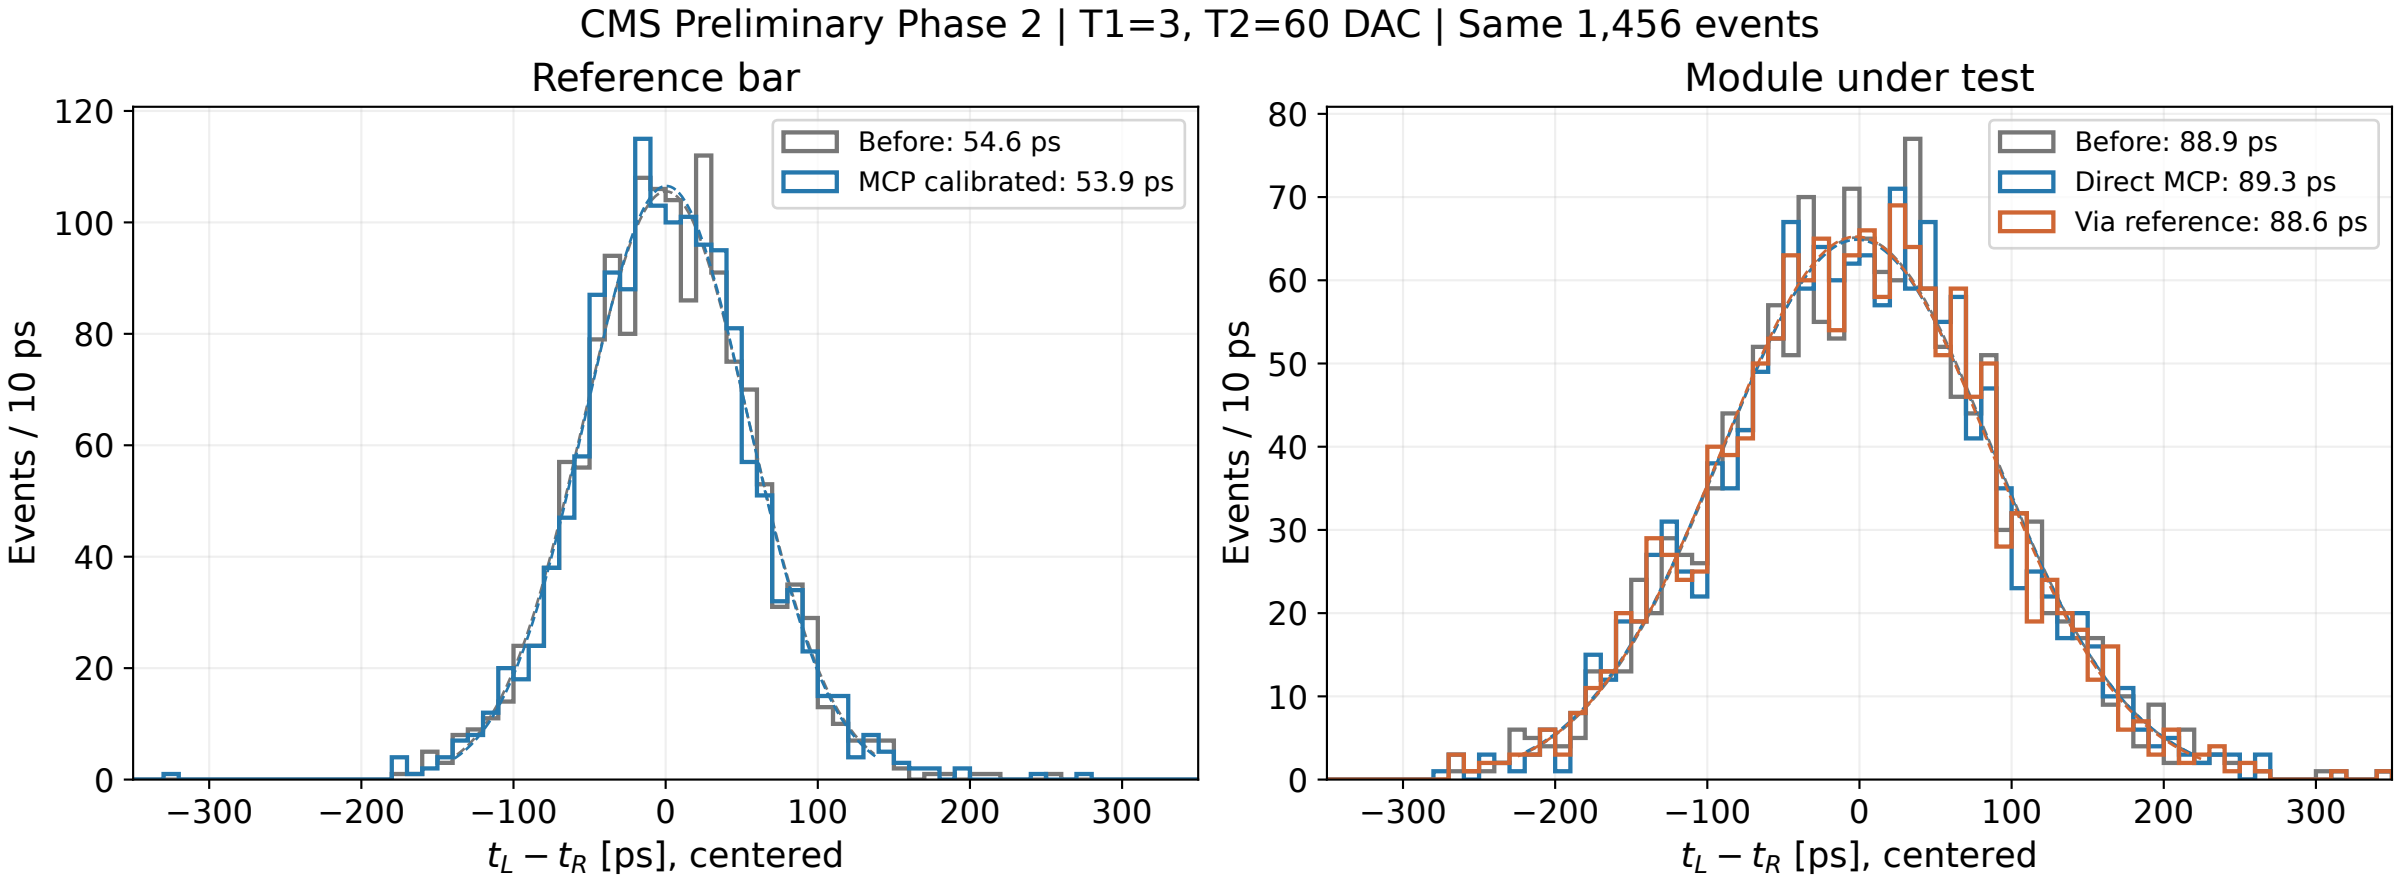
CMS Preliminary Phase 2 | T1=3, T2=60 DAC | Same 1,456 events
Reference bar
Module under test
Before: 54.6 ps
MCP calibrated: 53.9 ps
Before: 88.9 ps
Direct MCP: 89.3 ps
Via reference: 88.6 ps
Events / 10 ps
$t_L - t_R$ [ps], centered