

BASELINE 22 ISOLATED SINKING DIGITAL INPUTS — 6 HOME + 16 AUXILIARY — REVIEW r0.1

0–30V input study: low<=5V / high>=15V targets. PNP source or dry contact to field positive. Common FIELD_GND: no per-channel isolation.
11 ISO1212 devices require IO_3V3 only. Do not join FIELD_GND to LOGIC_GND. SUB pins get separate floating copper islands; never ground or join them.


DI0: DI00 / DI01 — FIELD inputs -> LOGIC

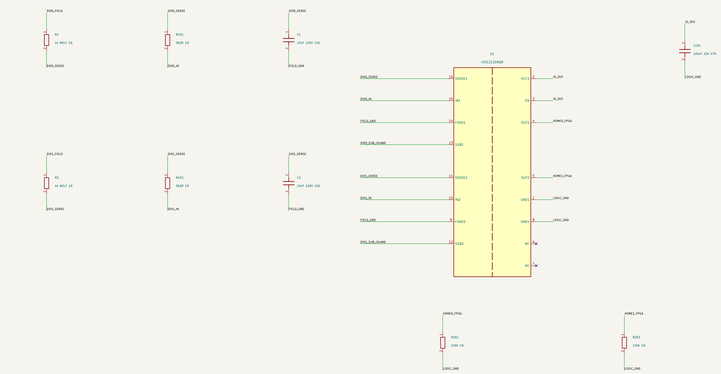


DI1: DI02 / DI03 — FIELD inputs -> LOGIC

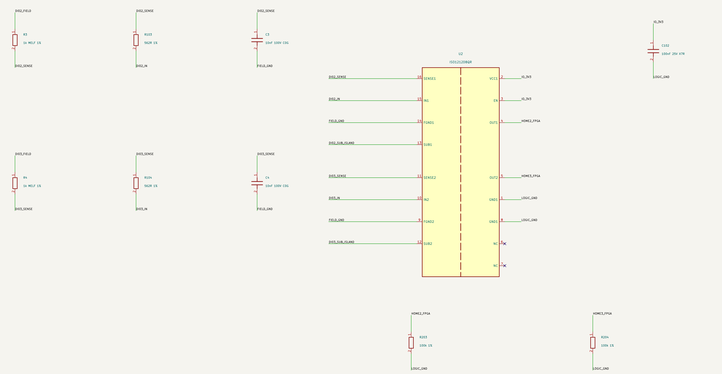


DI2: DI04 / DI05 — FIELD inputs -> LOGIC

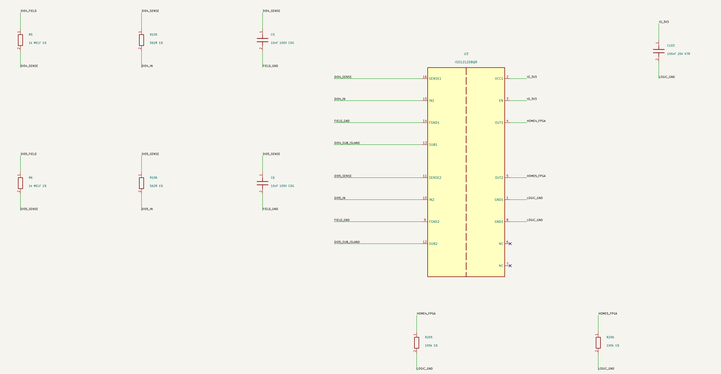


DI3: DI06 / DI07 — FIELD inputs -> LOGIC

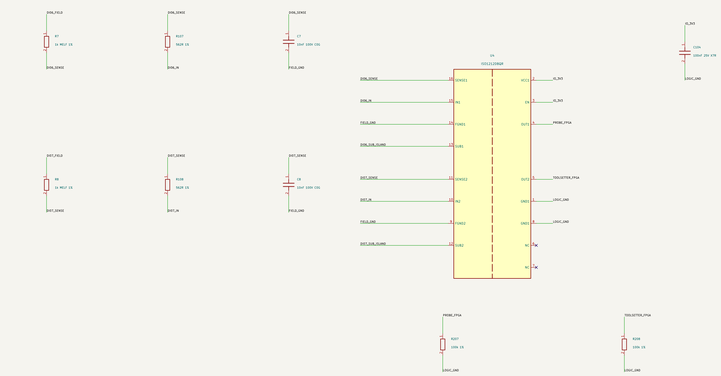


DI4: DI08 / DI09 — FIELD inputs -> LOGIC

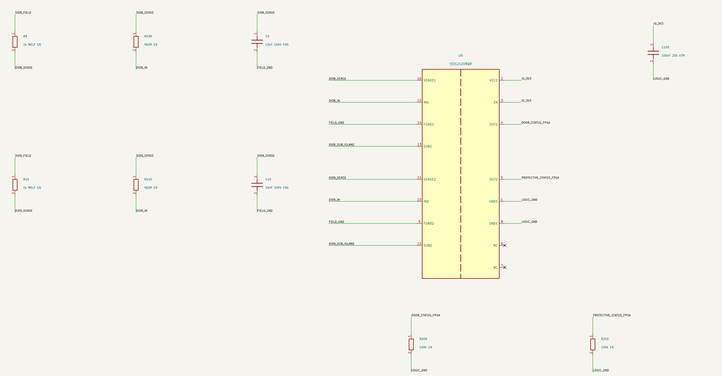


DI5: DI10 / DI11 — FIELD inputs -> LOGIC

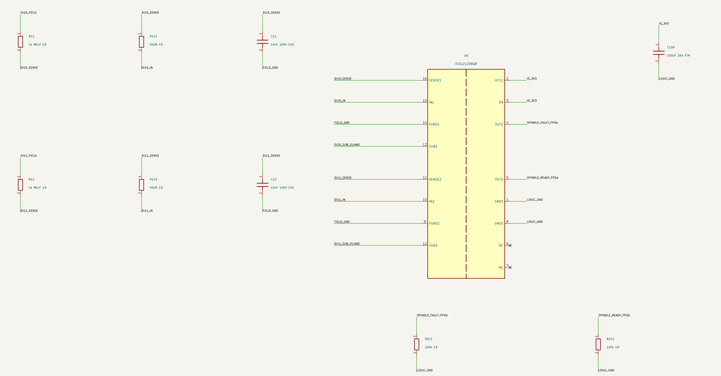


DI6: DI12 / DI13 — FIELD inputs -> LOGIC

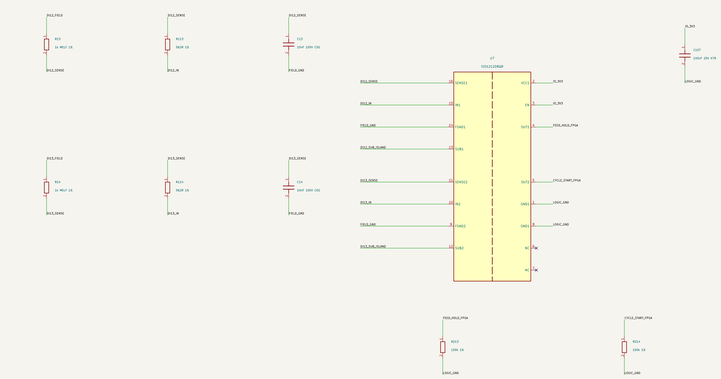

DI7: DI14 / DI15 — FIELD inputs -> LOGIC

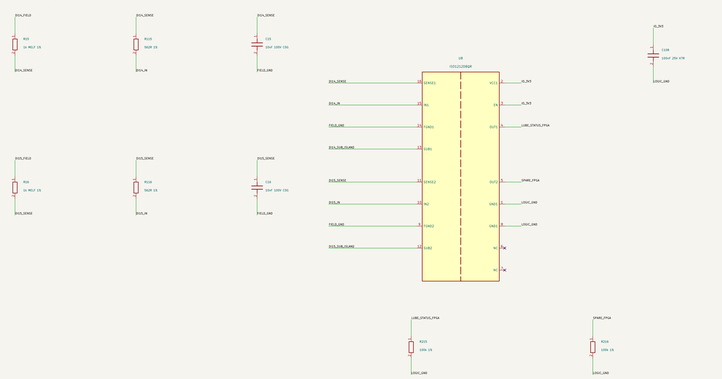


DI8: DI16 / DI17 — FIELD inputs -> LOGIC

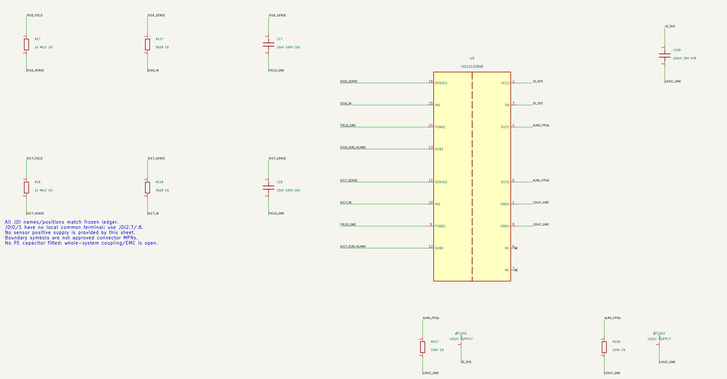



All JD names/positions match frozen ledger.
J00/1 have no local common terminal; use J02-7/8.
No sensor positive supply is provided by this module.
Boundary symbols are not approved connection points.
No Y1 capacitor fitted; whole-system coupling/EMC is open.

DI9: DI18 / DI19 — FIELD inputs -> LOGIC

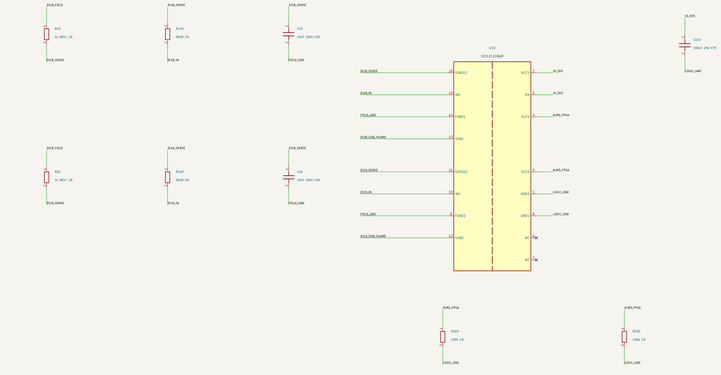

DI10: DI20 / DI21 — FIELD inputs -> LOGIC

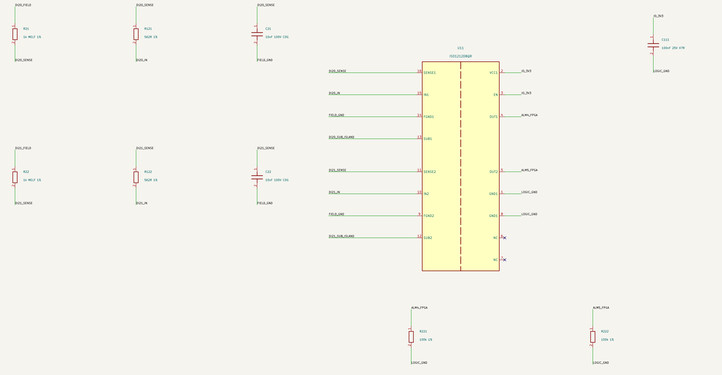

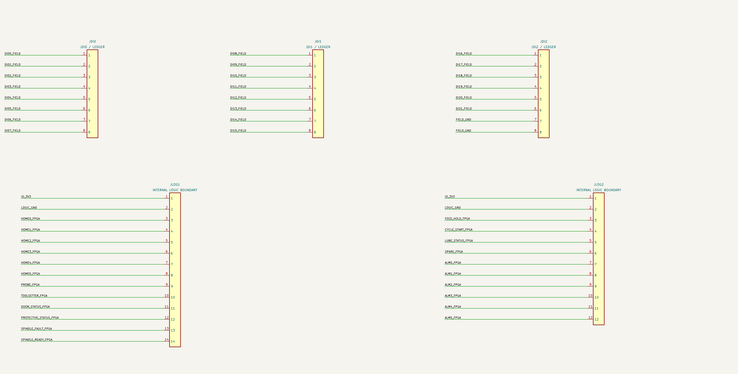

EN is tied to IO_3V3. Powered open input reads LOW. Unpowered/brownout output is UNDETERMINED: pull-down is bias, not a fail-safe guarantee.
Mask all inputs until qualified rail/FPGA readiness. PROBE/TOOLSETTER filters need latency qualification. No safety input certification, physical EMC result or PCB release.

Sheet: /	
File: digital_inputs.kicad_sch	
Title:	
Size: A0	Date:
KiCad E.D.A. 10.0.4	Rev:
	Id: 1/1