MOTHERBOARD: 24 GENERAL DI – 12 ISO1212 – NEW SOURCE r0.1 / NOT A PCB RELEASE

Fixed sinking inputs: PNP or contact to qualified sensor positive. 0–30V, LOW<=5V / HIGH>=15V targets. NPN/12V/AUTO mode not implemented.
FIELD_B_0V never joins LOGIC_GND here. Each SUB pin needs a separate floating 2x2mm copper island; no ground or inter–island connection.

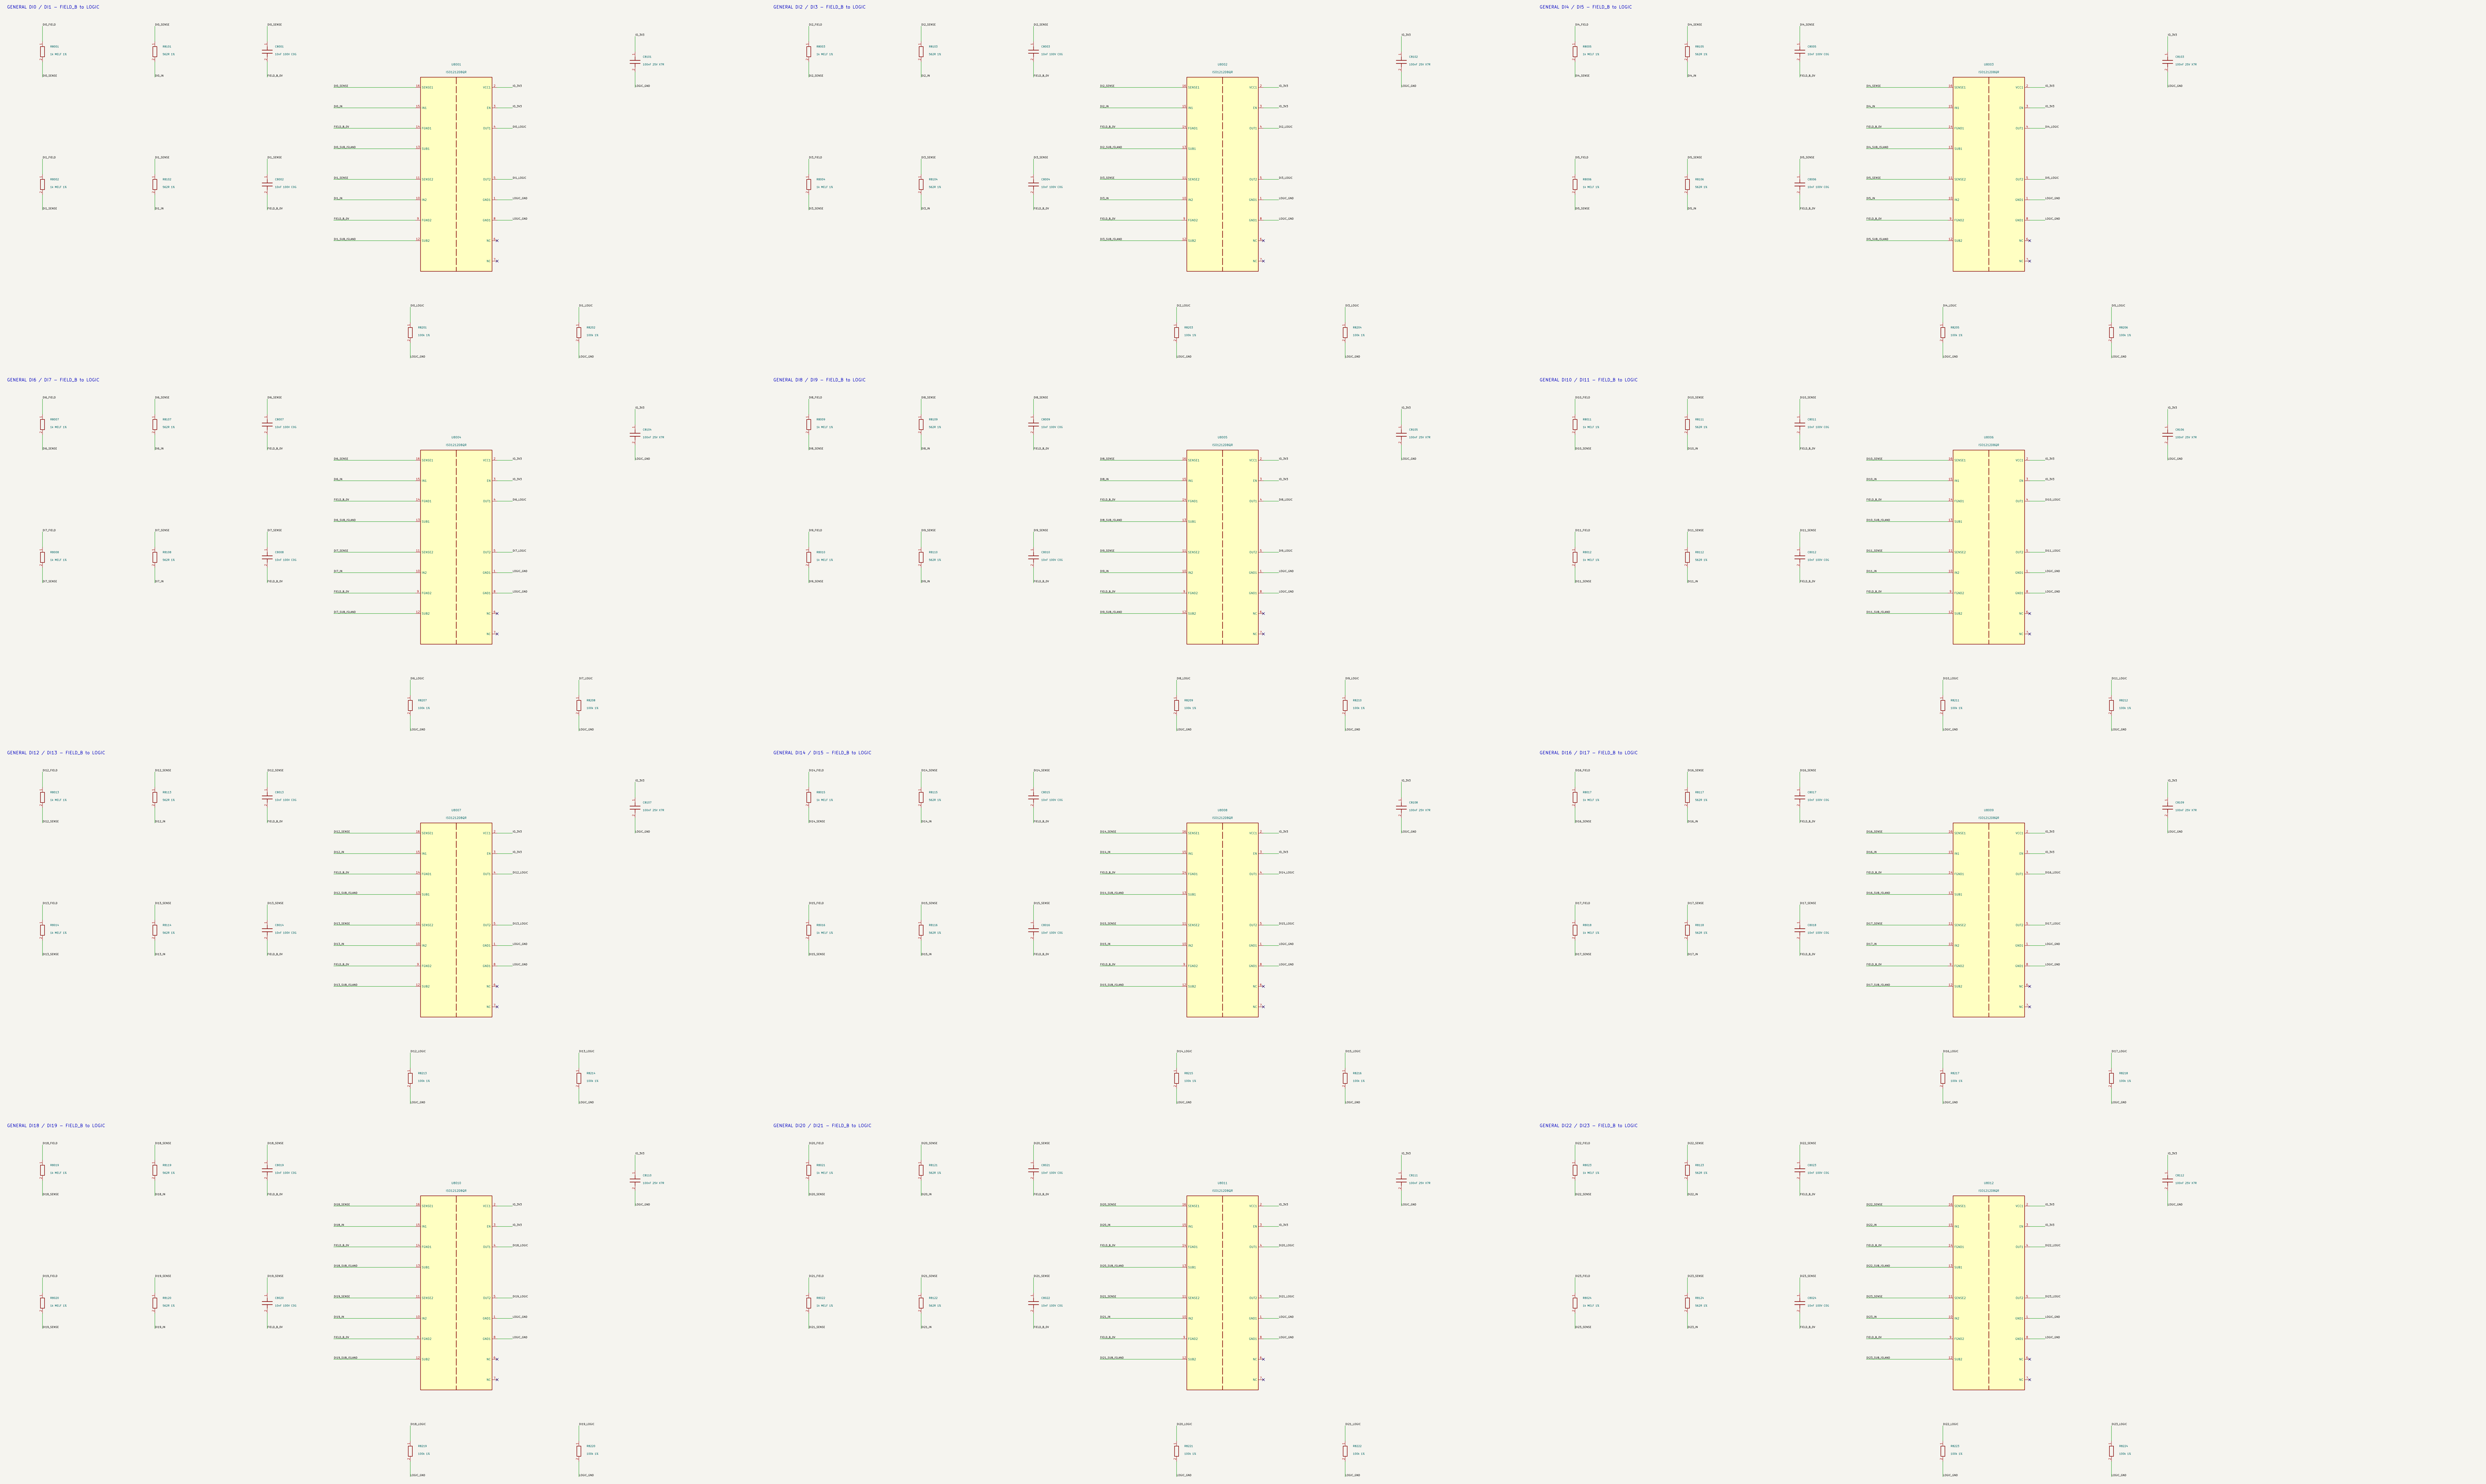
GENERAL DI0 / DI1 – FIELD_B to LOGIC
GENERAL DI2 / DI3 – FIELD_B to LOGIC
GENERAL DI4 / DI5 – FIELD_B to LOGIC
GENERAL DI6 / DI7 – FIELD_B to LOGIC
GENERAL DI8 / DI9 – FIELD_B to LOGIC
GENERAL DI10 / DI11 – FIELD_B to LOGIC
GENERAL DI12 / DI13 – FIELD_B to LOGIC
GENERAL DI14 / DI15 – FIELD_B to LOGIC
GENERAL DI16 / DI17 – FIELD_B to LOGIC
GENERAL DI18 / DI19 – FIELD_B to LOGIC
GENERAL DI20 / DI21 – FIELD_B to LOGIC
GENERAL DI22 / DI23 – FIELD_B to LOGIC
DI0_FIELD
DI0_SENSE
DI0_IN
FIELD_B_0V
R8001
1k MELF 1%
R8101
562R 1%
C8001
10nF 100V C0G
C8101
100nF 25V X7R
U8001
ISO1212DBQR
SENSE1
IN1
VCC1
EN
IO_3V3
LOGIC_GND
DI0_LOGIC
R8219
R8220
100k 1%
DI18_LOGIC
DI19_LOGIC

All 24 DI are general channels, independent of 12 motor alarms and 2 fast probes. No PROBE/HOME/ALM assignment is consumed here.
EN tied to IO_3V3. Powered open reads LOW. Unpowered/brownout is UNDETERMINED; bias is not guaranteed fail–safe.
Acquisition, rail/freshness/CRC validity, sensor–power limiters/measurement, TVS/cable qualification and connectors are unfinished parent circuits.

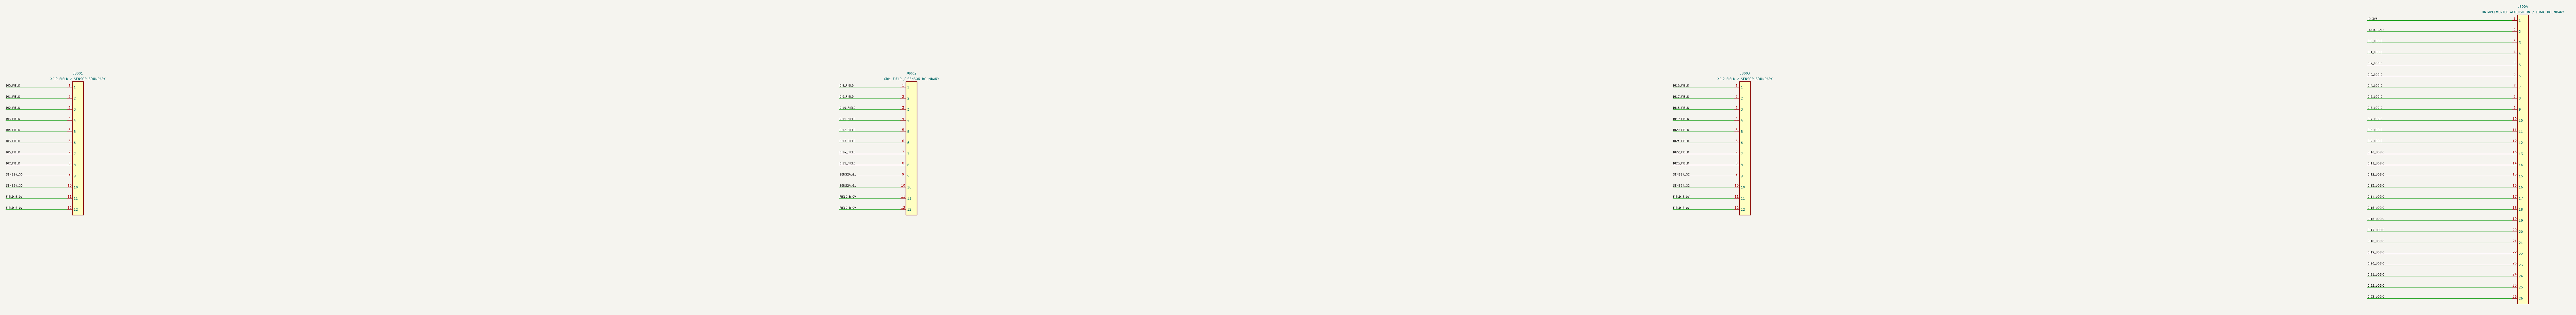

XDI9/10 supply contacts are one shared 0.20A group, not 0.20A each. Three groups reserve 0.60A total under frozen IS–1.
Sensor supply is an UNIMPLEMENTED boundary: no source/current limiter/telemetry is fitted by this sheet. All boundary symbols excluded from PCB/BOM.
RTHR*C is a screen, not complete input propagation delay. No board isolation/EMC/temperature or safety certification is established.

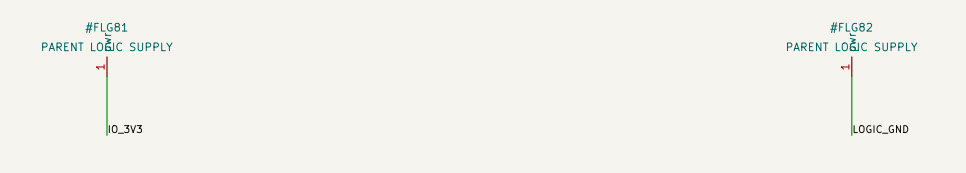

Sheet: /
File: motherboard_di.kicad_sch

Title:

Size: User | Date: | **Rev:**
KiCad E.D.A. 10.0.4 | Id: 1/1