

No work is to be done before this matter is finalized and a "Change Order" is issued. This copy to remain with your office. Do not return. Contractor to submit signed letter with price including cost breakdown and change (if any) to construction schedule. Authority having Jurisdiction shall advise of any objections.

TO: QUOREX CONSTRUCTION SERVICES LTD.
1630A 8th Avenue,
Regina, SK S4R 1E5

RE: AURORA FOOD STORE
2000 ANAQUOD ROAD
REGINA, SK
Commission No. 2445

DATE: December 23, 2025

PAGES: 8 (including cover)

RE: Snack Bar Cooler (Propane)

1.0 ELECTRICAL

- .1 Refer to attached Electrical PCN #30, dated December 19, 2025.
(1 page text, 2 full size drawings E0.2, E2.4)
- .2 GENIUS 2 H145 UI/SC (PROPANE) cut sheet attached (4 pages).

Distribution:

Sobeys Inc. – Jeff Craig
Sobeys Inc. – Shanwen Hsu
Quorex Construction Services Ltd. – Chris Walbaum
Quorex Construction Services Ltd. – Dustin Williamson
Lavergne Draward & Associates Inc. – Charles Koop
CGM Engineering – Justin Albo
CGM Engineering – Tony Mitousis
CGM Engineering – Brendan Simpson

jeff.craig@sobeys.com
shanwen.hsu@sobeys.com
c.walbaum@quorex.ca
d.williamson@quorex.ca
ckoop@ldaeng.ca
justin_albo@cgmeng.ca
tony_mitousis@cgmeng.ca
brendan_simpson@cgmeng.ca



Principal
Kevin Fawley, SAA MRAIC

Project: Aurora Grocery Store
2000 Anaquod Road, Regina, Saskatchewan
Subject: Snack Bar Coolers
Date: 2025.12.19

Subject: Snack Bar Coolers
References: Electrical Drawing E0.2 – Schedules
Electrical Drawing E2.4 – Partial Layout - Power

1. Refer to attached drawing E0.2 - Schedules for revisions in Panel 'H'. Snack Bar coolers on circuits 22 and 24 are changed to 22,24 and 42,44 respectively. The wire size is reduced from #10 to #12. Two(2) 15A-1P breakers are replaced with two(2) 15A-2P breakers for two(2) Snack Bar coolers.
2. Refer to attached drawing E2.4 – Partial Layout - Power, total of two(2) NEMA 6-15 twist lock receptacles are added to serve Snack Bar coolers.

PANEL '100A'				
400A-347/600V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
PANEL '8L'	100	1 0 2 3 0 1 5 0 15	25	GAS COOLER #10 WIRE
TVSS #10 WIRE	30	7 0 8 9 0 10	30	COMPACTOR #10 WIRE
SPACE	-	13 0 14	-	BALER #10 WIRE
SPACE	-	15 0 16	30	SPACE
SPACE	-	17 0 18	-	SPACE
SPACE	-	19 0 20	-	SPACE
SPACE	-	21 0 22	-	SPACE
SPACE	-	23 0 24	-	SPACE
SPACE	-	25 0 26	-	SPACE
SPACE	-	27 0 28	-	SPACE
SPACE	-	29 0 30	-	SPACE
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE

PANEL '100B'				
400A-347/600V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
RTU-1, ROOF TOP UNIT #1 WIRE	125	1 0 2 3 0 4 5 0 6 7 0 8	15	RTU-4, ROOF TOP UNIT
RTU-2, ROOF TOP UNIT #1 WIRE	70	9 0 10 11 0 12 13 0 14	15	RTU-5, ROOF TOP UNIT
RTU-3, ROOF TOP UNIT #10 WIRE	30	15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	RTU-6, ROOF TOP UNIT
EF-1, EXHAUST FAN	15	25 0 26 27 0 28 29 0 30	30	AC-1, AIR CURTAIN #10 WIRE
TVSS #10 WIRE	30	31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	-	SPACE


PANEL '8L'				
100A-347/600V-3PH-4W PANEL SURFACE MOUNTED IN WEST STAFF CORRIDOR				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
LIGHTING - SALES - POT LIGHTS	15	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - SALES
SPACE	-	25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	-	SPACE

PANEL 'SD-1'				
1200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
PANEL '2A'	200	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20	100	PANEL '1'
PANEL '2L'	200	21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	100	PANEL '1'
PANEL '2B'	200	43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	400	PANEL '1'
PANEL 'C2	200	61 0 62 63 0 64 65 0 66 67 0 68 69 0 70 71 0 72 73 0 74 75 0 76 77 0 78 79 0 80 81 0 82 83 0 84	200	PANEL '5M'
TVSS	30	85 0 86 87 0 88 89 0 90 91 0 92 93 0 94 95 0 96 97 0 98 99 0 100	200	PANEL '1'

PANEL 'SD-2'				
1200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
PANEL '1'	100	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42 43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	200	PANEL '11L'
PANEL 'C1'	100	61 0 62 63 0 64 65 0 66 67 0 68 69 0 70 71 0 72 73 0 74 75 0 76 77 0 78 79 0 80 81 0 82 83 0 84	400	PANEL '12L'
PANEL 'R1M'	200	85 0 86 87 0 88 89 0 90 91 0 92 93 0 94 95 0 96 97 0 98 99 0 100	400	PANEL '13L'
PANEL 'Z'	100	101 0 102 103 0 104 105 0 106 107 0 108 109 0 110 111 0 112 113 0 114 115 0 116 117 0 118 119 0 120 121 0 122 123 0 124 125 0 126 127 0 128 129 0 130 131 0 132 133 0 134 135 0 136 137 0 138 139 0 140 141 0 142 143 0 144 145 0 146 147 0 148 149 0 150 151 0 152 153 0 154 155 0 156 157 0 158 159 0 160	200	PANEL '14L'

PANEL '2A'				
200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
DOOR OPENER (EXTERIOR)	15	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	EXTERIOR SIGNAGE
DOOR OPENER (EXTERIOR)	15	25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42 43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	15	HOUSEKEEPING RECEPTACLES
DOOR OPENER (INSIDE)	15	61 0 62 63 0 64 65 0 66 67 0 68 69 0 70 71 0 72 73 0 74 75 0 76 77 0 78 79 0 80 81 0 82 83 0 84	15	WAREHOUSE COMPUTER
DOOR OPENER (INSIDE)	15	85 0 86 87 0 88 89 0 90 91 0 92 93 0 94 95 0 96 97 0 98 99 0 100	15	SHELVING RECEPTACLE
DOOR OPENER (INSIDE)	15	101 0 102 103 0 104 105 0 106 107 0 108 109 0 110 111 0 112 113 0 114 115 0 116 117 0 118 119 0 120 121 0 122 123 0 124 125 0 126 127 0 128 129 0 130 131 0 132 133 0 134 135 0 136 137 0 138 139 0 140 141 0 142 143 0 144 145 0 146 147 0 148 149 0 150 151 0 152 153 0 154 155 0 156 157 0 158 159 0 160	15	SHELVING RECEPTACLE
BILLBOARD - NORTH	15	161 0 162 163 0 164 165 0 166 167 0 168 169 0 170 171 0 172 173 0 174 175 0 176 177 0 178 179 0 180 181 0 182 183 0 184 185 0 186 187 0 188 189 0 190 191 0 192 193 0 194 195 0 196 197 0 198 199 0 200	15	SHELVING RECEPTACLE
BILLBOARD - NORTH	15	201 0 202 203 0 204 205 0 206 207 0 208 209 0 210 211 0 212 213 0 214 215 0 216 217 0 218 219 0 220 221 0 222 223 0 224 225 0 226 227 0 228 229 0 230 231 0 232 233 0 234 235 0 236 237 0 238 239 0 240 241 0 242 243 0 244 245 0 246 247 0 248 249 0 250 251 0 252 253 0 254 255 0 256 257 0 258 259 0 260	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	261 0 262 263 0 264 265 0 266 267 0 268 269 0 270 271 0 272 273 0 274 275 0 276 277 0 278 279 0 280 281 0 282 283 0 284 285 0 286 287 0 288 289 0 290 291 0 292 293 0 294 295 0 296 297 0 298 299 0 300	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	301 0 302 303 0 304 305 0 306 307 0 308 309 0 310 311 0 312 313 0 314 315 0 316 317 0 318 319 0 320 321 0 322 323 0 324 325 0 326 327 0 328 329 0 330 331 0 332 333 0 334 335 0 336 337 0 338 339 0 340 341 0 342 343 0 344 345 0 346 347 0 348 349 0 350 351 0 352 353 0 354 355 0 356 357 0 358 359 0 360	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	361 0 362 363 0 364 365 0 366 367 0 368 369 0 370 371 0 372 373 0 374 375 0 376 377 0 378 379 0 380 381 0 382 383 0 384 385 0 386 387 0 388 389 0 390 391 0 392 393 0 394 395 0 396 397 0 398 399 0 400	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	401 0 402 403 0 404 405 0 406 407 0 408 409 0 410 411 0 412 413 0 414 415 0 416 417 0 418 419 0 420 421 0 422 423 0 424 425 0 426 427 0 428 429 0 430 431 0 432 433 0 434 435 0 436 437 0 438 439 0 440 441 0 442 443 0 444 445 0 446 447 0 448 449 0 450 451 0 452 453 0 454 455 0 456 457 0 458 459 0 460	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	461 0 462 463 0 464 465 0 466 467 0 468 469 0 470 471 0 472 473 0 474 475 0 476 477 0 478 479 0 480 481 0 482 483 0 484 485 0 486 487 0 488 489 0 490 491 0 492 493 0 494 495 0 496 497 0 498 499 0 500	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	501 0 502 503 0 504 505 0 506 507 0 508 509 0 510 511 0 512 513 0 514 515 0 516 517 0 518 519 0 520 521 0 522 523 0 524 525 0 526 527 0 528 529 0 530 531 0 532 533 0 534 535 0 536 537 0 538 539 0 540 541 0 542 543 0 544 545 0 546 547 0 548 549 0 550 551 0 552 553 0 554 555 0 556 557 0 558 559 0 560	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	561 0 562 563 0 564 565 0 566 567 0 568 569 0 570 571 0 572 573 0 574 575 0 576 577 0 578 579 0 580 581 0 582 583 0 584 585 0 586 587 0 588 589 0 590 591 0 592 593 0 594 595 0 596 597 0 598 599 0 600	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	601 0 602 603 0 604 605 0 606 607 0 608 609 0 610 611 0 612 613 0 614 615 0 616 617 0 618 619 0 620 621 0 622 623 0 624 625 0 626 627 0 628 629 0 630 631 0 632 633 0 634 635 0 636 637 0 638 639 0 640 641 0 642 643 0 644 645 0 646 647 0 648 649 0 650 651 0 652 653 0 654 655 0 656 657 0 658 659 0 660	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	661 0 662 663 0 664 665 0 666 667 0 668 669 0 670 671 0 672 673 0 674 675 0 676 677 0 678 679 0 680 681 0 682 683 0 684 685 0 686 687 0 688 689 0 690 691 0 692 693 0 694 695 0 696 697 0 698 699 0 700	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	701 0 702 703 0 704 705 0 706 707 0 708 709 0 710 711 0 712 713 0 714 715 0 716 717 0 718 719 0 720 721 0 722 723 0 724 725 0 726 727 0 728 729 0 730 731 0 732 733 0 734 735 0 736 737 0 738 739 0 740 741 0 742 743 0 744 745 0 746 747 0 748 749 0 750 751 0 752 753 0 754 755 0 756 757 0 758 759 0 760	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	761 0 762 763 0 764 765 0 766 767 0 768 769 0 770 771 0 772 773 0 774 775 0 776 777 0 778 779 0 780 781 0 782 783 0 784 785 0 786 787 0 788 789 0 790 791 0 792 793 0 794 795 0 796 797 0 798 799 0 800	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	801 0 802 803 0 804 805 0 806 807 0 808 809 0 810 811 0 812 813 0 814 815 0 816 817 0 818 819 0 820 821 0 822 823 0 824 825 0 826 827 0 828 829 0 830 831 0 832 833 0 834 835 0 836 837 0 838 839 0 840 841 0 842 843 0 844 845 0 846 847 0 848 849 0 850 851 0 852 853 0 854 855 0 856 857 0 858 859 0 860	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	861 0 862 863 0 864 865 0 866 867 0 868 869 0 870 871 0 872 873 0 874 875 0 876 877 0 878 879 0 880 881 0 882 883 0 884 885 0 886 887 0 888 889 0 890 891 0 892 893 0 894 895 0 896 897 0 898 899 0 900	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	901 0 902 903 0 904 905 0 906 907 0 908 909 0 910 911 0 912 913 0 914 915 0 916 917 0 918 919 0 920 921 0 922 923 0 924 925 0 926 927 0 928 929 0 930 931 0 932 933 0 934 935 0 936 937 0 938 939 0 940 941 0 942 943 0 944 945 0 946 947 0 948 949 0 950 951 0 952 953 0 954 955 0 956 957 0 958 959 0 960	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	961 0 962 963 0 964 965 0 966 967 0 968 969 0 970 971 0 972 973 0 974 975 0 976 977 0 978 979 0 980 981 0 982 983 0 984 985 0 986 987 0 988 989 0 990 991 0 992 993 0 994 995 0 996 997 0 998 999 0 1000	15	SHELVING RECEPTACLE

PANEL '2L'				
200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN WEST STAFF CORRIDOR				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
LIGHTING - SALES - TRACK	20	1 0 2	15	DECORATIVE LIGHTING
LIGHTING - SALES - TRACK	15	3 0 4	20	LIGHTING - TRELLIS
LIGHTING - SALES - TRACK	15	5 0 6	20	LIGHTING - TRELLIS
LIGHTING - SALES - TRACK	15	7 0 8	20	LIGHTING - TRELLIS
LIGHTING - SALES - TRACK	15	9 0 10	15	LIGHTING - BULKHEAD
LIGHTING - DOCK LIGHTS	15	11 0 12	15	LIGHTING - BULKHEAD
ILLUMINATION SIGNAGE POWER SUPPLY	15	13 0 14	15	ILLUMINATION SIGNAGE POWER SUPPLY
ILLUMINATION SIGNAGE POWER SUPPLY	15	15 0 16	15	ILLUMINATION SIGNAGE POWER SUPPLY
ILLUMINATION SIGNAGE POWER SUPPLY	15	17 0 18	15	ILLUMINATION SIGNAGE POWER SUPPLY
ILLUMINATION SIGNAGE POWER SUPPLY	15	19 0 20	15	ILLUMINATION SIGNAGE POWER SUPPLY
ILLUMINATION SIGNAGE POWER SUPPLY	15	21 0 22	-	SPACE
SPACE	23	0 24	-	SPACE
SPACE	25	0 26	-	SPACE
SPACE	27	0 28	-	SPACE
SPACE	29	0 30	-	SPACE
SPACE	31	0 32	-	SPACE
SPACE	33	0 34	-	SPACE
SPACE	35	0 36	-	SPACE
SPACE	37	0 38	-	SPACE
SPACE	39	0 40	-	SPACE
SPACE	41	0 42	-	SPACE

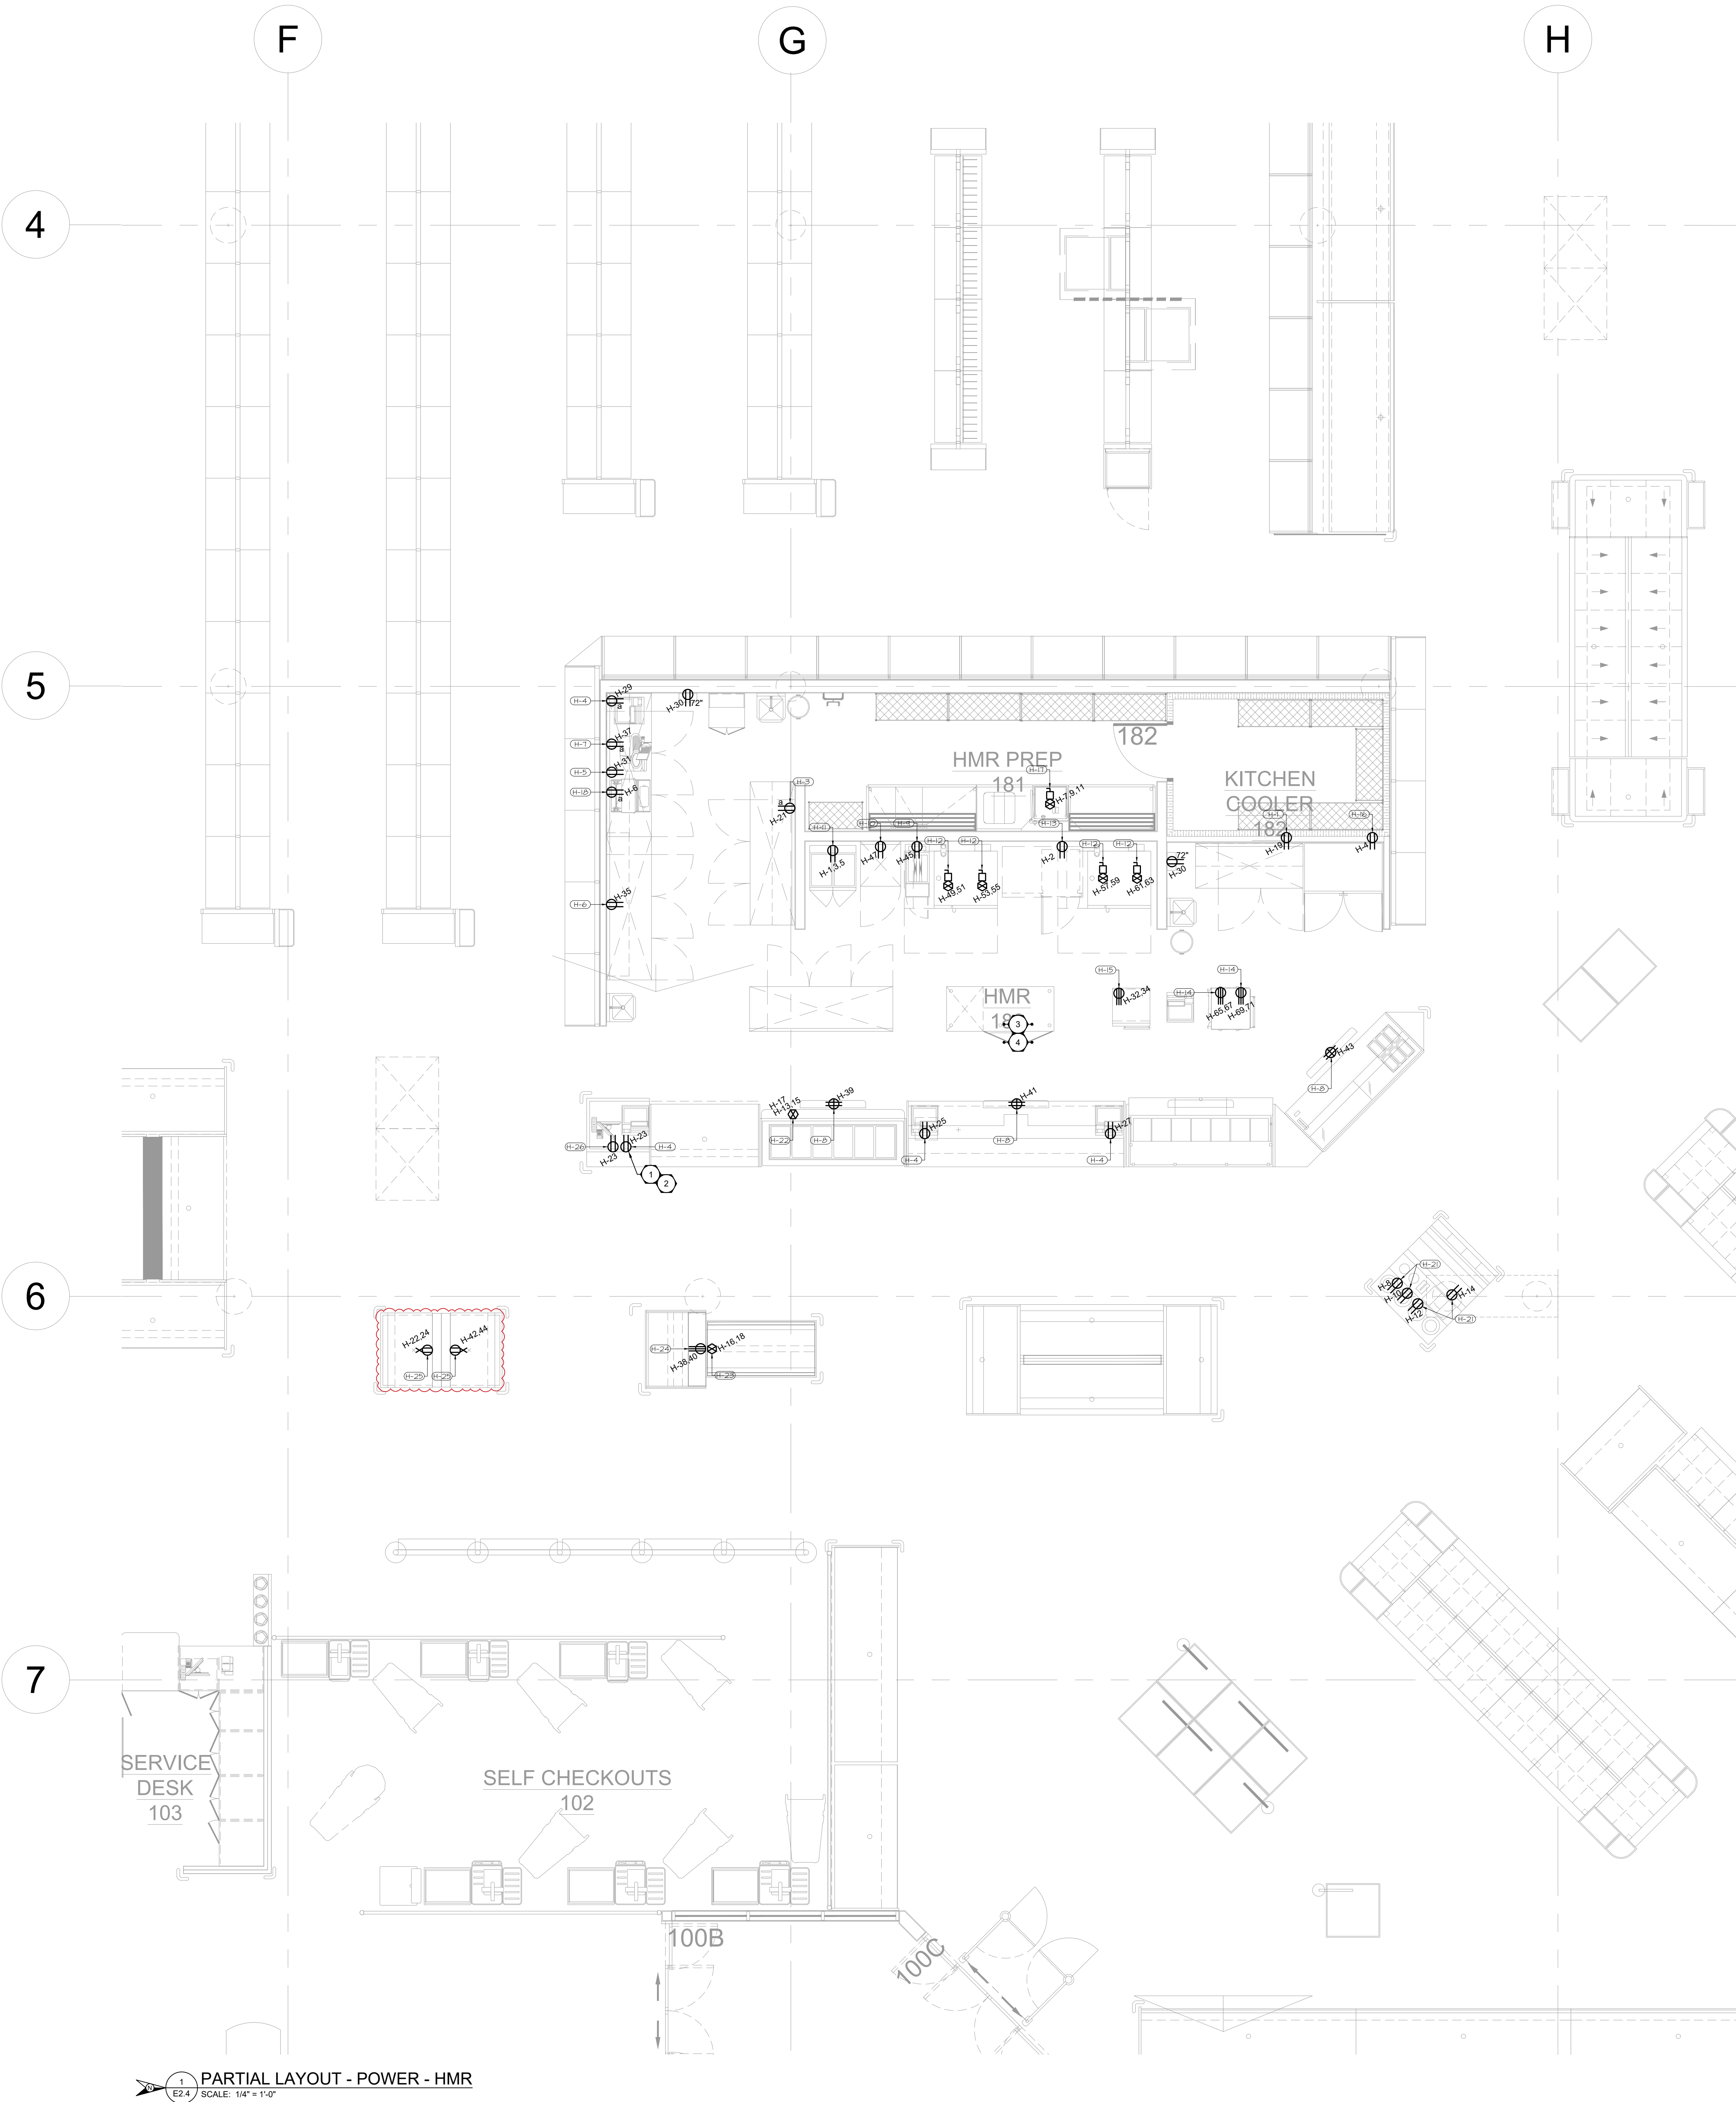

DRAWING NOTES - HMR

1. PROVIDE PERMANENT TYPE WRITTEN LABEL ON ALL RECEPTACLES IDENTIFYING THE CIRCUIT NUMBER AND PANEL BOARD NAME WHERE IT IS CONNECTED.
2. VERIFY MOUNTING HEIGHT AND EXACT LOCATION OF RECEPTACLES AND STUB-UPS, COORDINATE WITH MILL WORK, MECHANICAL AND REFRIGERATION CONTRACTOR, SEE TRACES AND SAFETYWAY MANAGEMENT PRIOR TO ROUGH-IN.
3. COORDINATE FINAL LOCATION AND POWER / CONTROL REQUIREMENTS OF ALL EQUIPMENT IN VARIOUS DEPARTMENTS, COORDINATE WITH EQUIPMENT / FIXTURE SUPPLIERS AND MILL WORKS PRIOR TO ROUGH-IN.
4. ALL RECEPTACLES WITHIN PREPARATION AREAS (MEAT, SEAFOOD, PRODUCE PREPARATION, ETC.) TO BE WATERPROOF.
5. PROVIDE 1" DIAMETER CONDUIT AS INDICATED, PRIOR TO CONCRETE POURING, EXAMINE SITE AND CONFIRM ROUTING OF CONDUIT WITH GC AND ALL ASSOCIATED TRADES.

1 KEY PLAN
E2.4 SCALE: 1/8" = 1'-0"

H.M.R. PREP. AREA EQUIPMENT SCHEDULE						
EQUIP. #	QTY	EQUIPMENT	CONDUCTORS (CU.)	VOLTS	LOAD	BREAKER
H-1	1	6" REFRIGERATOR UIC UNIT	#12	120V-1PH	1.44 KW	15A-1P
H-3	1	RICE COOKER	#12	120V-1PH	1.55 KW	20A-1P
H-4	4	SCALE PRINTER	#12	120V-1PH	240W	15A-1P
H-5	1	8" REFRIGERATOR UIC UNIT	#12	120V-1PH	1.44 KW	15A-1P
H-6	2	8" FREEZER UIC UNIT	#12	120V-1PH	1.6 KW	20A-1P
H-7	1	SLICER	#12	120V-1PH	840W	15A-1P
H-8	3	55" LG TV	#12	120V-1PH	100W	15A-1P
H-9	1	DEEP FRYER (GAS)	#12	120V-1PH	720W	15A-1P
H-10	1	27" FREEZER	#12	120V-1PH	1.44 KW	15A-1P
H-11	1	PITCO RETHERMALIZER (GAS)	#10	208V-3PH	22 A	30A-3P
H-12	4	RATIONAL COMBO OVEN (GAS)	#12	208V-1PH	900W	15A-2P
H-13	1	9" BLAST CHILLER	#12	120V-1PH	13.3 A	15A-1P
H-14	1	DOUBLE DECK TURBO CHIEF	#8	208V-1PH	8.32 KW	50A-2P
H-15	1	AMANA OVEN	#10	208V-1PH	5.7 KW	30A-2P
H-16	1	2 DOOR FREEZER	#12	120V-1PH	1.34 KW	15A-1P
H-17	1	DISHWASHER	#6	208V-3PH	53.7 A	60A-3P
H-18	1	WRAPPER	#12	120V-1PH	725W	15A-1P
H-21	4	HOT AND COLD SOUP	#12	120V-1PH	500W	15A-1P
H-22	1	FULL SERVICE HOT FOODS C/W SEPARATE CIRCUIT RECEPTACLE	#4 #12	208V-1PH 120V-1PH	68 MCA 10A	70A-2P 15A-1P
H-23	1	HOT CHICKEN ISLAND	#8	208V-1PH	6.2 KW	40A-2P
H-24	1	4' COLD SIDE AND SALADS	#12	208V-1PH	6.5A	15A-2P
H-25	2	SNACK BAR	#12	208V-1PH	MCA: 14.31	15A-2P
H-26	1	POS STATION	#12	120V-1PH	240W	15A-1P

NOTES:
1. ELECTRICAL CONTRACTOR TO WIRE AND CONNECT ALL KITCHEN EQUIPMENT AS INDICATED. PROVIDE WIRING AND CIRCUIT BREAKERS TO FINAL NAMEPLATE OF THE EQUIPMENT.
2. ELECTRICAL CONTRACTOR TO CONFIRM ALL EQUIPMENT LOADS, CIRCUIT SIZES, AND MOUNTING HEIGHTS PRIOR TO ROUGH-IN.
3. ELECTRICAL CONTRACTOR TO PROVIDE ALL RELAYS & WIRING AND MAKE ALL CONNECTIONS FOR INTERLOCKING OF ALL EQUIPMENT AS REQUIRED. CONFIRM AND COORDINATE EXACT REQUIREMENTS ON SITE.
4. ELECTRICAL CONTRACTOR TO PROVIDE ALL STARTERS AND DISCONNECT SWITCHES AS REQUIRED.
5. ALL STARTERS ARE TO BE COMPLETE WITH OVERCURRENT PROTECTION.
6. ELECTRICAL CONTRACTOR TO PROVIDE ALL LINE VOLTAGE CONTROL WIRING AS REQUIRED.
7. PROVIDE A NEUTRAL WIRE FOR ALL EQUIPMENT.
8. QUANTITIES ARE FOR UTILITIES INFORMATION ONLY TO DETERMINE LOADS. CONTRACTOR TO CONFIRM EXACT QUANTITIES AND LOCATIONS WITH THE APPROVED EQUIPMENT PACKAGE AND PLAN.

1 PARTIAL LAYOUT - POWER - HMR
E2.4 SCALE: 1/4" = 1'-0"

1	PCN-30	2025.12.19	KC
No.	ISSUED FOR	DATE	BY
DRAWN BY:	BS		
PRINTING DATE:	DECEMBER 19, 2025		

CGM 200-1100 CORYOON AVE WINNIPEG, MB R3M 0Y3
ENGINEERING LTD. PROJECT NO: 24258
P 204 947 3775 F 204 947 3789 www.nejmark.mb.ca

NEJ MARK ARCHITECT
2-54 Adelaide Street Winnipeg Manitoba R3A 0V7
P 204 947 3775 F 204 947 3789 www.nejmark.mb.ca

Drawings and specifications, as instruments of service are the property of the Architect, the copyright in the same being reserved to them. No reproduction may be made without the permission of the architect, and when made, must bear their names. All prints to be returned. The contractor is to verify dimensions and date noted times with conditions on the site and is held responsible for reporting discrepancies to the Architect for adjustment.

PROJECT TITLE:

AURORA GROCERY
STORE
2000 ANAQUOD ROAD
REGINA, SASKATCHEWAN

SHEET TITLE:
PARTIAL LAYOUT -
POWER
COMMISSION NUMBER:
2445

SHEET NUMBER:
E2.4




GENIUS 2 H145 UI/SC (PROPANE)




07/2023

VUE CÔTÉ / SIDE VIEW

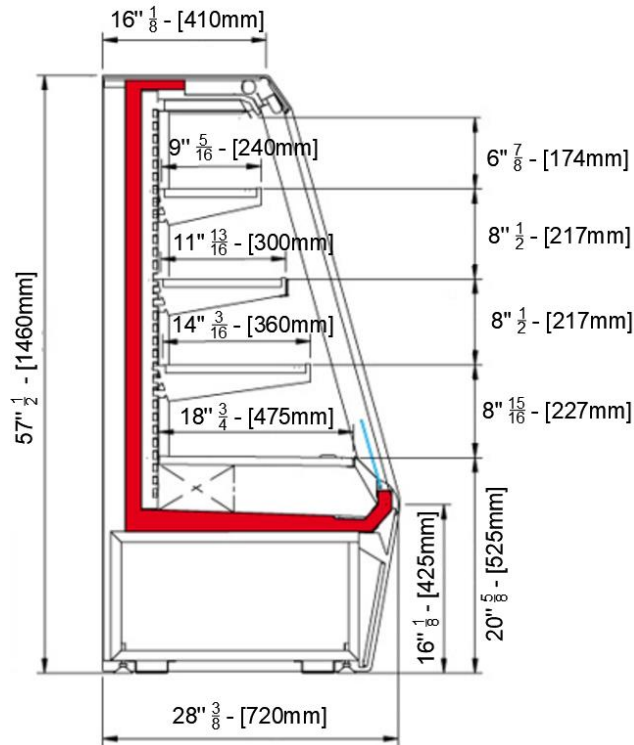

VUE DESSUS / PLAN VIEW

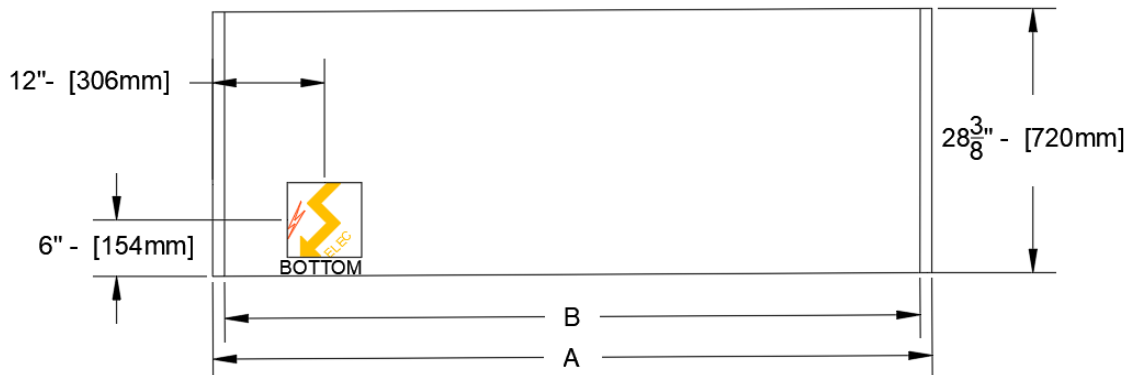

		03M	04M	06M
Longueur Comptoir / Case Length	A	$40\frac{5}{16}$ / 1027mm	$52\frac{3}{4}$ / 1340mm	$77\frac{3}{8}$ / 1965mm
Longueur sans les bouts / Length without ends	B	$37\frac{7}{8}$ / 937mm	$50\frac{1}{4}$ / 1250mm	$74\frac{7}{8}$ / 1901mm

Arneg Canada se réserve le droit de modifier ou de réviser les spécifications et la conception des produits dans le cadre d'une révision de ses produits. Ces changements ne donnent aucun droit à l'acheteur sur ces modifications, améliorations ou remplacements pour les équipements vendus ou expédiés précédemment.

Arneg Canada reserves the right to change or revise specifications and product design in connection with any feature of its products. Such changes do not entitle the buyer to corresponding changes, improvements, additions or replacements for equipment previously sold or shipped.




ARNEG CANADA • LACOLLE (QUEBEC) •
J0J1J0 • CANADA 1-800-363-3439 •
www.arneg.ca

**GENIUS 2
H145**

Rev.B

Données Électriques / Electrical Data



	03M	04M	06M
Alimentation / Power supply (Voltage/Phase/Hz)	(230/1/60)	(230/1/60)	(230/1/60)
MCA (A)	9.37	14.31	16.07
MOP (A)	15	15	20
Fiche électrique / Electrical plug	 15A 250V NEMA L6-15P UL/CSA 1.5 HP	 15A 250V NEMA L6-15P UL/CSA 1.5 HP	 20A 250V NEMA L6-20P UL/CSA 2 HP
Dégivrage / Defrost	Électrique / Electric		

Arneg Canada se réserve le droit de modifier ou de réviser les spécifications et la conception des produits dans le cadre d'une révision de ses produits. Ces changements ne donnent aucun droit à l'acheteur sur ces modifications, améliorations ou remplacements pour les équipements vendus ou expédiés précédemment.

Arneg Canada reserves the right to change or revise specifications and product design in connection with any feature of its products. Such changes do not entitle the buyer to corresponding changes, improvements, additions or replacements for equipment previously sold or shipped.

ARNEG CANADA • LACOLLE (QUEBEC) •
 J0J1J0 • CANADA 1-800-363-3439 •
www.arneg.ca

GENIUS 2
H145

Rev.B



18 rue Richelieu street
Lacolle, Québec, Canada
J0J1J0



GENIUS 2 H145 P85 UI R290

Arneg Canada se réserve le droit de modifier ou de réviser les spécifications et la conception des produits dans le cadre d'une révision de ses produits. Ces changements ne donnent aucun droit à l'acheteur sur ces modifications, améliorations ou remplacements pour les équipements vendus ou expédiés précédemment.

Arneg Canada reserves the right to change or revise specifications and product design in connection with any feature of its products. Such changes do not entitle the buyer to corresponding changes, improvements, additions or replacements for equipment previously sold or shipped.

ARNEG CANADA • LACOLLE (QUEBEC) •
J0J1J0 • CANADA 1-800-363-3439 •
www.arneg.ca

**GENIUS 2
H145**

Rev.B