

No work is to be done before this matter is finalized and a "Change Order" is issued. This copy to remain with your office. Do not return. Contractor to submit signed letter with price including cost breakdown and change (if any) to construction schedule. Authority having Jurisdiction shall advise of any objections.

TO: QUOREX CONSTRUCTION SERVICES LTD.
1630A 8th Avenue,
Regina, SK S4R 1E5

RE: AURORA FOOD STORE
2000 ANAQUOD ROAD
REGINA, SK
Commission No. 2445

DATE: July 23, 2025

PAGES: 5 (including cover)

RE: Refrigerated Floral Cases

1.0 ELECTRICAL

.1 Refer to attached Electrical PCN #10, dated July 23, 2025. (4 pages)

Distribution:

Sobeys Inc. – Jeff Craig
Sobeys Inc. – Shanwen Hsu
Quorex Construction Services Ltd. – Chris Walbaum
Lavergne Draward & Associates Inc. – Charles Koop
CGM Engineering – Justin Albo
CGM Engineering – Tony Mitousis
CGM Engineering – Brendan Simpson

jeff.craig@sobeys.com
shanwen.hsu@sobeys.com
c.walbaum@quorex.ca
ckoop@ldaeng.ca
justin_albo@cgmeng.ca
tony_mitousis@cgmeng.ca
brendan_simpson@cgmeng.ca



Principal
Kevin Fawley, SAA MRAIC



Project: Aurora Grocery Store
2000 Anaquod Road, Regina, Saskatchewan
Subject: Refrigerated Floral Cases
Date: 2025.07.23

Subject: Refrigerated Floral Cases
References: Electrical Drawing E0.2 – Schedules
Electrical Drawing E2.1 – Partial Layout – Power


1. Refer to attached drawing E0.2 for two(2) additional 20A-2P breakers added to panel 'D' for the refrigerated floral cases.
2. Refer to attached drawing E2.1 for the location of two(2) receptacles for the refrigerated floral cases. The floral prep area equipment schedule is updated on drawing E2.1 for reference.

GENERAL NOTES :
-ALL WELDED AND POLISHED EDGES- NO SHARP EDGES OR WELD BURRS


ITEM LIST				
ITEM #	C.D. CN#	QTY	DESCRIPTION	MODEL:
			REFRIGERATED FLORAL COUNTER BACK TO BACK	NOVA-FL-3T-487250-SC

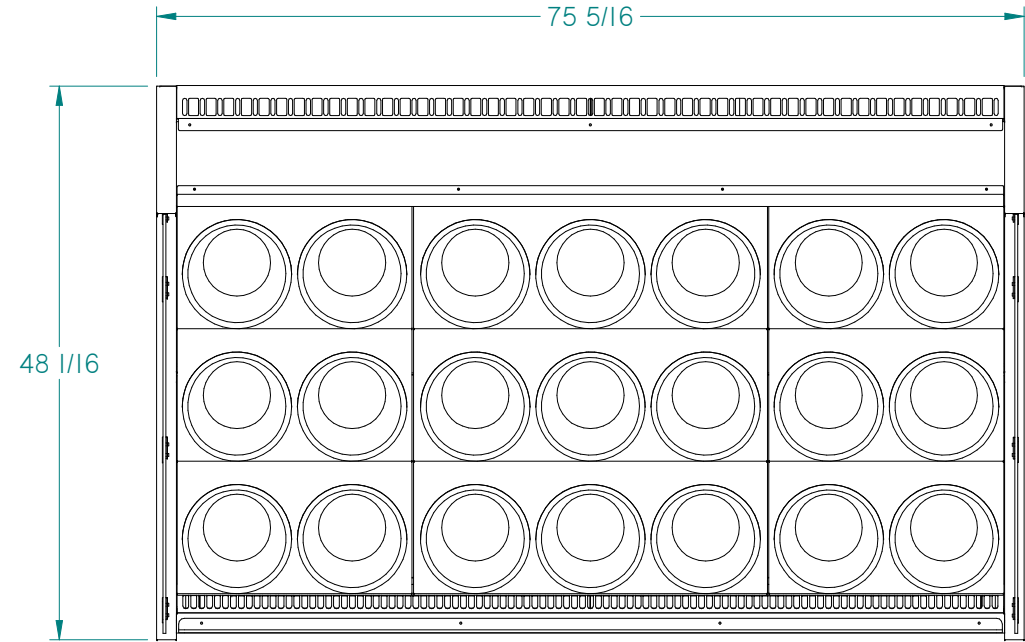


ALL PAINTED BLACK

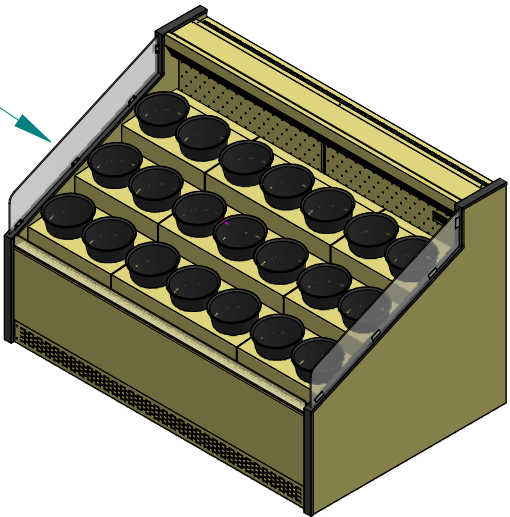

16.5 AMPS
120/208V IPH

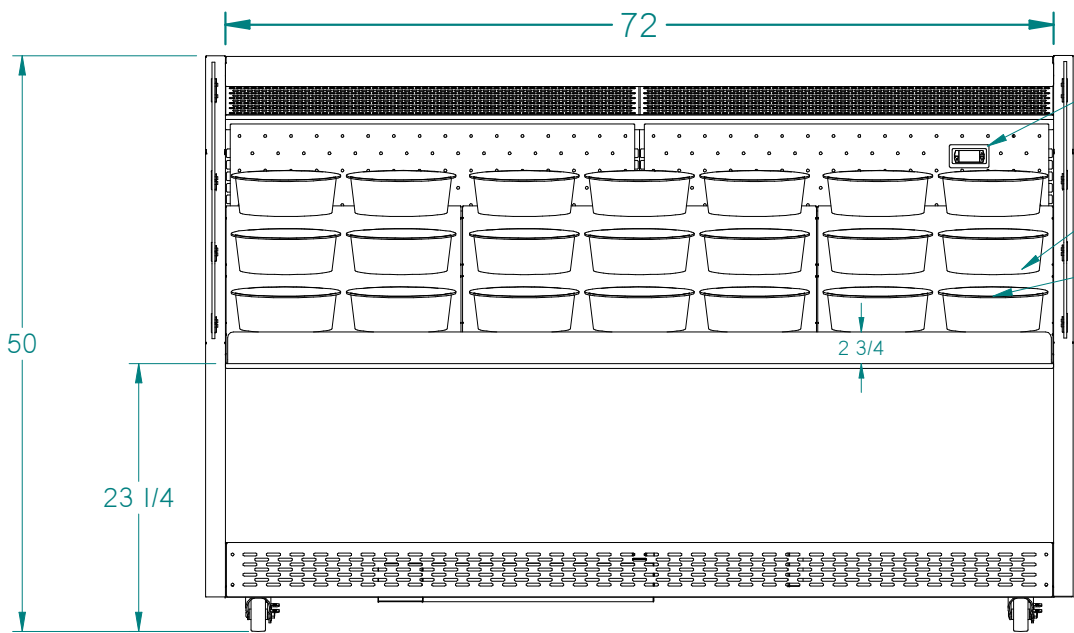

DIGITAL CONTROLLER WITH THERMOMETER
REMOVABLE DECK
FLORAL BUCKET (INCLUDED)

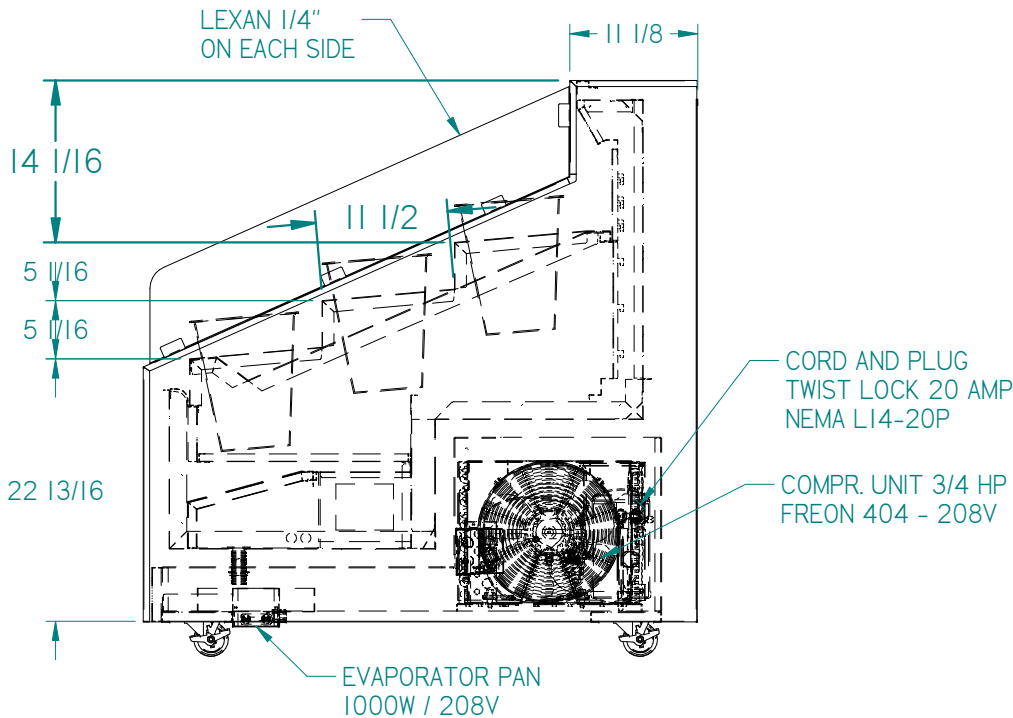

CUSTOMER: SOBEYS

PROJECT:

LOCATION:

ORDER NO:

ITEM(S) #	C.D. CN(S)#
	CN-001

DWG. DATE: APRIL 16, 2021

DRAWN BY: M.JOLICOEUR

SHEET NO: REV. 0

1 / 1

PANEL '100A'				
400A-347/600V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
PANEL '8L'	100	1 0 2 3 0 1 5 0 15	25	GAS COOLER #10 WIRE
TVSS #10 WIRE	30	7 0 8 9 0 10	30	COMPACTOR #10 WIRE
SPACE	-	13 0 14	-	BALER #10 WIRE
SPACE	-	15 0 16	30	SPACE
SPACE	-	17 0 18	-	SPACE
SPACE	-	19 0 20	-	SPACE
SPACE	-	21 0 22	-	SPACE
SPACE	-	23 0 24	-	SPACE
SPACE	-	25 0 26	-	SPACE
SPACE	-	27 0 28	-	SPACE
SPACE	-	29 0 30	-	SPACE
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE

PANEL '100B'				
400A-347/600V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
RTU-1, ROOF TOP UNIT #1 WIRE	125	1 0 2 3 0 4 5 0 6 7 0 8	15	RTU-4, ROOF TOP UNIT
RTU-2, ROOF TOP UNIT #1 WIRE	70	9 0 10 11 0 12 13 0 14	15	RTU-5, ROOF TOP UNIT
RTU-3, ROOF TOP UNIT #10 WIRE	30	15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	RTU-6, ROOF TOP UNIT
EF-1, EXHAUST FAN	15	25 0 26 27 0 28 29 0 30	30	AC-1, AIR CURTAIN #10 WIRE
TVSS #10 WIRE	30	31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	-	SPACE
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE


PANEL '8L'				
100A-347/600V-3PH-4W PANEL SURFACE MOUNTED IN WEST STAFF CORRIDOR				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
LIGHTING - SALES - POT LIGHTS	15	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - SALES
SPACE	-	15 0 16	-	LIGHTING - SALES
SPACE	-	17 0 18	-	LIGHTING - SALES
LIGHTING - SEATING	15	7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - SEATING
LIGHTING - CHECKOUTS	15	9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - CHECKOUTS
LIGHTING - OFFICE	15	11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - OFFICE
LIGHTING - DELI	15	13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - DELI
LIGHTING - PHARMACY	15	15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - PHARMACY
LIGHTING - BAKERY	15	17 0 18 19 0 20 21 0 22 23 0 24	15	LIGHTING - BAKERY
LIGHTING - HMR	15	19 0 20 21 0 22 23 0 24	15	LIGHTING - HMR
LIGHTING - SEAFOOD / MEATS / PRODUCE	15	21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	LIGHTING - SEAFOOD / MEATS / PRODUCE
SPACE	-	23 0 24	-	SPACE
SPACE	-	25 0 26	-	SPACE
SPACE	-	27 0 28	-	SPACE
SPACE	-	29 0 30	-	SPACE
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE

PANEL 'SD-1'				
1200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
PANEL '2A'	200	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12	100	PANEL '1'
PANEL '2L'	200	13 0 14 15 0 16 17 0 18 19 0 20	100	PANEL '1'
PANEL '2B'	200	21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	400	PANEL '1'
PANEL '12	200	21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	200	PANEL '5M'
TVSS	30	27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	200	PANEL '1'
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE
SPACE	-	43 0 44	-	SPACE
SPACE	-	45 0 46	-	SPACE
SPACE	-	47 0 48	-	SPACE
SPACE	-	49 0 50	-	SPACE
SPACE	-	51 0 52	-	SPACE
SPACE	-	53 0 54	-	SPACE
SPACE	-	55 0 56	-	SPACE
SPACE	-	57 0 58	-	SPACE
SPACE	-	59 0 60	-	SPACE

PANEL 'SD-2'				
1200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
PANEL '1'	100	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42 43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	200	PANEL '11L'
PANEL '11'	100	7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42 43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	400	PANEL '12L'
PANEL '13M'	200	13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42 43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	400	PANEL '13L'
PANEL '2'	100	21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42 43 0 44 45 0 46 47 0 48 49 0 50 51 0 52 53 0 54 55 0 56 57 0 58 59 0 60	200	PANEL '14L'
SPACE	-	23 0 24	-	SPACE
SPACE	-	25 0 26	-	SPACE
SPACE	-	27 0 28	-	SPACE
SPACE	-	29 0 30	-	SPACE
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE
SPACE	-	43 0 44	-	SPACE
SPACE	-	45 0 46	-	SPACE
SPACE	-	47 0 48	-	SPACE
SPACE	-	49 0 50	-	SPACE
SPACE	-	51 0 52	-	SPACE
SPACE	-	53 0 54	-	SPACE
SPACE	-	55 0 56	-	SPACE
SPACE	-	57 0 58	-	SPACE
SPACE	-	59 0 60	-	SPACE

PANEL '2A'				
200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN COMPRESSOR ROOM 300				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
DOOR OPENER (EXTERIOR)	15	1 0 2 3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	EXTERIOR SIGNAGE
DOOR OPENER (EXTERIOR)	15	3 0 4 5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	HOUSEKEEPING RECEPTACLES
DOOR OPENER (INSIDE)	15	5 0 6 7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	WAREHOUSE COMPUTER
DOOR OPENER (INSIDE)	15	7 0 8 9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
DOOR OPENER (INSIDE)	15	9 0 10 11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
DOOR OPENER (INSIDE)	15	11 0 12 13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
BILLBOARD - NORTH	15	13 0 14 15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
BILLBOARD - NORTH	15	15 0 16 17 0 18 19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
BILLBOARD - NORTH	15	17 0 18 19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
BILLBOARD - NORTH	15	19 0 20 21 0 22 23 0 24	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	21 0 22 23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	23 0 24 25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	25 0 26 27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
BILLBOARD - WEST	15	27 0 28 29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
EXTERIOR SIGNAGE	15	29 0 30 31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
EXTERIOR SIGNAGE	15	31 0 32 33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
EXTERIOR SIGNAGE	15	33 0 34 35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
EXTERIOR SIGNAGE	15	35 0 36 37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
EXTERIOR SIGNAGE	15	37 0 38 39 0 40 41 0 42	15	SHELVING RECEPTACLE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE
SPACE	-	43 0 44	-	SPACE
SPACE	-	45 0 46	-	SPACE
SPACE	-	47 0 48	-	SPACE
SPACE	-	49 0 50	-	SPACE
SPACE	-	51 0 52	-	SPACE
SPACE	-	53 0 54	-	SPACE
SPACE	-	55 0 56	-	SPACE
SPACE	-	57 0 58	-	SPACE
SPACE	-	59 0 60	-	SPACE
SPACE	-	61 0 62	-	SPACE
SPACE	-	63 0 64	-	SPACE
SPACE	-	65 0 66	-	SPACE
SPACE	-	67 0 68	-	SPACE
SPACE	-	69 0 70	-	SPACE
SPACE	-	71 0 72	-	SPACE
SPACE	-	73 0 74	-	SPACE
SPACE	-	75 0 76	-	SPACE
SPACE	-	77 0 78	-	SPACE
SPACE	-	79 0 80	-	SPACE
SPACE	-	81 0 82	-	SPACE
SPACE	-	83 0 84	-	SPACE


PANEL '2L'				
200A-120/208V-3PH-4W PANEL SURFACE MOUNTED IN WEST STAFF CORRIDOR				
DESCRIPTION	CIRCUIT BREAKER	PHASE A B C	CIRCUIT BREAKER	DESCRIPTION
LIGHTING - SALES - TRACK	20	1 0 2	15	DECORATIVE LIGHTING
LIGHTING - SALES - TRACK	15	3 0 4	20	LIGHTING - TRELLIS
LIGHTING - SALES - TRACK	15	5 0 6	20	LIGHTING - TRELLIS
LIGHTING - SALES - TRACK	15	7 0 8	20	LIGHTING - TRELLIS
LIGHTING - SALES - TRACK	15	9 0 10	15	LIGHTING - BULKHEAD
LIGHTING - DOCK LIGHTS	15	11 0 12	15	LIGHTING - BULKHEAD
SPACE	-	13 0 14	-	SPACE
SPACE	-	15 0 16	-	SPACE
SPACE	-	17 0 18	-	SPACE
SPACE	-	19 0 20	-	SPACE
SPACE	-	21 0 22	-	SPACE
SPACE	-	23 0 24	-	SPACE
SPACE	-	25 0 26	-	SPACE
SPACE	-	27 0 28	-	SPACE
SPACE	-	29 0 30	-	SPACE
SPACE	-	31 0 32	-	SPACE
SPACE	-	33 0 34	-	SPACE
SPACE	-	35 0 36	-	SPACE
SPACE	-	37 0 38	-	SPACE
SPACE	-	39 0 40	-	SPACE
SPACE	-	41 0 42	-	SPACE

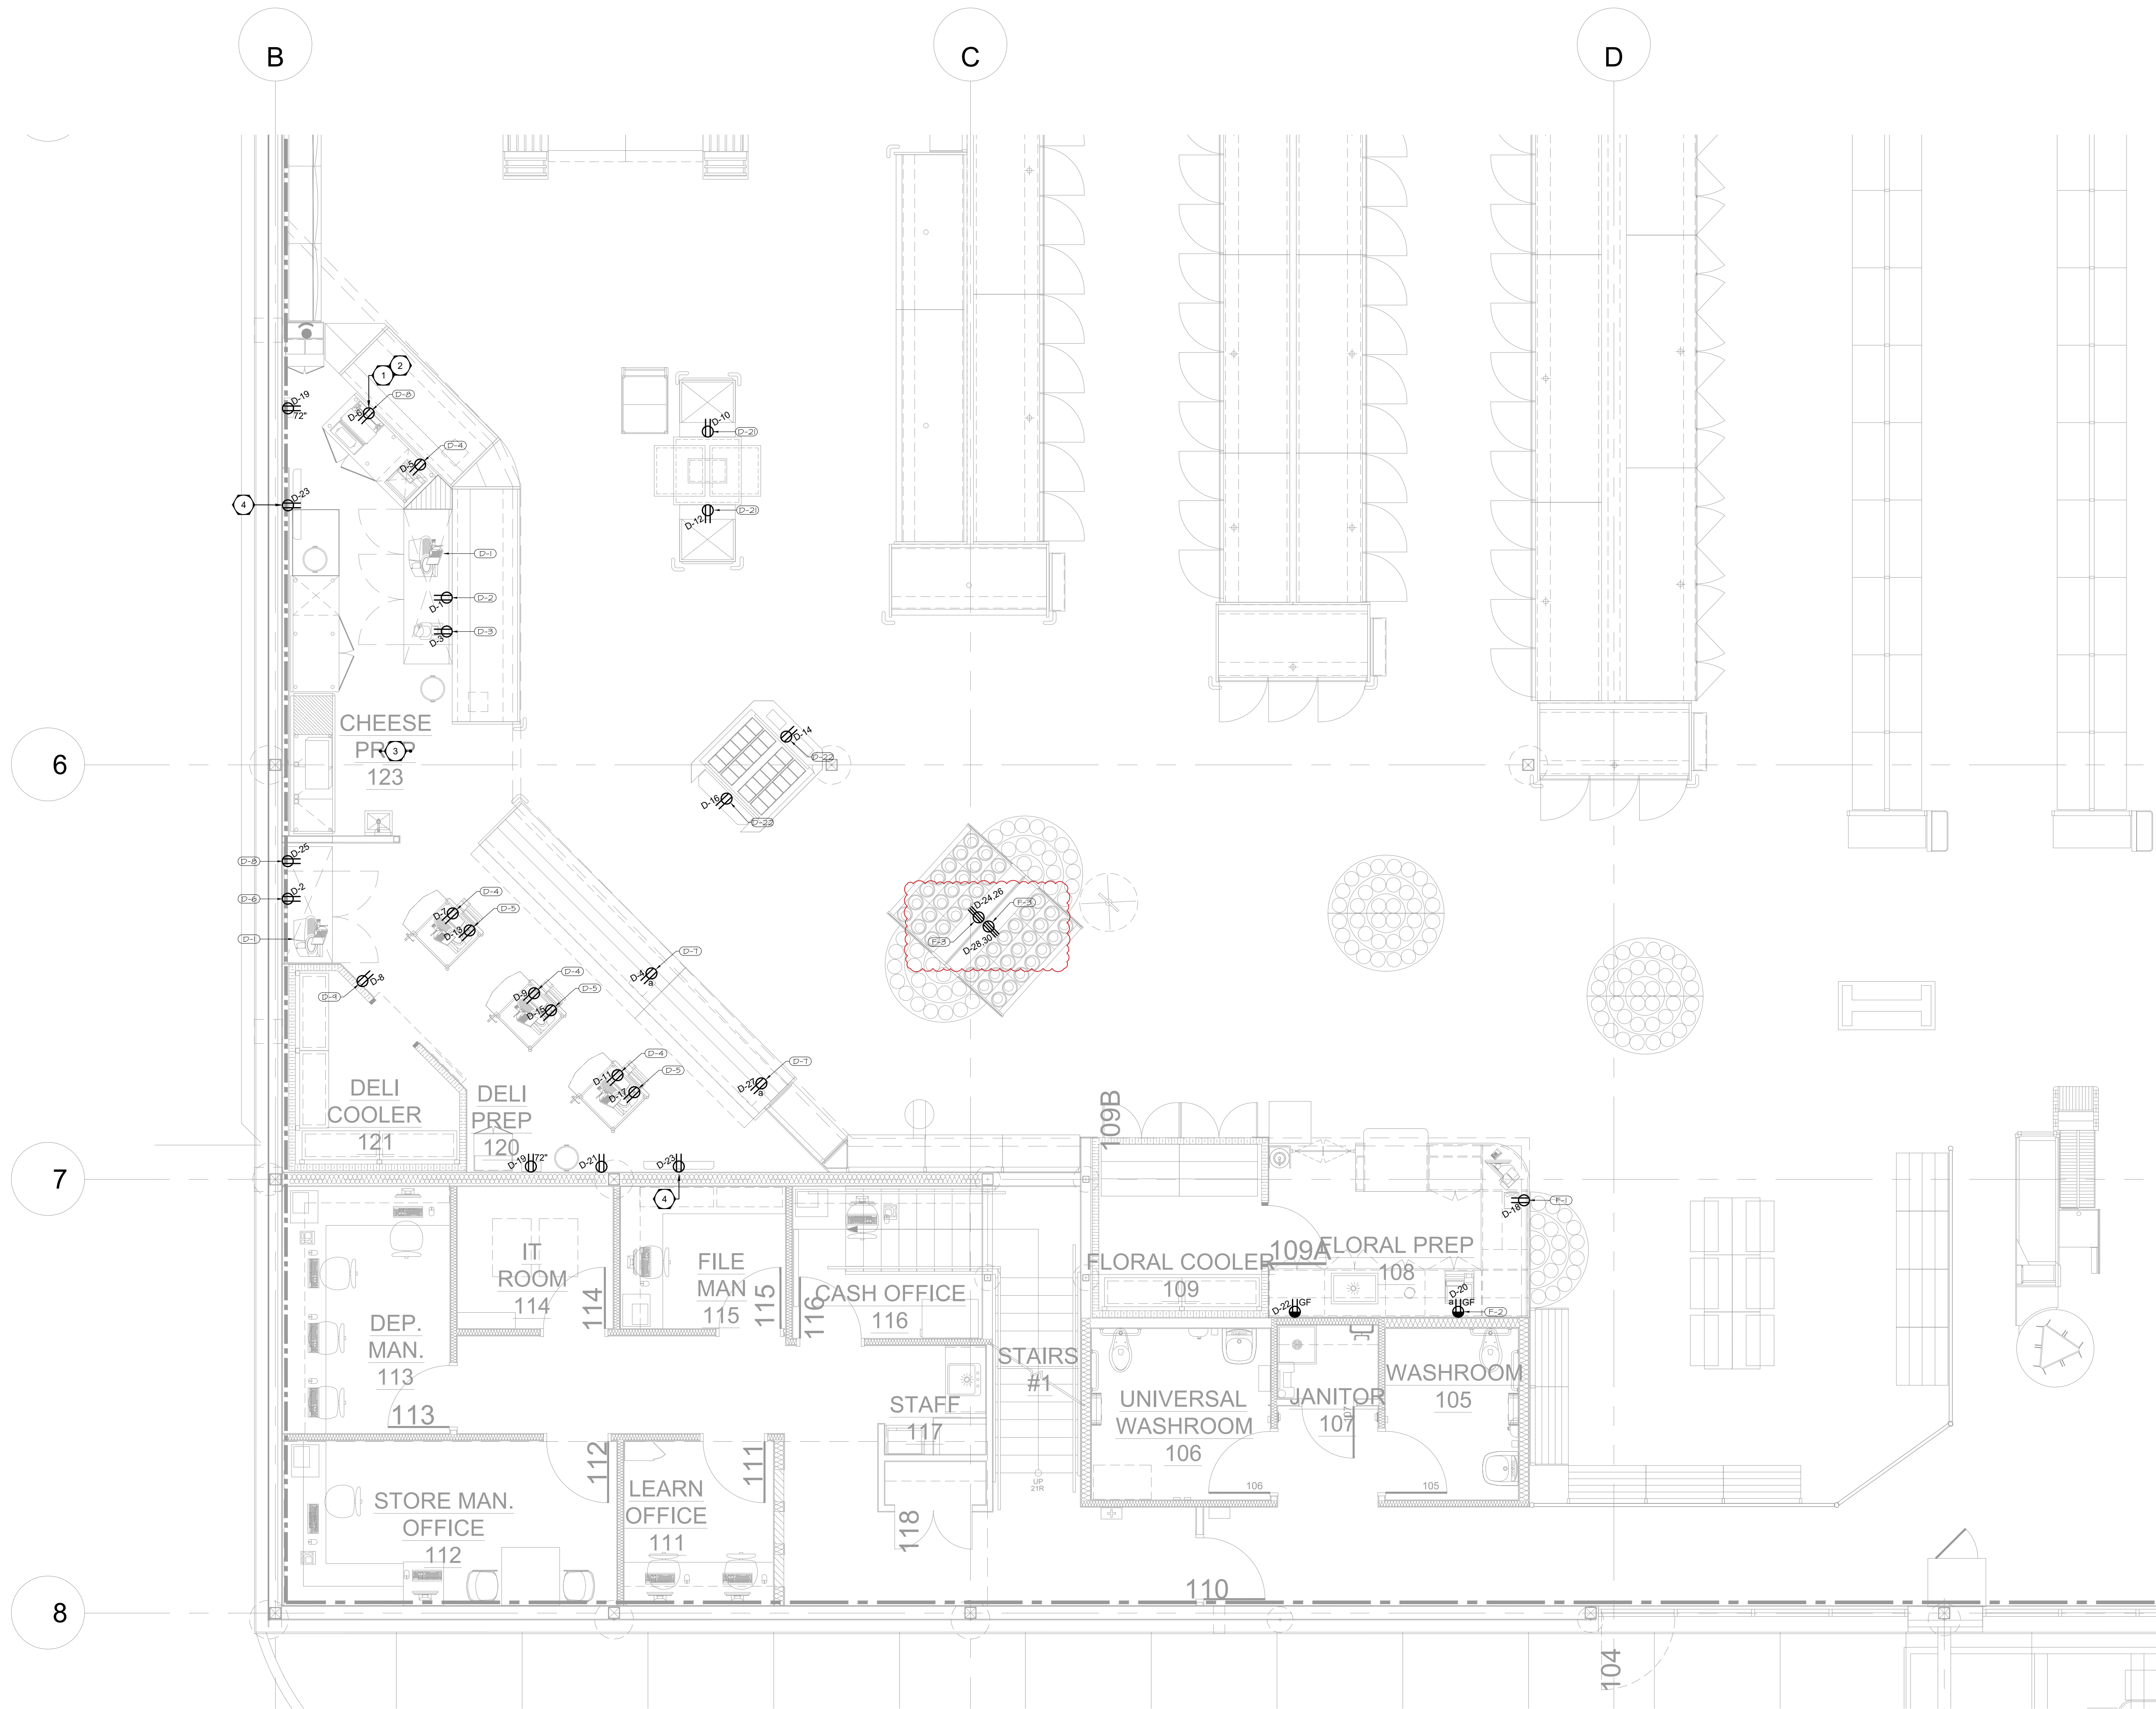

1 PARTIAL LAYOUT - POWER - DELI
SCALE: 1/4" = 1'-0"

DRAWING NOTES

1. PROVIDE PERMANENT TYPE WRITTEN LABEL ON ALL RECEPTACLES IDENTIFYING THE CIRCUIT NUMBER AND PANEL BOARD NAME TO WHERE IT IS CONNECTED.
2. VERIFY MOUNTING HEIGHT AND EXACT LOCATION OF RECEPTACLES AND SUB-UPS. COORDINATE WITH MILL WORK, MECHANICAL, AND REFRIGERATION CONTRACTOR, SUB TRADES AND SAFETY MANAGEMENT PRIOR TO ROUGH-IN.
3. COORDINATE FINAL LOCATION AND POWER / CONTROL REQUIREMENTS OF ALL EQUIPMENT IN VARIOUS DEPARTMENTS. COORDINATE WITH EQUIPMENT / FIXTURE SUPPLIERS AND MILLWORK AND MILLWORK INSTALLER PRIOR TO ROUGH-IN.
4. COORDINATE THE HEIGHT OF TV RECEPTACLES WITH DECOR DRAWINGS AND TV MOUNTING BRACKETS.

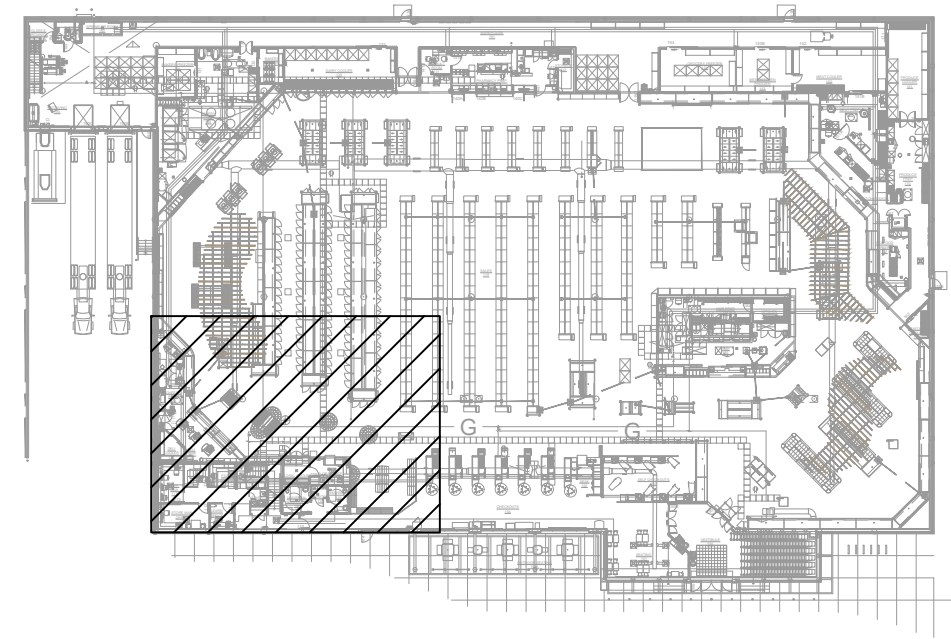

1 KEY PLAN
SCALE: 1/64" = 1'-0"

DELI / CHEESE PREP. AREA EQUIPMENT SCHEDULE

EQUIP. #	QTY	EQUIPMENT	CONDUCTORS (CU.)	VOLTS	LOAD	BREAKER
D-1	2	MANUAL SLICER	#12	-	MANUAL	-
D-2	1	8' REFRIGERATOR UIC UNIT	#12	120V-1PH	1.44 KW	15A-1P
D-3	1	CHEESE GRATER	#12	120V-1PH	560W	15A-1P
D-4	4	FIRMWARE SCALE	#12	120V-1PH	240W	15A-1P
D-5	3	SLICER "DELI BUDDY" SCALE	#12	120V-1PH	420W	15A-1P
D-6	1	8' REFRIGERATOR UIC UNIT	#12	120V-1PH	1.44 KW	15A-1P
D-7	1	SCALE AND PRINTER	#12	120V-1PH	240W	15A-1P
D-8	2	WRAPPER	#12	120V-1PH	725W	15A-1P
D-9	1	FOAMING STATION	#12	120V-1PH	200W	15A-1P
D-21	2	CHEESE DISPLAY	#12	120V-1PH	1.5 KW	20A-1P
D-22	2	OLIVE BAR	#12	120V-1PH	1.5 KW	20A-1P

- NOTES:
1. ELECTRICAL CONTRACTOR TO WIRE AND CONNECT ALL KITCHEN EQUIPMENT AS INDICATED. PROVIDE WIRING AND CIRCUIT BREAKERS TO FINAL NAMEPLATE OF THE EQUIPMENT.
 2. ELECTRICAL CONTRACTOR TO CONFIRM ALL EQUIPMENT LOADS, CIRCUIT SIZES, AND MOUNTING HEIGHTS PRIOR TO ROUGH-IN.
 3. ELECTRICAL CONTRACTOR TO PROVIDE ALL RELAYS & WIRING AND MAKE ALL CONNECTIONS FOR INTERLOCKING OF ALL EQUIPMENT AS REQUIRED. CONFIRM AND COORDINATE EXACT REQUIREMENTS ON SITE.
 4. ELECTRICAL CONTRACTOR TO PROVIDE ALL STARTERS AND DISCONNECT SWITCHES AS REQUIRED.
 5. ALL STARTERS ARE TO BE COMPLETE WITH OVERCURRENT PROTECTION.
 6. ELECTRICAL CONTRACTOR TO PROVIDE ALL LINE VOLTAGE CONTROL WIRING AS REQUIRED.
 7. PROVIDE A NEUTRAL WIRE FOR ALL EQUIPMENT.
 8. QUANTITIES ARE FOR UTILITIES INFORMATION ONLY TO DETERMINE LOADS. CONTRACTOR TO CONFIRM EXACT QUANTITIES AND LOCATIONS WITH THE APPROVED EQUIPMENT PACKAGE AND PLAN.

FLORAL PREP. AREA EQUIPMENT SCHEDULE

EQUIP. #	QTY	EQUIPMENT	CONDUCTORS (CU.)	VOLTS	LOAD	BREAKER
F-1	1	FLORAL CASH UNIT	#12	120V-1PH	360W	15A-1P
F-2	1	FLORAL WRAPPER	#12	120V-1PH	725W	15A-1P
F-3	2	REFRIGERATED FLORAL CASES	#12	208V-1PH	16.5A	20A-2P

- NOTES:
1. ELECTRICAL CONTRACTOR TO WIRE AND CONNECT ALL KITCHEN EQUIPMENT AS INDICATED. PROVIDE WIRING AND CIRCUIT BREAKERS TO FINAL NAMEPLATE OF THE EQUIPMENT.
 2. ELECTRICAL CONTRACTOR TO CONFIRM ALL EQUIPMENT LOADS, CIRCUIT SIZES, AND MOUNTING HEIGHTS PRIOR TO ROUGH-IN.
 3. ELECTRICAL CONTRACTOR TO PROVIDE ALL RELAYS & WIRING AND MAKE ALL CONNECTIONS FOR INTERLOCKING OF ALL EQUIPMENT AS REQUIRED. CONFIRM AND COORDINATE EXACT REQUIREMENTS ON SITE.
 4. ELECTRICAL CONTRACTOR TO PROVIDE ALL STARTERS AND DISCONNECT SWITCHES AS REQUIRED.
 5. ALL STARTERS ARE TO BE COMPLETE WITH OVERCURRENT PROTECTION.
 6. ELECTRICAL CONTRACTOR TO PROVIDE ALL LINE VOLTAGE CONTROL WIRING AS REQUIRED.
 7. PROVIDE A NEUTRAL WIRE FOR ALL EQUIPMENT.
 8. QUANTITIES ARE FOR UTILITIES INFORMATION ONLY TO DETERMINE LOADS. CONTRACTOR TO CONFIRM EXACT QUANTITIES AND LOCATIONS WITH THE APPROVED EQUIPMENT PACKAGE AND PLAN.

3	PCN-10	2025.07.23	KC
2	PCN-09	2025.06.25	KC
1	PCN-08	2025.06.13	KC
No. ISSUED FOR		DATE	BY
DRAWN BY:		BS	
PRINTING DATE: JULY 23, 2025			