

No work is to be done before this matter is finalized and a "Change Order" is issued. This copy to remain with your office. Do not return. Contractor to submit signed letter with price including cost breakdown and change (if any) to construction schedule. Authority having Jurisdiction shall advise of any objections.

TO: QUOREX CONSTRUCTION SERVICES LTD.
1630A 8th Avenue,
Regina, SK S4R 1E5

RE: AURORA FOOD STORE
2000 ANAQUOD ROAD
REGINA, SK
Commission No. 2445

DATE: August 13, 2025

PAGES: 4 (including cover)


RE: Baler, Compactor & Power Pack (Fixture Plan R04)

1.0 ELECTRICAL

- .1 Refer to attached Electrical PCN #12, dated August 11, 2025 (2 pages).

2.0 FIXTURE PLAN

- .1 Replace Fixture Plan with attached FP.R05 dated August 7, 2025 (1 page).
Refer to noted revisions for FP.R04 dated July 23, 2025:

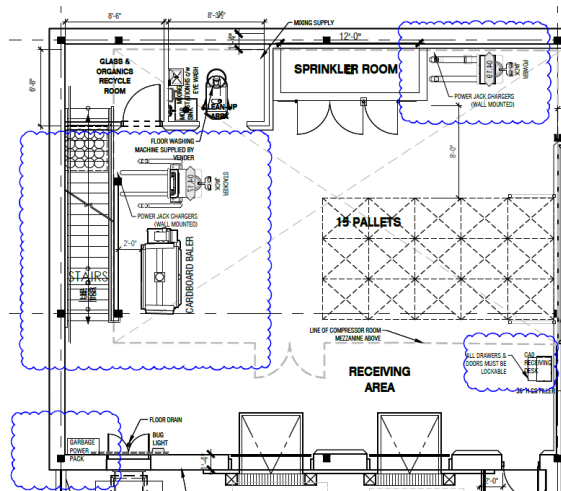

Distribution:

Sobeys Inc. – Jeff Craig
Sobeys Inc. – Shanwen Hsu
Quorex Construction Services Ltd. – Chris Walbaum
Quorex Construction Services Ltd. – Dustin Williamson
Lavergne Draward & Associates Inc. – Charles Koop
CGM Engineering – Justin Albo
CGM Engineering – Tony Mitousis
CGM Engineering – Brendan Simpson

jeff.craig@sobeys.com
shanwen.hsu@sobeys.com
c.walbaum@quorex.ca
d.williamson@quorex.ca
ckoop@ldaeng.ca
justin_albo@cgmeng.ca
tony_mitousis@cgmeng.ca
brendan_simpson@cgmeng.ca



Kevin Fawley

Principal
Kevin Fawley, SAA MRAIC

Project: Aurora Grocery Store
2000 Anaquod Road, Regina, Saskatchewan
Subject: Receiving 190 Equipment Revisions
Date: 2025.08.11

Subject: Receiving 190 Equipment Revisions
References: Electrical Drawing E2.0 – Floor Plan - Power

1. Refer to attached drawing E2.0 for the relocation of the following equipment.
 - 1.1. Compactor within 'Receiving 190'.
 - 1.2. Baler within 'Receiving 190'.
 - 1.3. Two(2) power jack charger receptacles within 'Receiving 190'.
2. Provide one(1) receptacle for power and one(1) data outlet to the CAO receiving desk within 'Receiving 190'. Wire and connect receptacle to circuit 'C1-22'.
 - 2.1. One(1) housekeeping receptacle is shifted ~7' to make room for the CAO receiving desk. Refer to attached drawing E2.0.

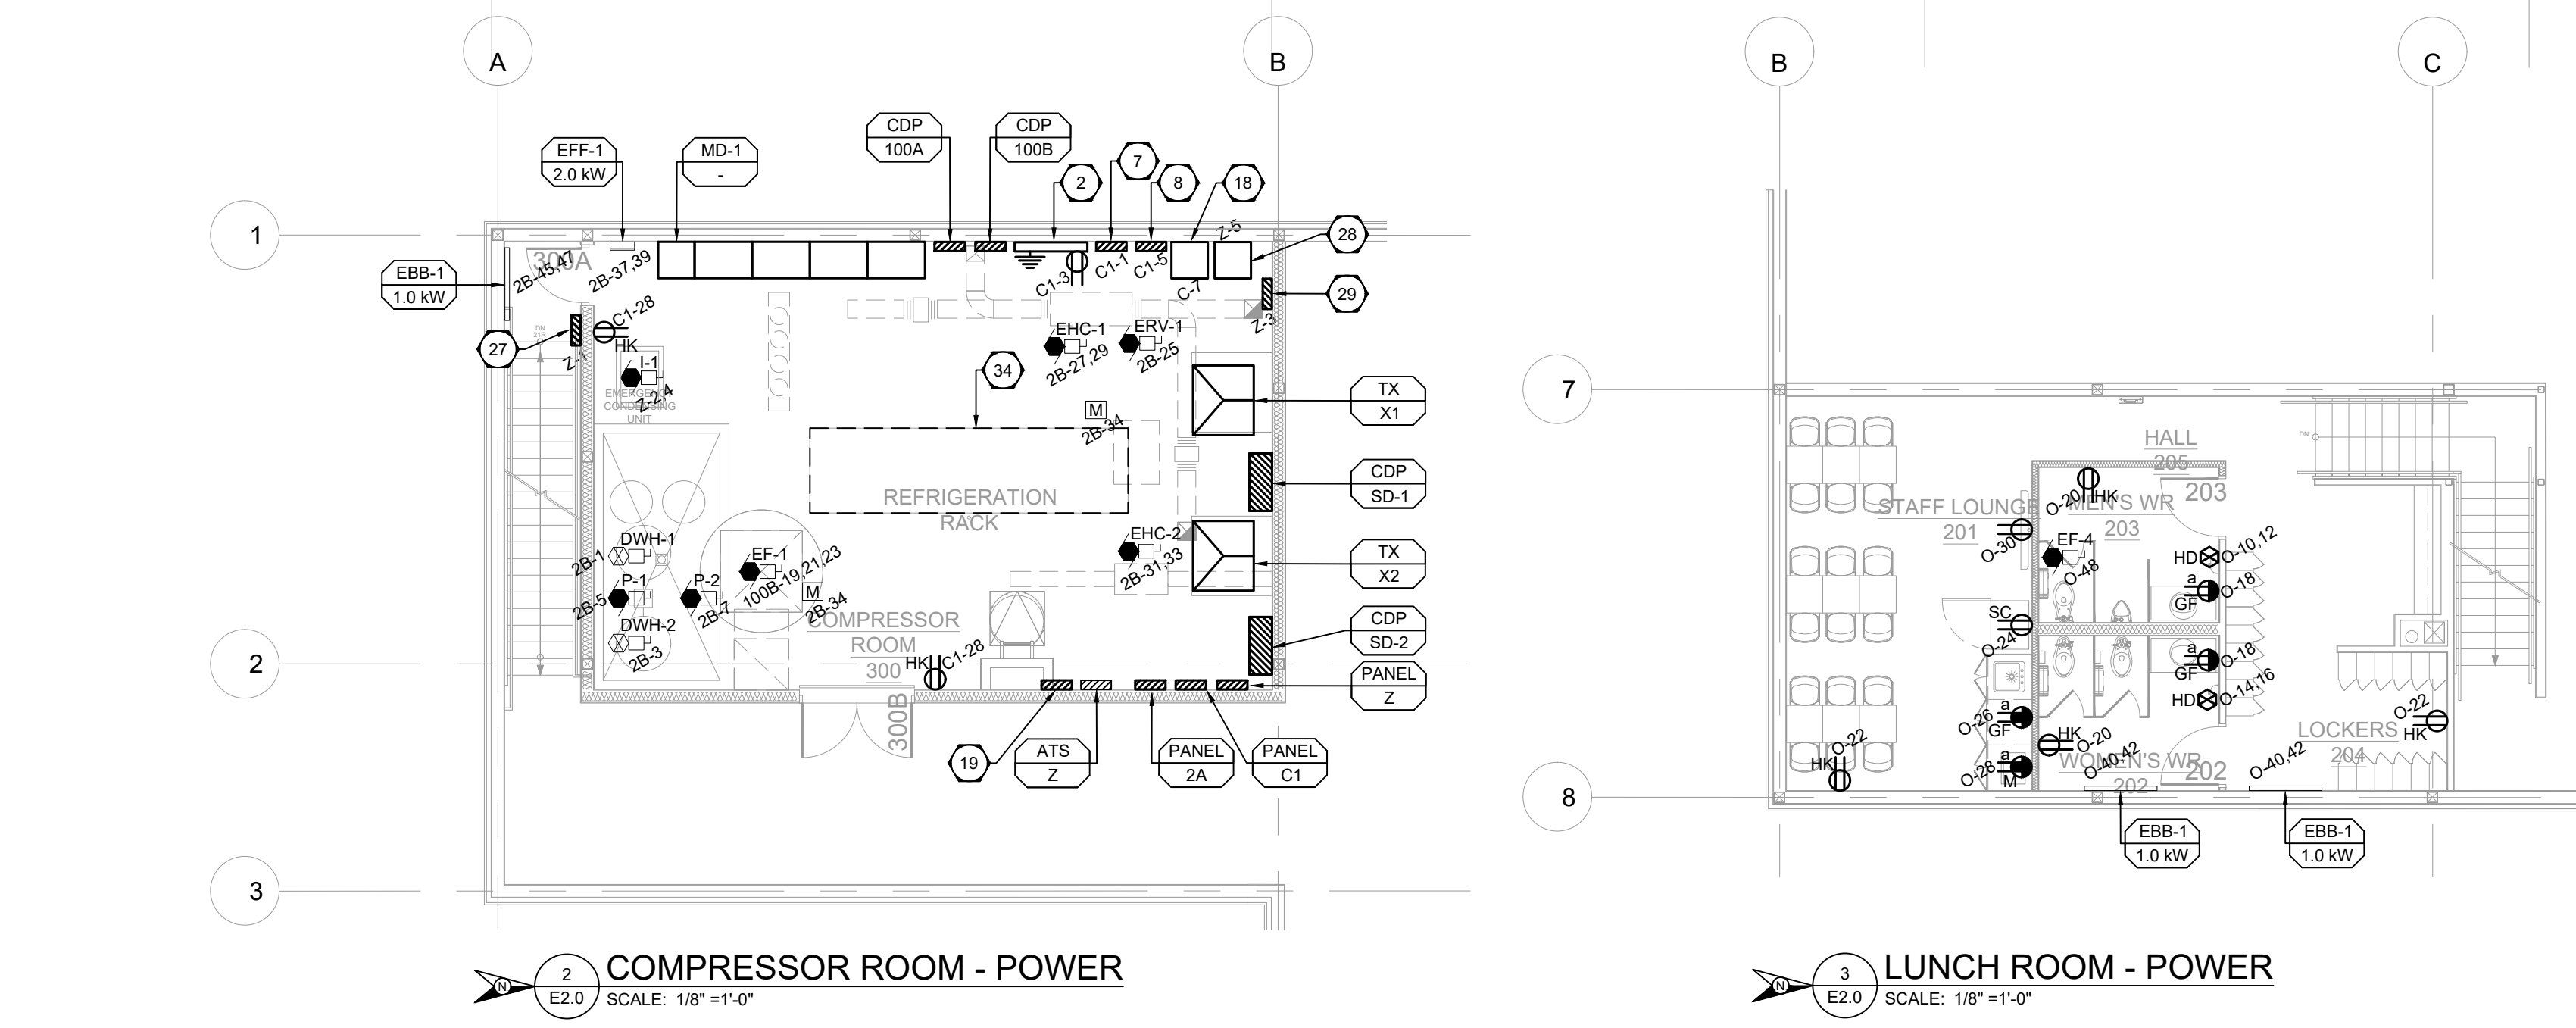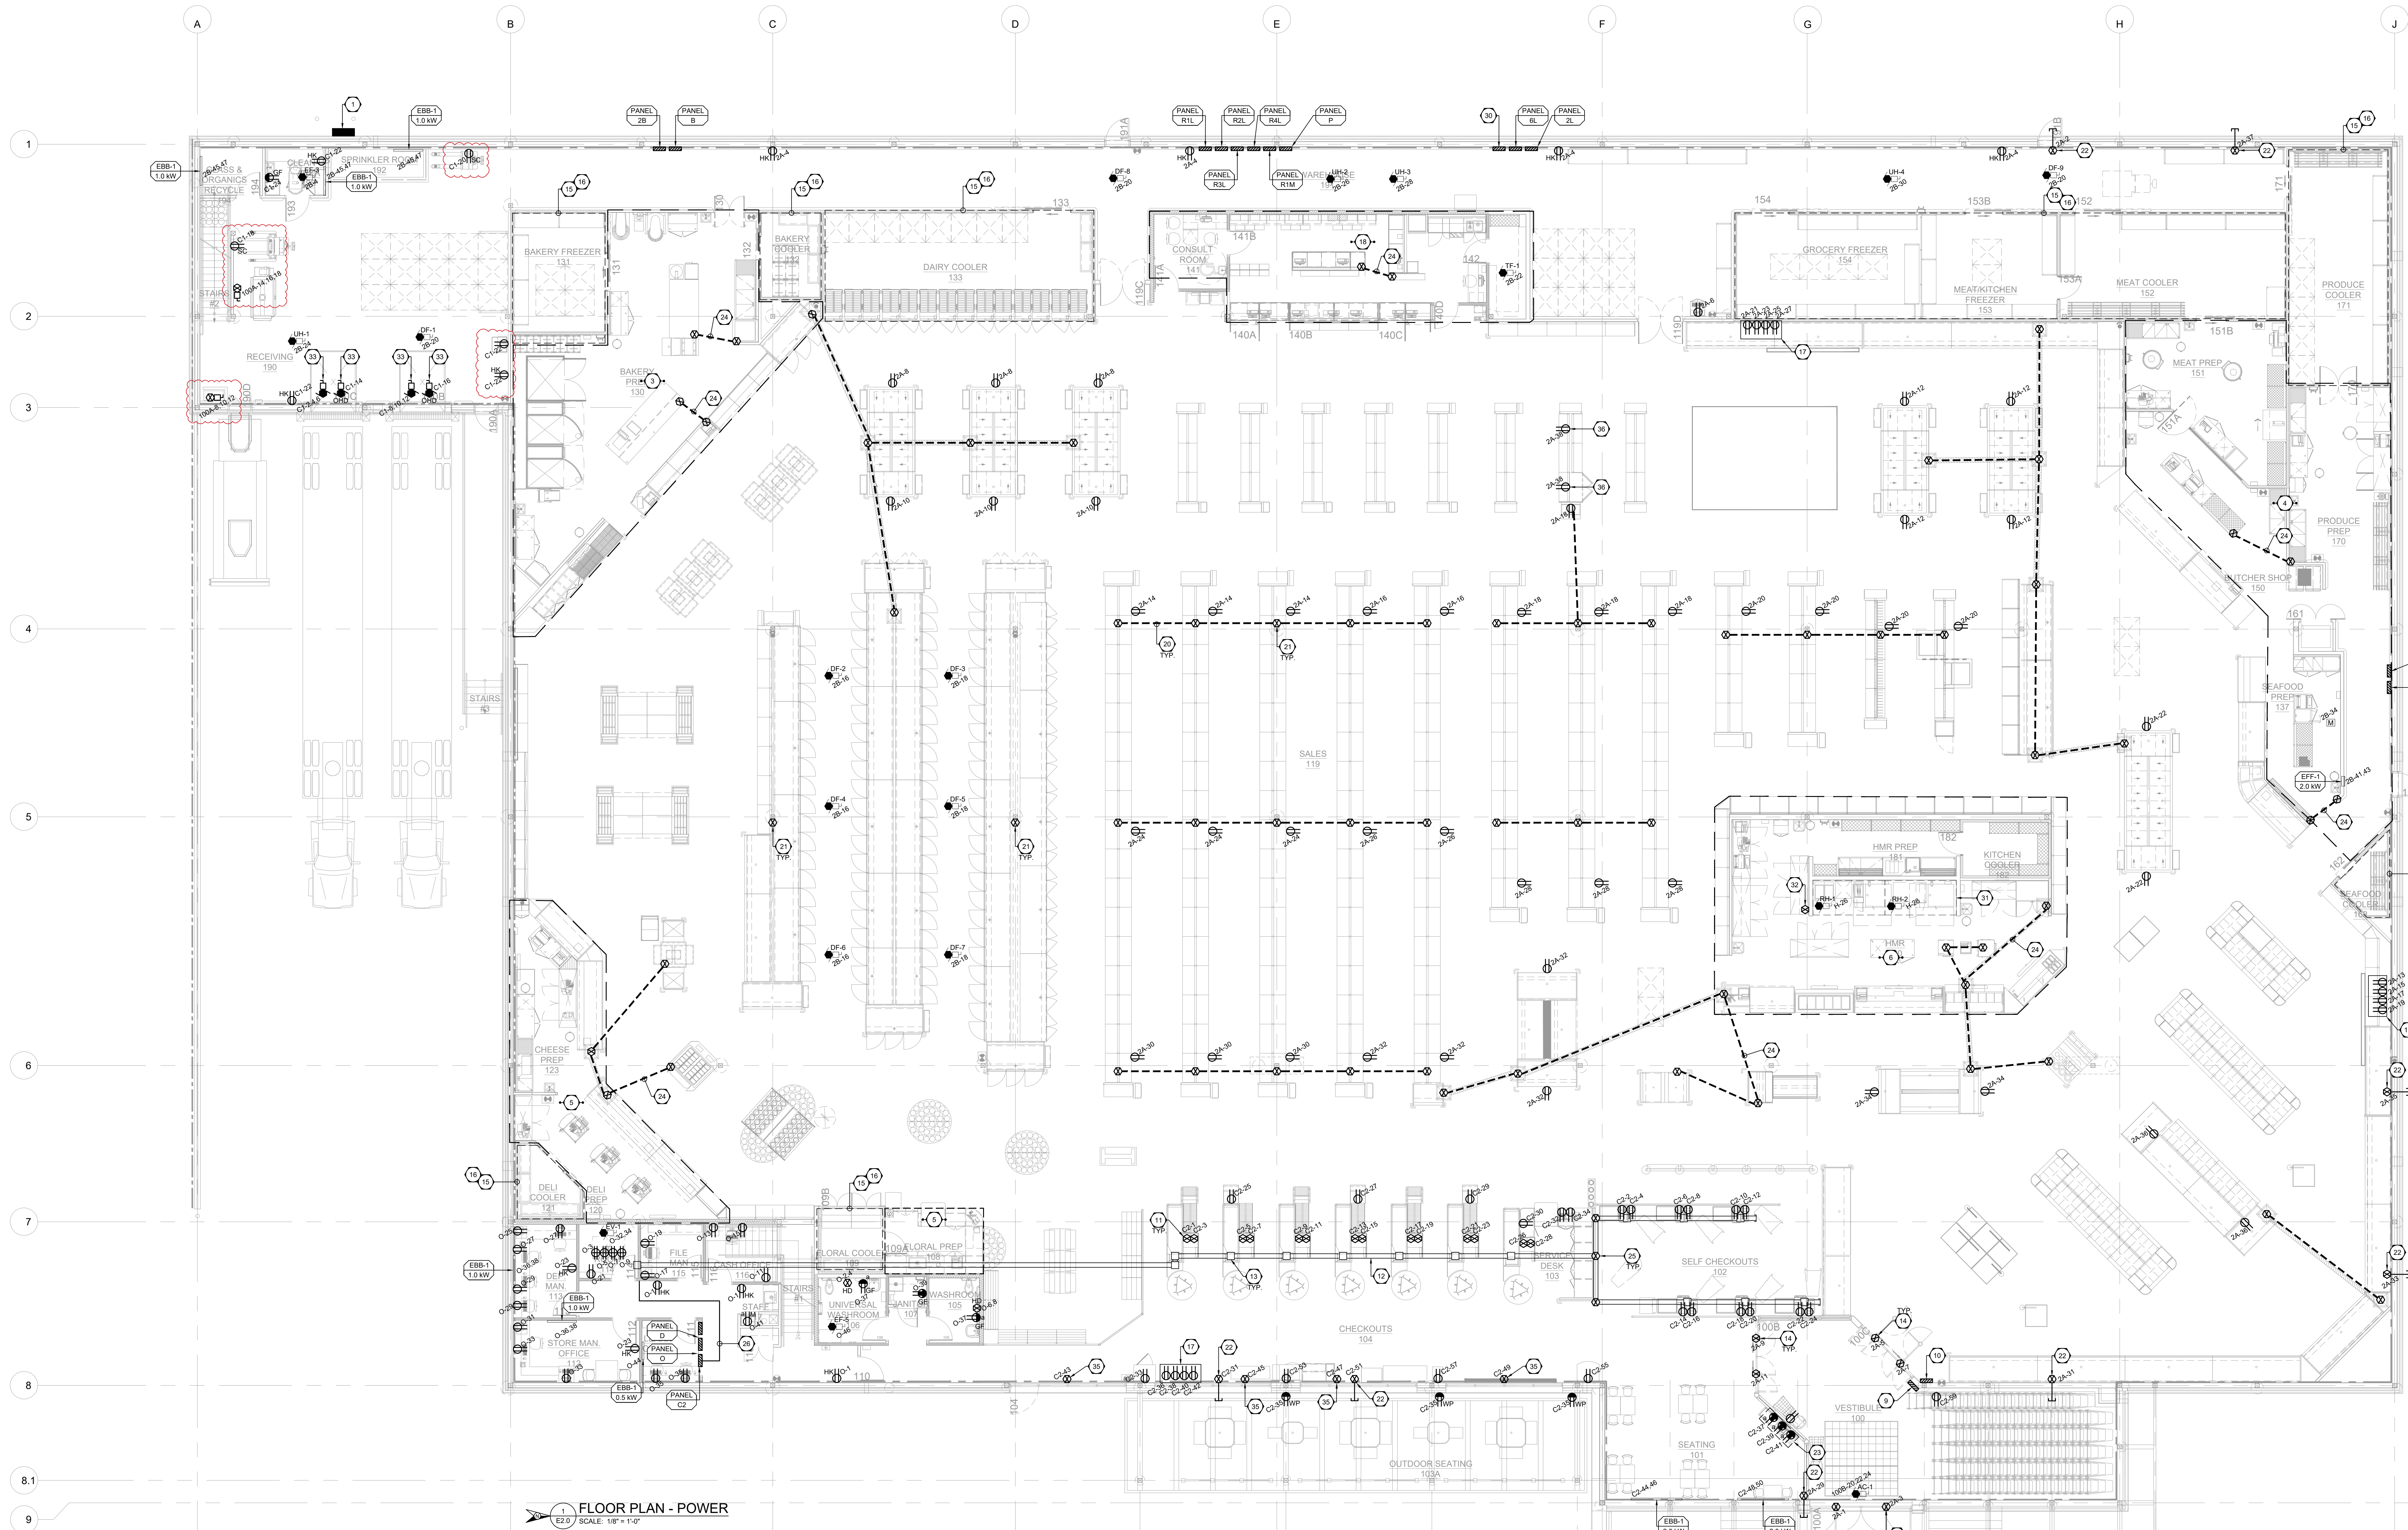

- GENERAL NOTES**
- COORDINATE WITH G.C. AND OTHER SUBTRADES AND MINIMIZE OR ELIMINATE CONDUIT DROPS TO MAINTAIN THE OVERALL AESTHETIC APPEARANCE OF THE AREA.
 - UNDERGROUND CONDUITS TO BE ROUTED CLEAR OF ALL WALK-IN BOX DOORS. VERIFY CLEARANCE REQUIREMENTS WITH COOLER/FREEZER ARCHITECTURAL DRAWINGS.
 - INSTALL OUTLETS AT PREPARATION AREA HORIZONTALLY AND AS HIGH AS PRACTICAL TO CLEAR SINK, COUNTER OR TABLE BACKSPASH.
 - PROVIDE 2-1/2" DIAMETER SPARE STUB-OUT TO ALL PANELS TO CEILING FOR FUTURE USE. SEAL AND CAP THE CONDUIT.
 - ALL EXPOSED ELECTRICAL CONDUITS IN OPEN CEILING AREAS TO BE MOUNTED AS CLOSE AS POSSIBLE TO THE UNDERSIDE OF ROOF BEAM.
 - UNLESS OTHERWISE APPROVED BY OWNER AND ARCHITECT, ALL OUTLETS IN THE REAR STORAGE AREA, LOADING DOCK, AND PRODUCE WORK AREA LOCATED BELOW 18'-0" SHALL BE FLUSH MOUNTED. CONCEAL CONDUIT IN WALL. REFER TO ARCHITECTURAL DRAWINGS FOR WALL TYPES AND FINISHES.
 - SEAL CONDUITS WHERE PASSING THROUGH FLOOR, EXTERIOR WALLS, CEILING, COOLERS, FREEZERS AND MEAT ROOM.
 - SITE VERIFY MOUNTING HEIGHT AND EXACT LOCATION OF ALL OUTLETS PRIOR TO ROUGH-IN. ELECTRICAL CONTRACTOR TO PROVIDE RECEIPTABLES TO MATCH FLUG TYPE OF EQUIPMENT. PROVIDE DIRECT CONNECTIONS TO EQUIPMENT WITH CONNECTION BOXES OR TERMINALS. REFER TO MILLWORK DRAWINGS AND FIXTURE CUTSHEETS.
 - COORDINATE LOCATIONS AND MOUNTING OF ALL CHECKOUT OUTLETS WITH MILLWORK CONTRACTOR ON SITE DURING CONSTRUCTION. ALL CONNECTIONS ARE TO BE ACCESSED FROM UNDERNEATH.
 - ALL CONDUIT AND WIRING IN MEAT COOLER BOX AND MEAT PREP AREA SHALL BE CONCEALED. SURFACE RUN IS NOT ACCEPTABLE.
 - ALL RECEIPTABLES AND WIRING METHODS WITHIN COOLERS, FREEZERS, SEAFOOD PREP, MEAT PREP, AND PRODUCE PREP AREAS SHALL BE IN ACCORDANCE WITH CEC RULES 22-18 AND 22-200 RESPECTIVELY (CATEGORY 1 LOCATION).
 - ALL CONDUIT IN SALES AREA COLUMNS MUST BE MOUNTED ON THE BACKSIDE (FACING REAR OF STORE). REFER TO ARCHITECTURAL DRAWINGS FOR LOCATIONS OF FURRING FOR COLUMNS.
 - ENSURE THERE ARE NO CONDUIT/WIRING RUNS LOCATED BENEATH OVENS, PROOFERS AND FREEZERS.
 - ALL WIRING FOR OUTLETS AND DEVICES LOCATED ON PERIMETER BUILDINGS WALLS SHALL BE RUN CONCEALED WHERE VISIBLE TO THE PUBLIC. COORDINATE WITH GENERAL CONTRACTOR.
 - VERIFY EXACT LOCATION OF ALL STUB-UP LOCATIONS WITH OWNER'S REPRESENTATIVE. REFRIGERATION CONTRACTOR AND FIXTURE/EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN.
 - COORDINATE FINAL EQUIPMENT LOCATIONS WITH MECHANICAL PRIOR TO ROUGH-IN.

7	PCN-12	2025.08.11	KC
7	PCN-14	2025.08.01	KC
6	PCN-13	2025.07.31	KC
5	PCN-12	2025.07.23	KC
4	PCN-11	2025.07.23	KC
3	PCN-10	2025.07.23	KC
2	PCN-09	2025.06.25	KC
1	PCN-08	2025.06.13	KC
No. ISSUED FOR		DATE	BY
DRAWN BY: BS			
PRINTING DATE: AUGUST 11, 2025			

Drawings and specifications, as instruments of service are the property of the Architect. The copyright in the same being reserved for him. No reproduction may be made without the permission of the architect, and when made, must bear their name. All prints to be retained.

PROJECT TITLE:

AURORA GROCERY STORE
2000 ANAQUOD ROAD
REGINA, SASKATCHEWAN

SHEET TITLE:
FLOOR PLAN - POWER
COMMISSION NUMBER:
2445
SHEET NUMBER:
E2.0

DRAWING NOTES - POWER

- SERVICE ENTRANCE SPLITTER. COORDINATE LOCATION AND CONFIRM EXACT REQUIREMENTS WITH SASKPOWER ON SITE.
- MAIN TELECOM DEMARCATION BACKBOARD.
- REFER TO DRAWING E2.1 FOR ENLARGED DELI POWER DRAWINGS.
- REFER TO DRAWING E2.2 FOR ENLARGED BAKERY AND PHARMACY POWER DRAWINGS.
- REFER TO DRAWINGS E2.3 FOR ENLARGED SEAFOOD, MEATS AND PRODUCE POWER DRAWINGS.
- REFER TO DRAWINGS E2.4 FOR ENLARGED HMR POWER DRAWINGS.
- FIRE ALARM CONTROL PANEL. PROVIDE A DEDICATED CIRCUIT. CIRCUIT BREAKER TO BE PAINTED RED. LABELLED "FIRE ALARM PANEL". BE LOCKED.
- SECURITY SYSTEM HEAD-END PANEL.
- FIRE ALARM ANNUNCIATOR PANEL. C/W MULTILINE DIGITAL DISPLAY INTERFACE. PANEL TO BE SURFACE MOUNTED.

- SECURITY GATE CONTROLLER PANEL. PROVIDE POWER INCLUDING NECESSARY CONTROL WIRING. COORDINATE WITH SECURITY GATE SUPPLIER.
- FOR EACH CHECKOUT STATION, PROVIDE ONE DEDICATED CIRCUIT TO THE UPS AND ONE DEDICATED CIRCUIT FOR THE CONVEYOR BELT, COURTESY RECEPTACLE AND MISCELLANEOUS RECEPTACLE.
- PROVIDE AN UNDER-FLOOR WALKER/DRIFT SYSTEM COMPLETE WITH ALL NECESSARY DUCTS, FITTINGS, SUPPORTS, BOXES AND OTHER REQUIRED ACCESSORIES IN COMPLIANCE WITH PROJECT SPECIFICATIONS AND MANUFACTURER'S RECOMMENDATIONS. ALIGN FLOOR DUCTS AND LOCATE AFTERSETS INCLUDING ALL ASSOCIATED FITTINGS/ACCESSORIES IN ACCESSIBLE AREA WITHIN THE DESIGNATED PRIMARY STUBBING AREA OF THE CHECKOUTS. COORDINATE WITH MILLWORK CONTRACTOR. CHECKOUT COUNTER SUPPLIER, ARCHITECTURAL AND STRUCTURAL PRIOR TO ROUGH-IN.
- PROVIDE UNDER FLOOR WALKER/DRIFT AFTERSETS OF SPECIFIED SIZE (240 AND 140) TO FACILITATE POWER AND COMMUNICATION FEED TO CUSTOMER CHECK STANDS, SELF CHECK-OUT AND SERVICE DESK COMPLETE WITH REQUIRED JUNCTION BOXES, CONDUITS AND FITTINGS.
- PROVIDE CONDUIT, WIRING AND CONNECTIONS FROM JUNCTION BOX FOR AUTOMATIC DOORS UP TO RESPECTIVE PANEL. COORDINATE WITH DOOR HARDWARE SUPPLIER AND ARCHITECTURAL.

- PROVIDE PATHWAYS, CIRCUIT WIRING AND CONNECTIONS TO ACCESS CONTROL SYSTEM. E.C. IS RESPONSIBLE FOR ALL LOW VOLTAGE WIRING BETWEEN SYSTEM DEVICES AND REQUIRED CONNECTIONS TO THE DOOR HARDWARE FOR A COMPLETE AND OPERATION SYSTEM. COORDINATE WITH GENERAL CONTRACTOR AND SUPPLIER. PROVIDE WIRING METHODS, FIXTURES AND DEVICES TO SUIT.
- AREA TO BE CONSIDERED A CATEGORY 1 LOCATION AS PER C.E.C. SECTION 22-002. PROVIDE WIRING METHODS, FIXTURES AND DEVICES TO SUIT.
- BILLBOARD RECEPTABLES TO BE RECESSED INTO WALL STRUCTURE BY MINIMUM 50mm. COORDINATE WITH DECOR AND ARCHITECTURAL DRAWINGS FOR FINAL MOUNTING HEIGHT AND LOCATIONS.
- DATA RACK. CONFIRM EXACT REQUIREMENTS WITH SOBEYS I.T. DEPARTMENT.
- SITE LIGHTING PANEL. PROVIDED AND INSTALLED BY OTHERS. COORDINATE EXACT REQUIREMENTS WITH GC ON SITE.
- PROVIDE 1" DIAMETER CONDUIT FROM STRUCTURAL COLUMN TO INDICATED CONDUIT. PRIOR TO CONCRETE POURING. EXAMINE SITE AND CONFIRM ROUTING OF CONDUIT WITH GC AND ALL ASSOCIATED TRADES.
- INSTALL JUNCTION BOX EITHER UNDER THE SHELVES (SPACE PERMITTING) OR AT THE INTERNAL LOWER MOST PART OF SHELVING. POWER TO RUN DOWN STRUCTURAL COLUMN AS NEEDED. TYPICAL.

- PROVIDE DEDICATED 10A CIRCUIT FOR EXTERIOR SIGNS. COORDINATE WITH ARCHITECT AND SIGN PROVIDER TO DETERMINE EXACT LOCATION AND ELECTRICAL REQUIREMENTS FOR SIGNS.
- CONFIRM MOUNTING HEIGHT OF RECEPTABLES IN DASHED AREA. COORDINATE WITH GENERAL CONTRACTOR AND ISLAND SUPPLIER.
- PROVIDE 1" DIAMETER CONDUIT AS INDICATED. PRIOR TO CONCRETE POURING. EXAMINE SITE AND CONFIRM ROUTING OF CONDUIT WITH GC AND ALL ASSOCIATED TRADES.
- PROVIDE UNDER FLOOR JUNCTION BOX COMPLETE WITH CONDUIT HUB FOR POWER, VOICEDATA AND SECURITY SYSTEM CABLE DISTRIBUTION TO SELF CHECKOUTS. SELF CHECKOUTS AND SERVICE DESK. UNDER FLOOR JUNCTION BOXES TO BE C/W NECESSARY DUCTS, CONDUITS, FITTINGS AND PANEL CONNECTORS TO CONNECT THE FLOOR DUCT SYSTEM TO CORRESPONDING ELECTRICAL PANELS.
- RUN POWER AS NOTED FOR CHECKOUTS IN CONDUIT AND IN CEILING. POWER TO DROP DOWN IT ROOM 112 WALL AND INTO WALK OUT AS REQUIRED.
- LEAK DETECTOR PANEL. COORDINATE EXACT REQUIREMENTS WITH MICRO THERMO ON SITE.
- EMS SYSTEM PC CABINET. COORDINATE EXACT REQUIREMENTS WITH MICRO THERMO ON SITE.
- EMS SYSTEM PANEL. COORDINATE EXACT REQUIREMENTS WITH MICRO THERMO ON SITE.

- EMS SYSTEM LIGHTING CONTROL PANEL. REFER TO DRAWING E7.0 FOR DETAILS.
- WIRE AND CONNECT FIRE SUPPRESSION SYSTEM FOR COOKING LINE HOOD. INTERCONNECT WITH FIRE ALARM SYSTEM TO ACTIVATE A FIRE CONDITION UPON ACTIVATION OF FIRE SUPPRESSION SYSTEM. ALL ELECTRICAL BELOW HOOD TO BE ENERGIZED UPON FIRE SUPPRESSION DISCHARGE.
- PROVIDE RED SHUT OFF BUTTON AND LAMACOID LABEL AS PER C.E.C. 26-750 TO DE-ENERGIZE EXHAUST FANS ASSOCIATED WITH HOOD. CONFIRM EXACT LOCATION ON SITE. REFER TO MANUFACTURER'S LITERATURE.
- PROVIDE JUNCTION BOX, CONDUIT, WIRING AND CONNECTION FOR COMPACTOR, DOCK LEVELER, AND OVERHEAD DOOR TO RESPECTIVE PANEL TO SUIT TARRANT FIT UP REQUIREMENTS.
- COMPRESSOR RACK. WIRE AND CONNECT AS REQUIRED.
- WIRE AND CONNECT ROOF WINDOW SHADES C/W MANUAL CONTROL SWITCH AS REQUIRED. REFER TO SOBEYS MASTER SPECIFICATION FOR DETAILS.
- RECEPTABLES FOR SHELVING LIGHT BOX. RECEPTACLE TO BE MOUNTED BEHIND LIGHT BOX. CONFIRM EXACT REQUIREMENTS WITH MANUFACTURER'S LITERATURE AND RACHELLE BERY DESIGN PACKAGE.



FP	R05
----	-----