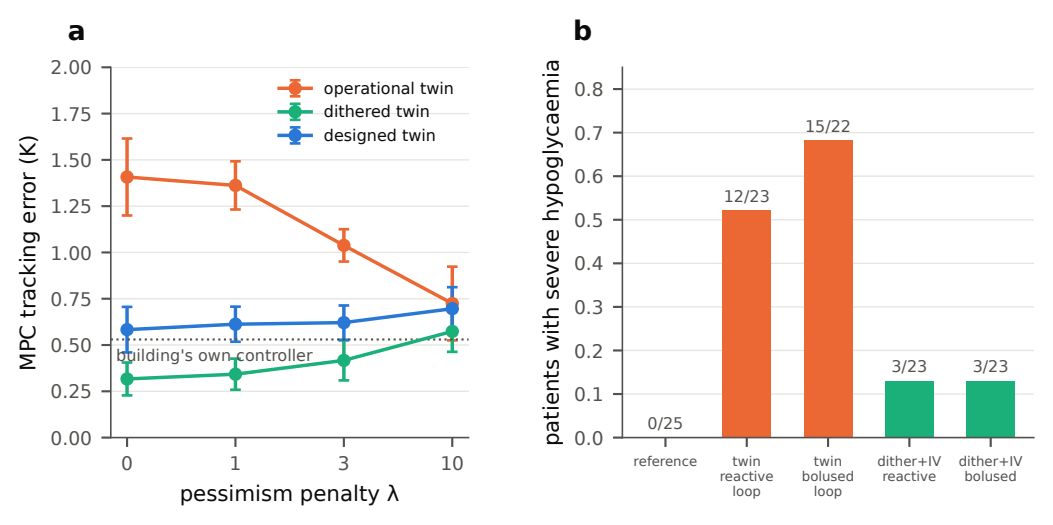
a
MPC tracking error (K)
2.00
1.75
1.50
1.25
1.00
0.75
0.50
0.25
0.00
operational twin
dithered twin
designed twin
building's own controller
0
1
3
10
pessimism penalty λ
b
patients with severe hypoglycaemia
0.8
0.7
0.6
0.5
0.4
0.3
0.2
0.1
0.0
0/25
12/23
15/22
3/23
3/23
reference
twin reactive loop
twin bolused loop
dither+IV reactive
dither+IV bolused