



0.0 0.1 0.25 0.5


Pending Demand

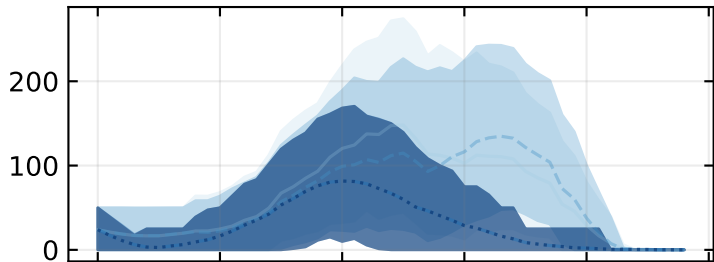

Battery Stored Energy

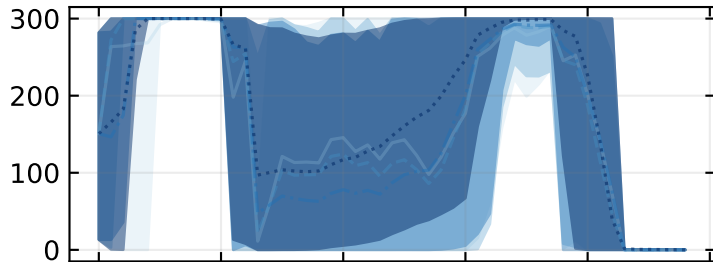

Grid Purchased Energy

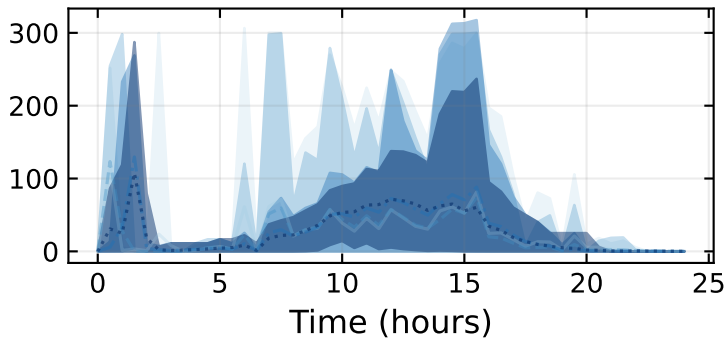

Interval Cost

