





BUILDING SECTION
SCALE: 1/8" = 1'-0"

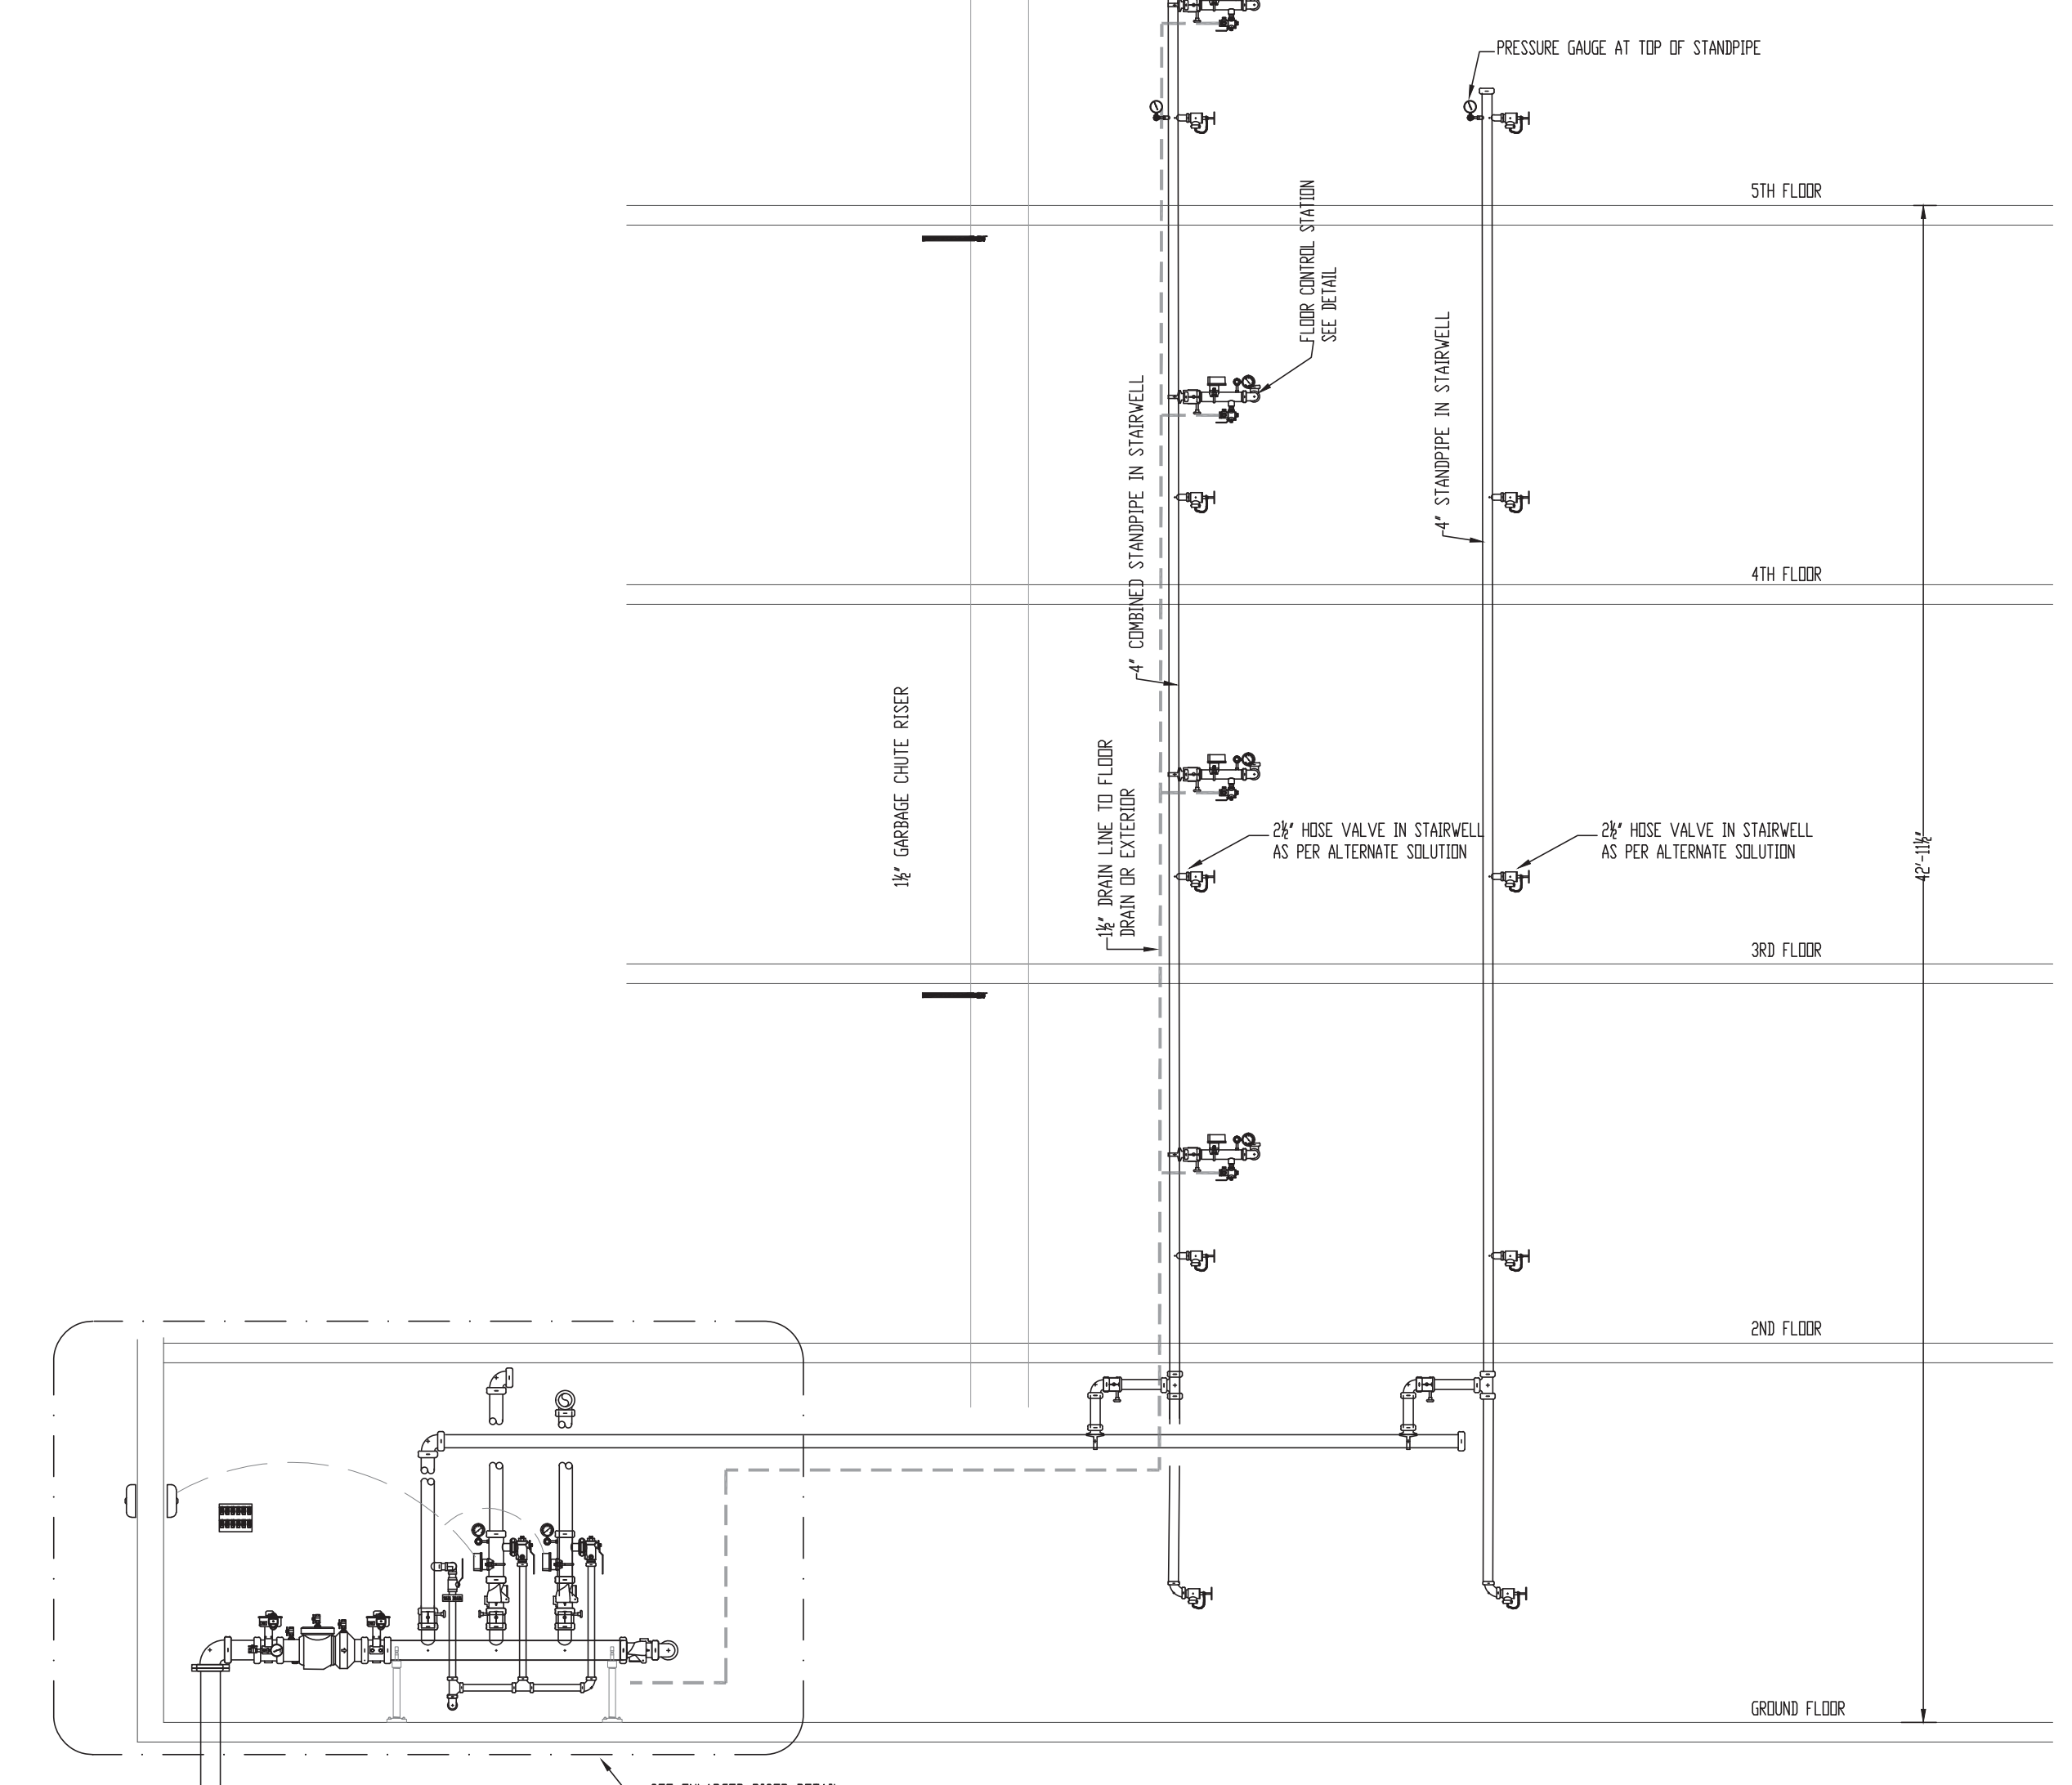

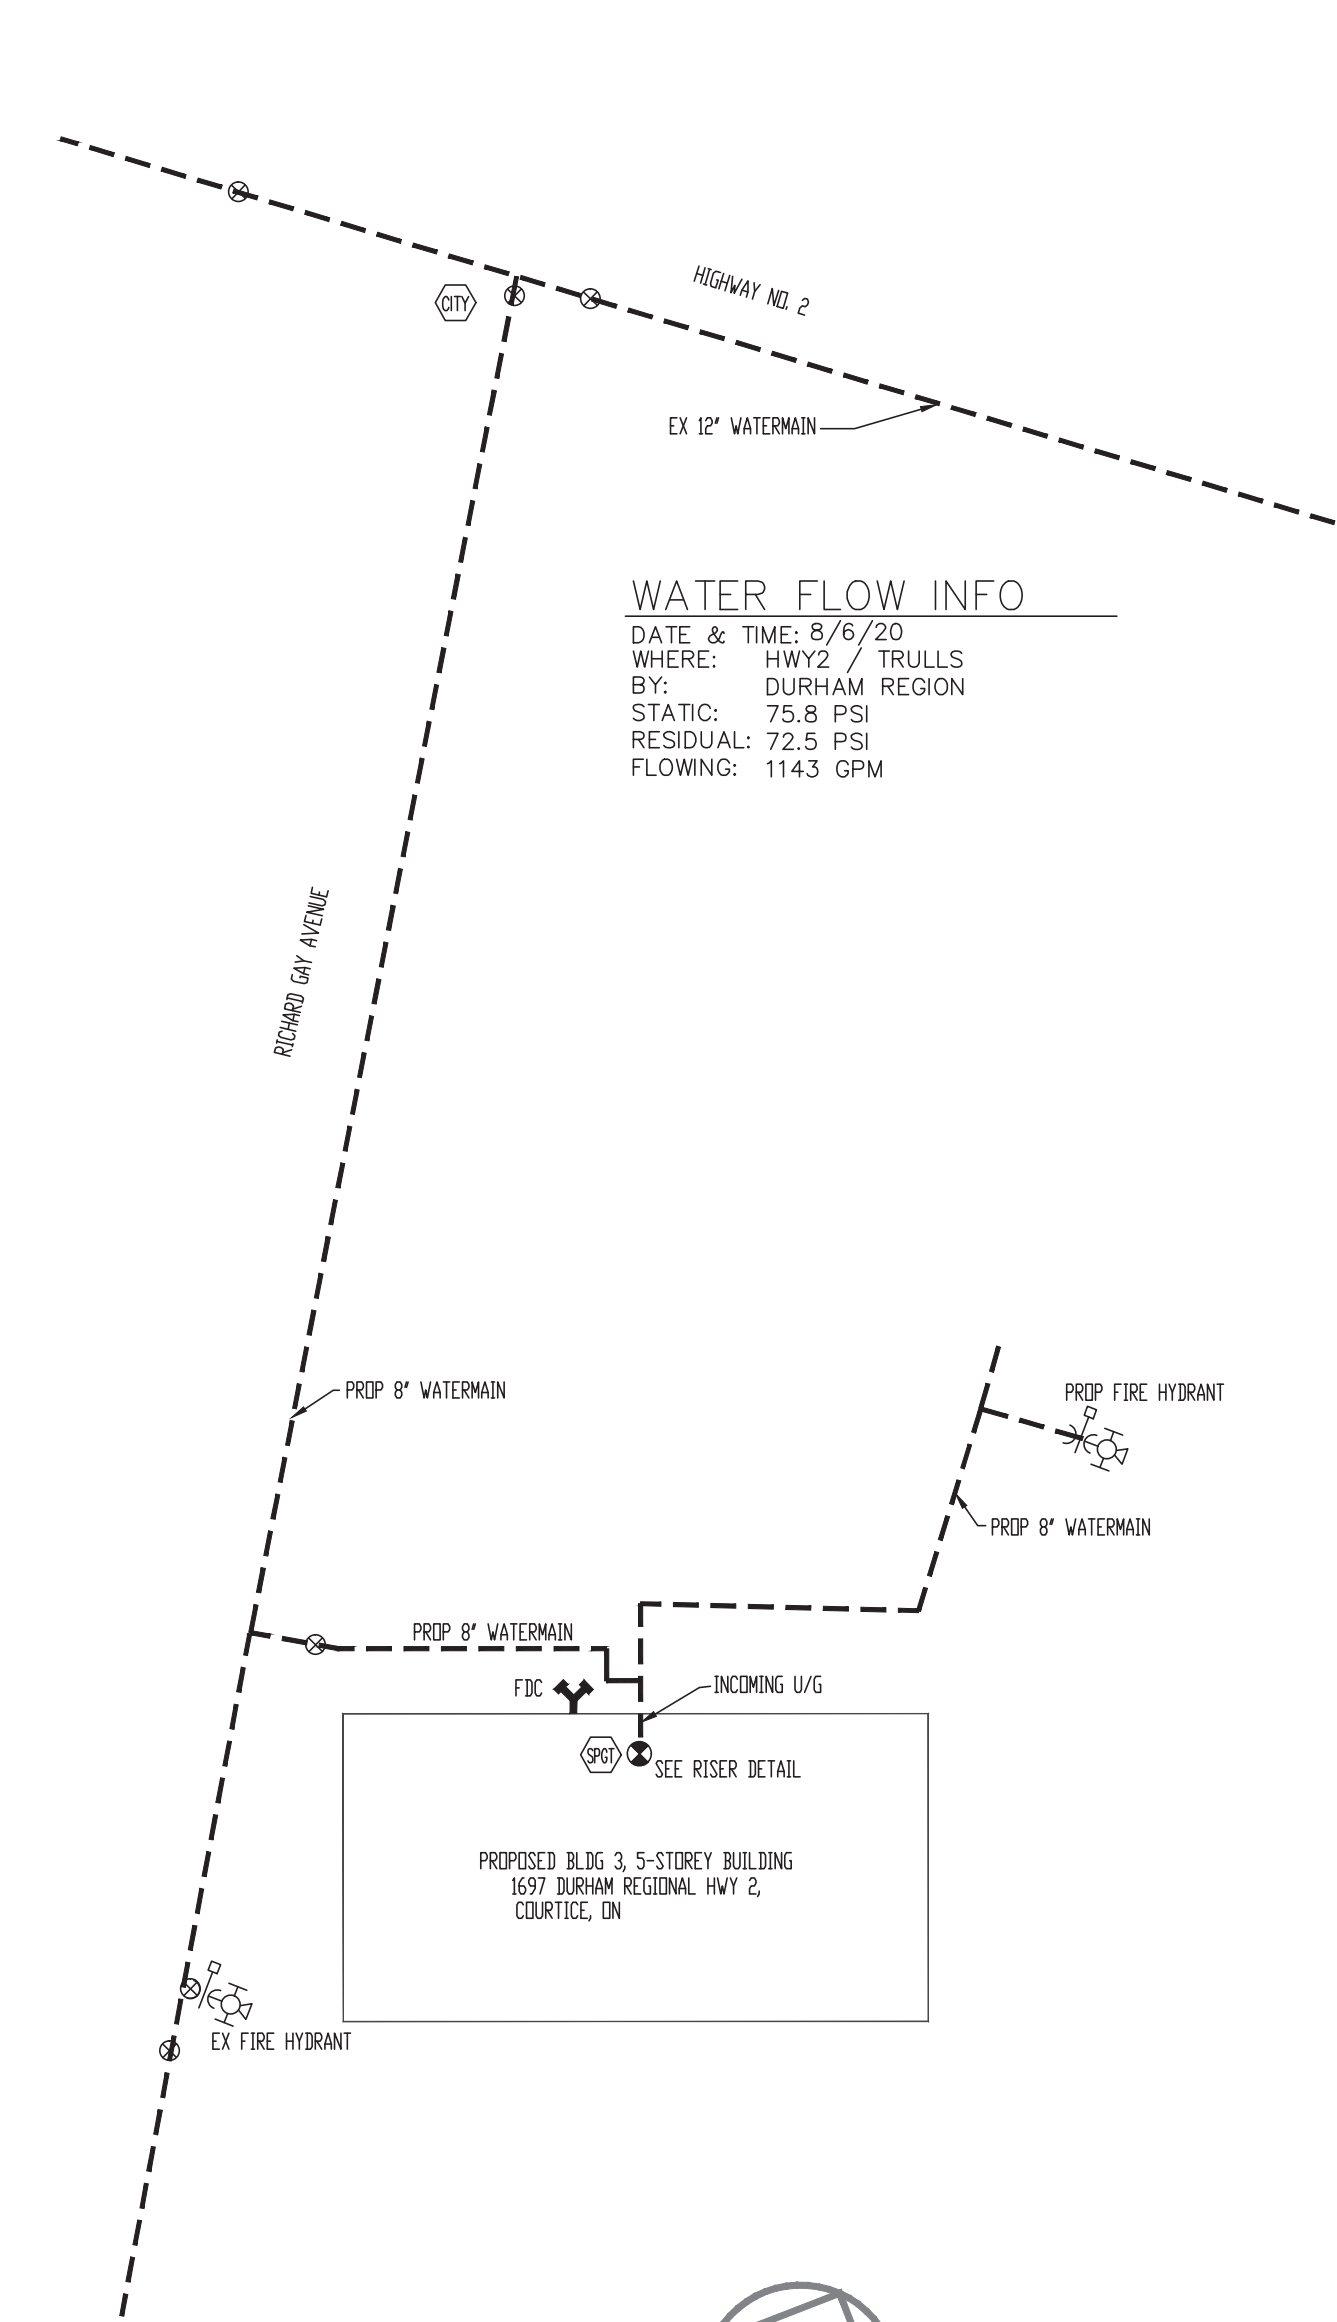

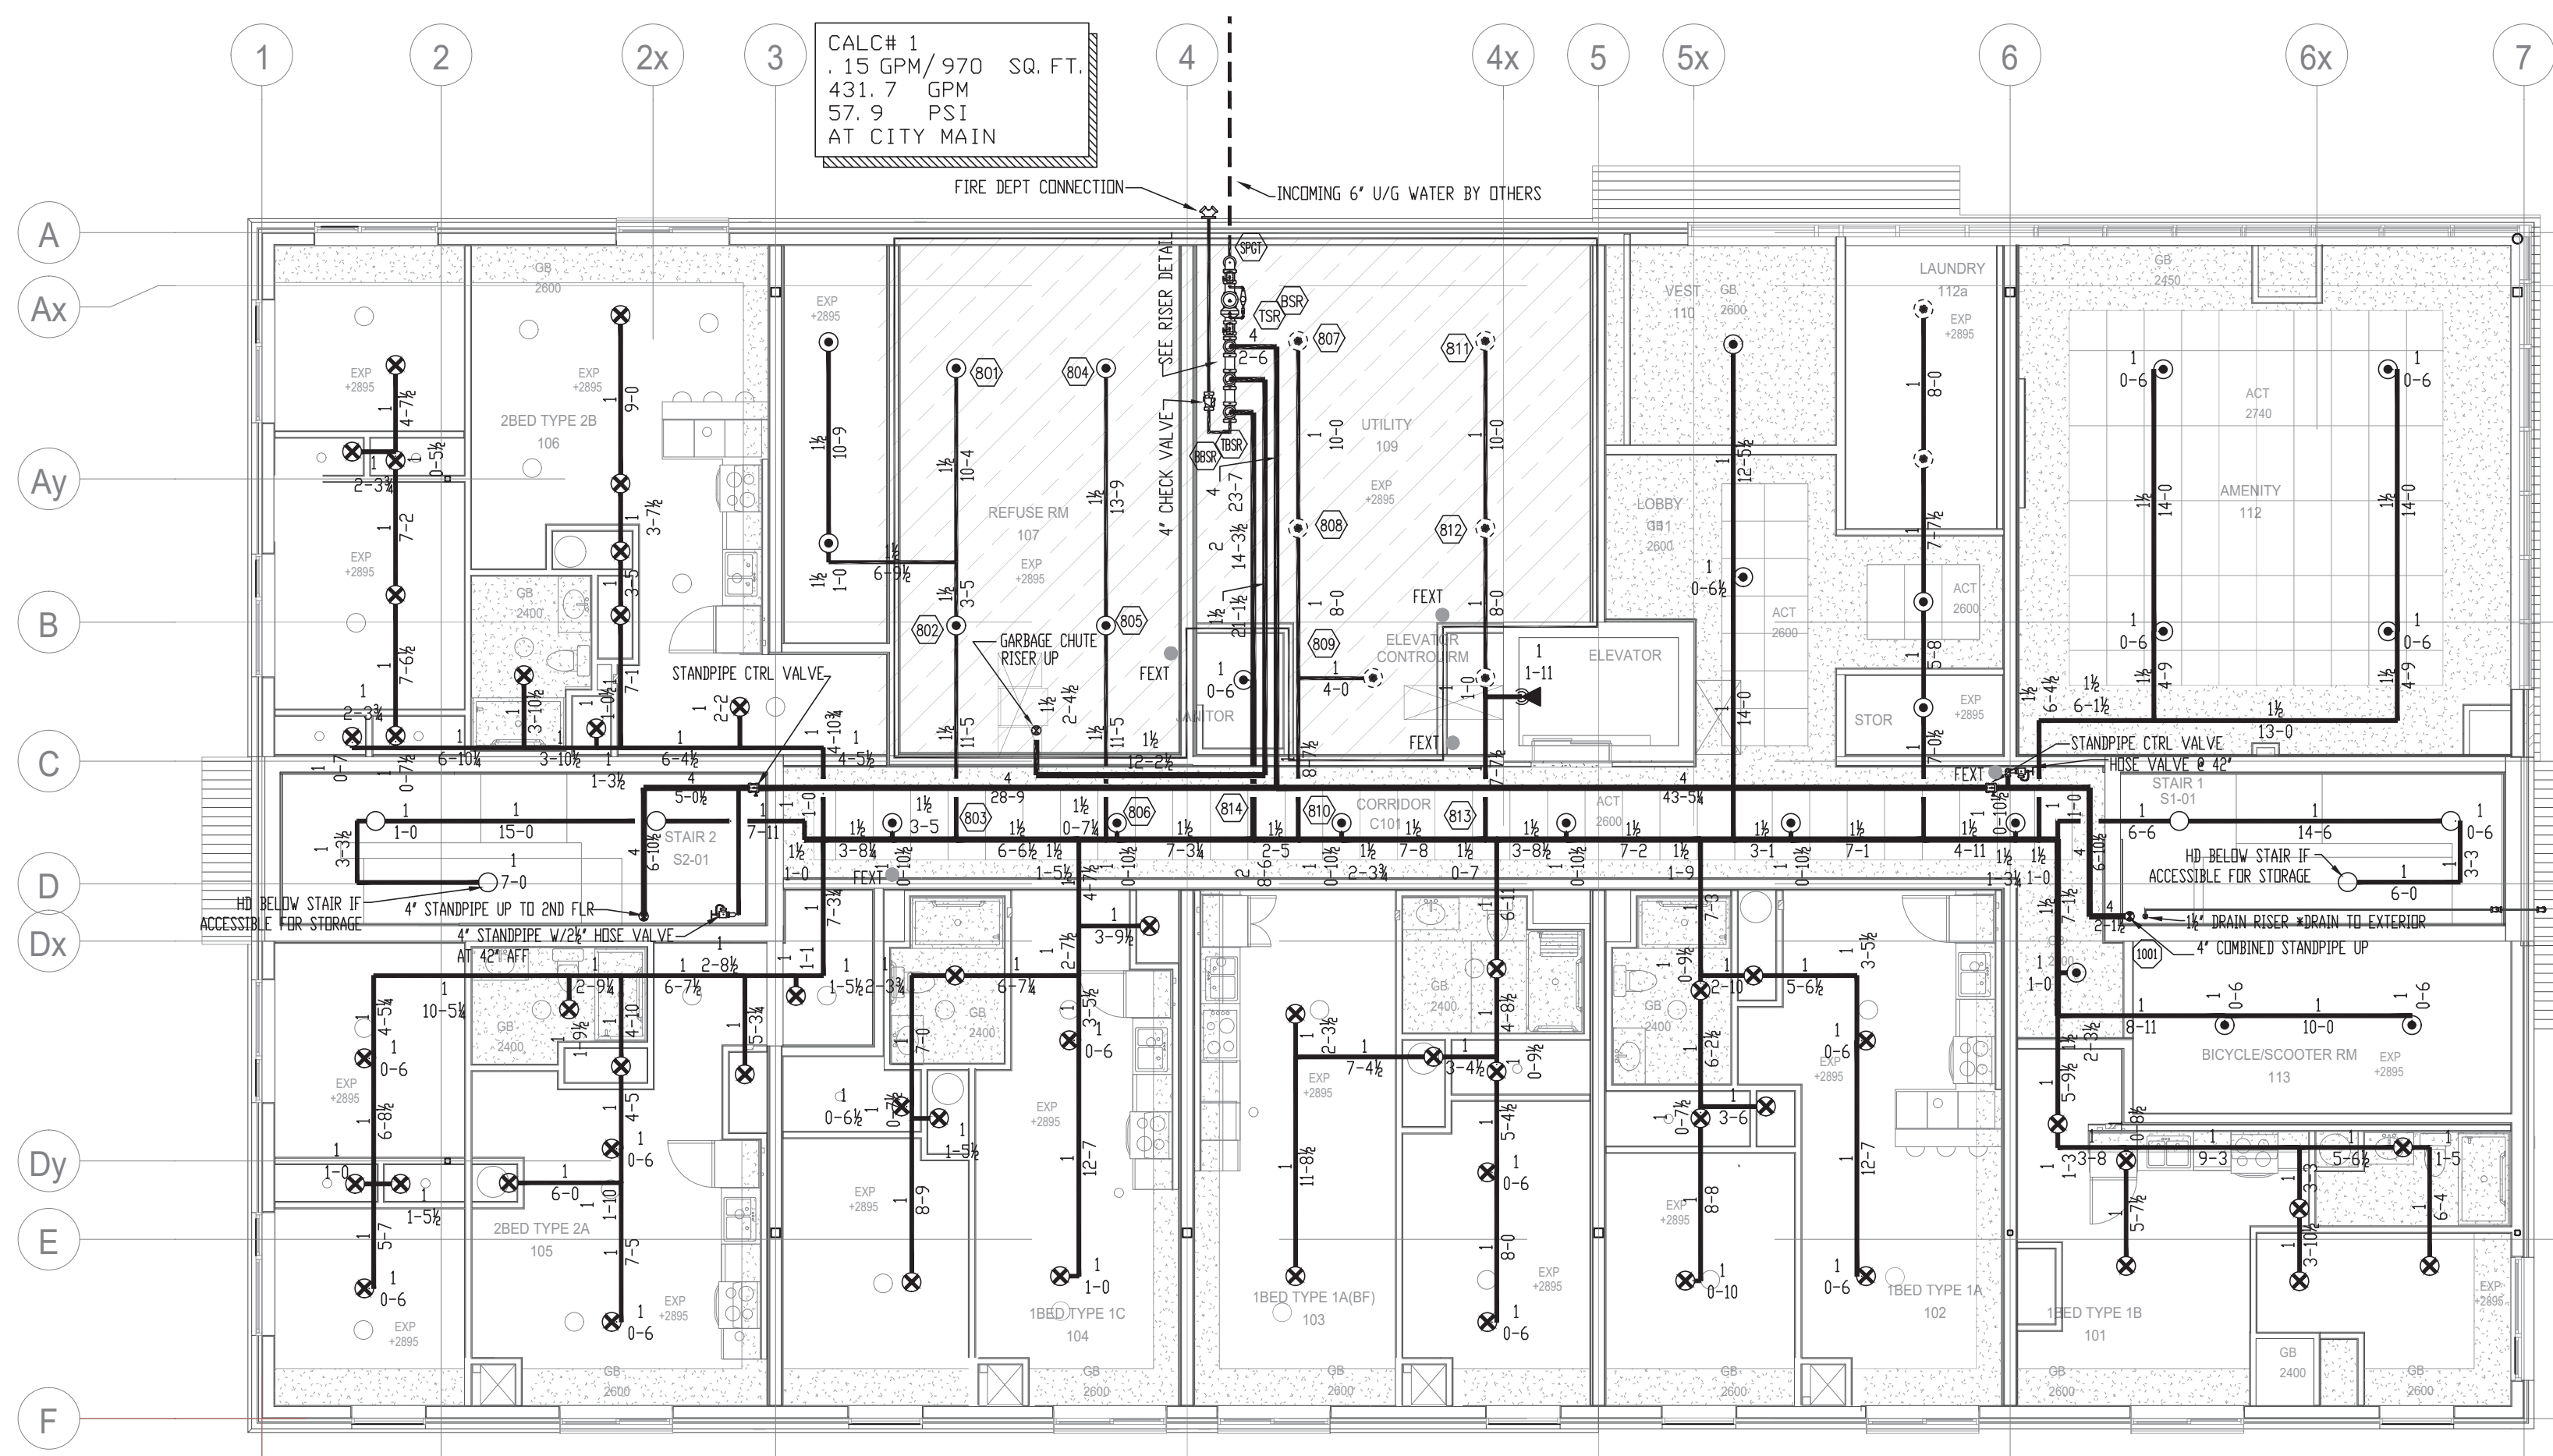

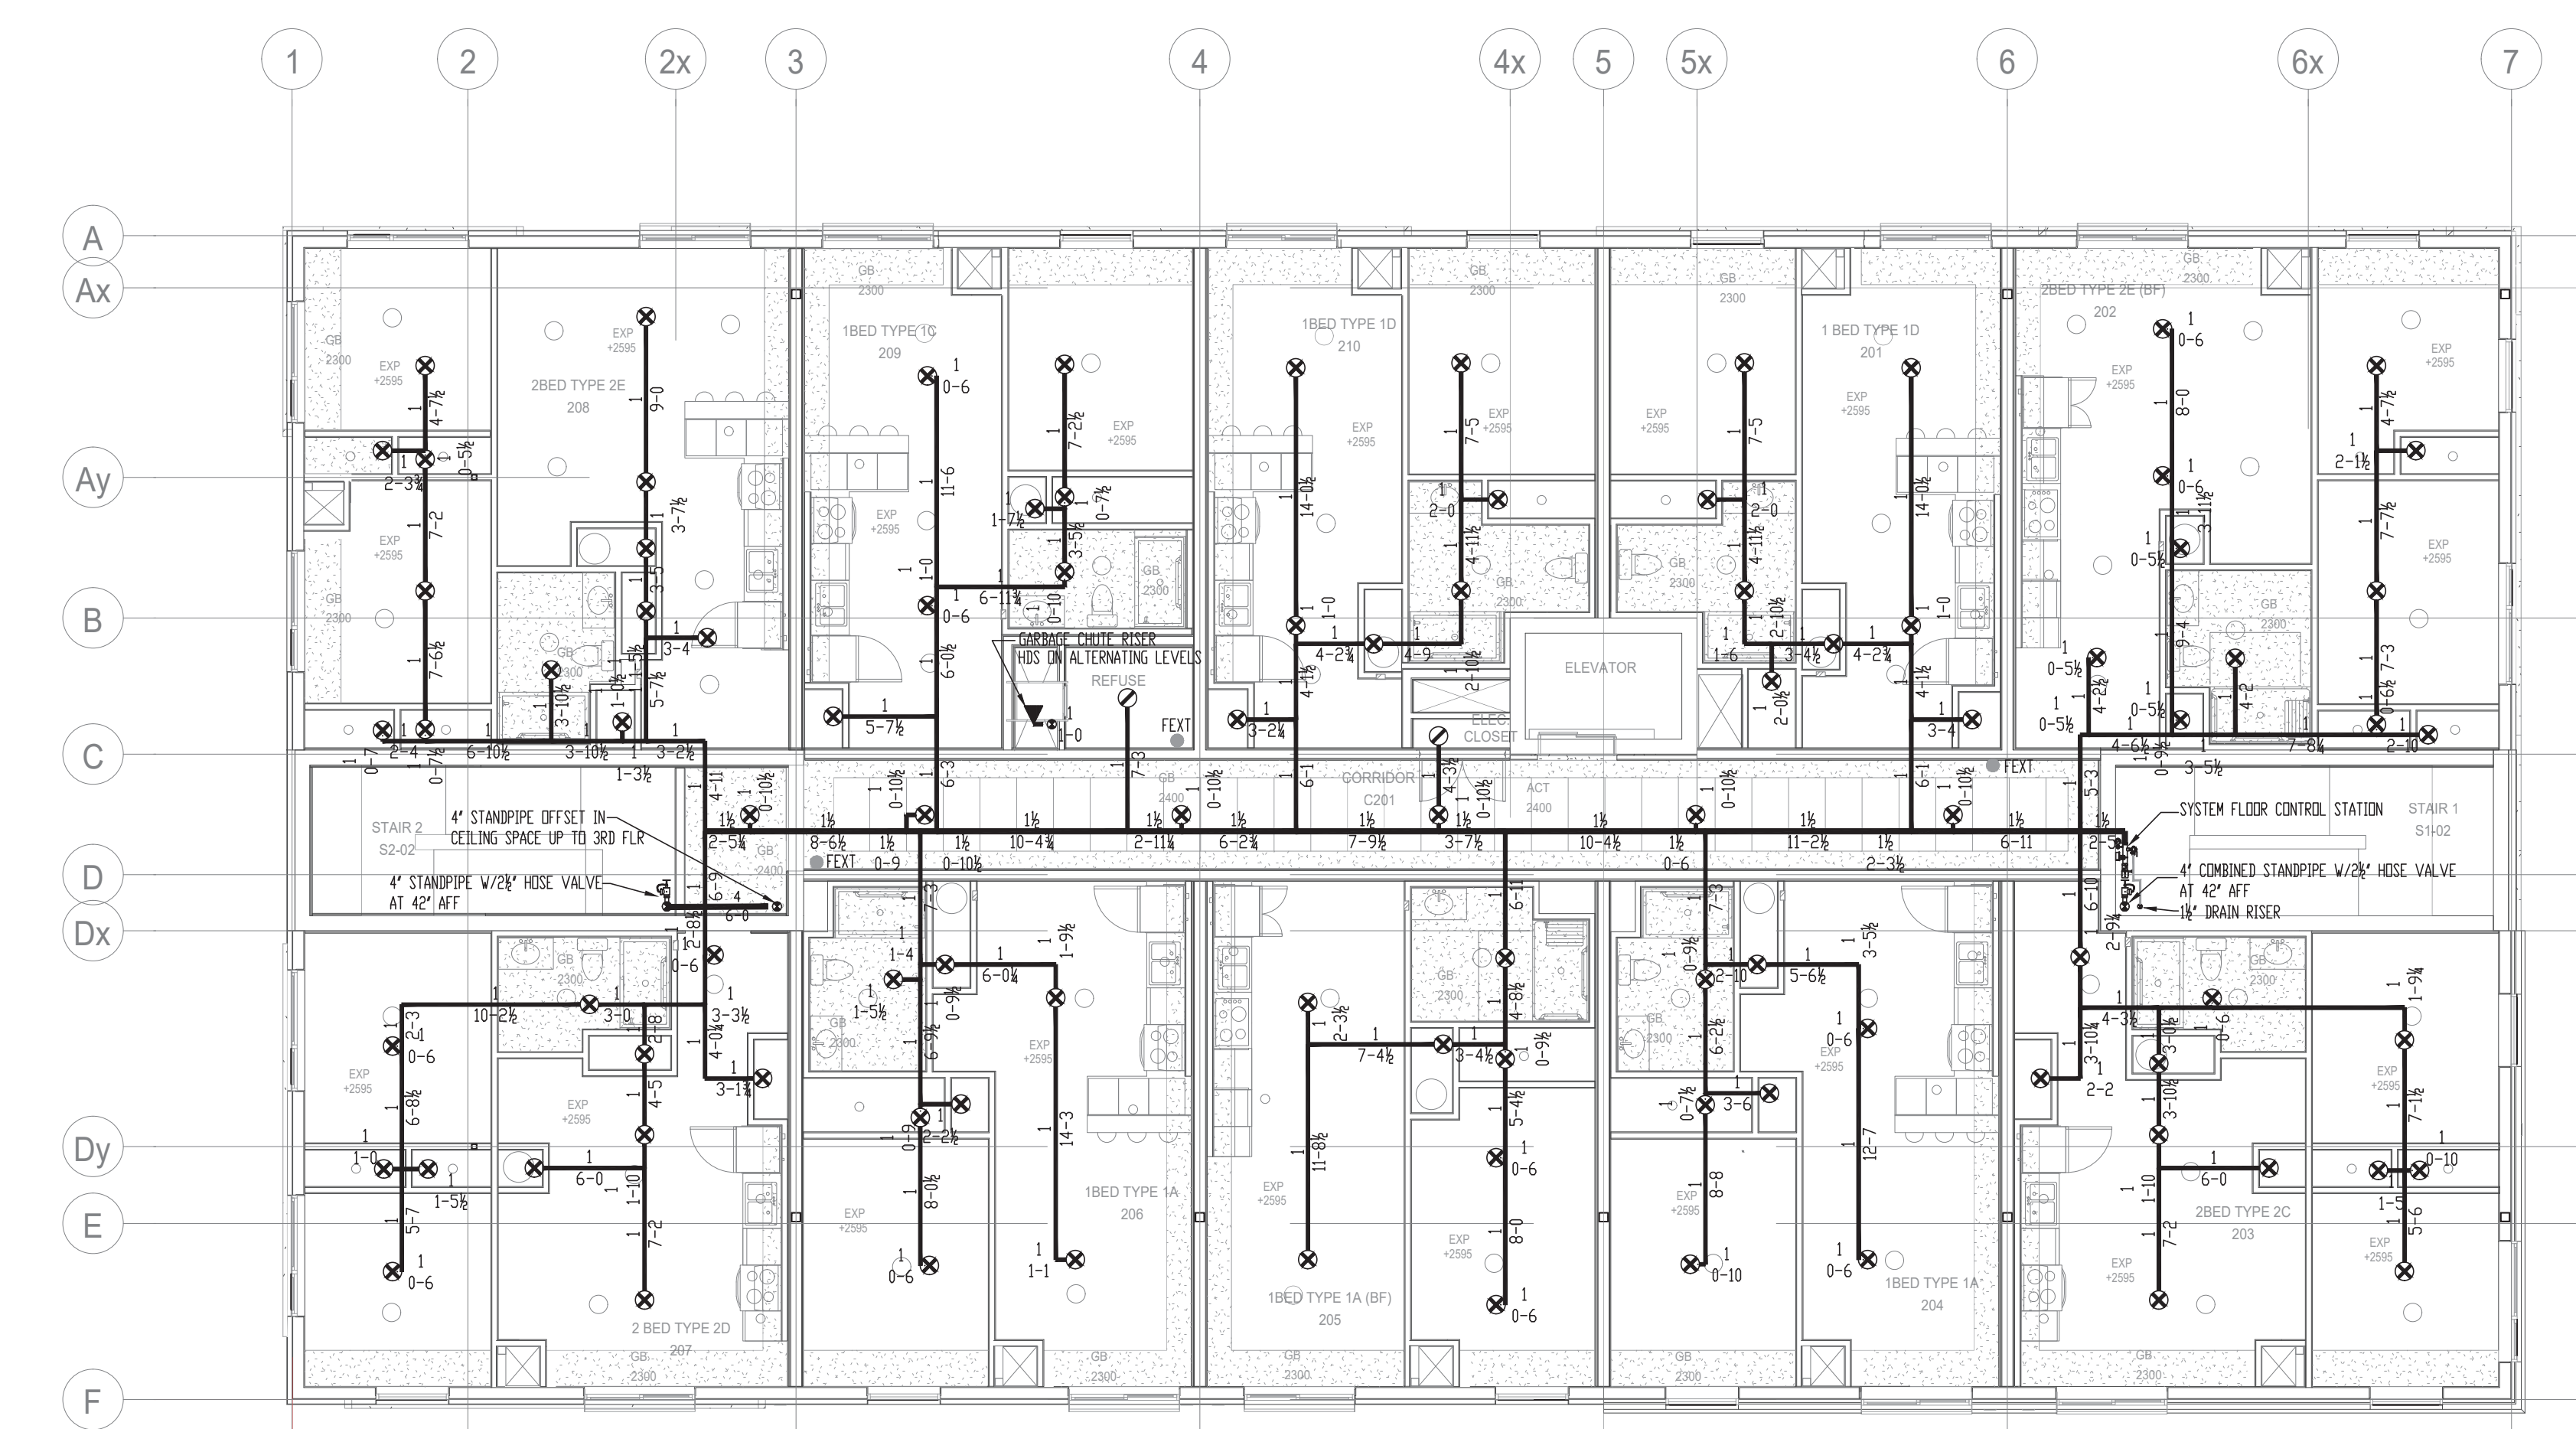

RISER SCHEMATIC
SCALE - 1/4" = 1'-0"







2ND/3RD FLR SPRINKLER PLAN








GROUND FLR SPRINKLER PLAN

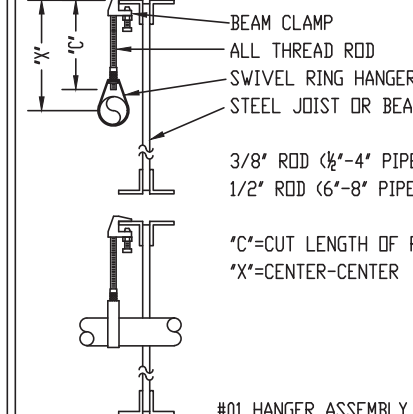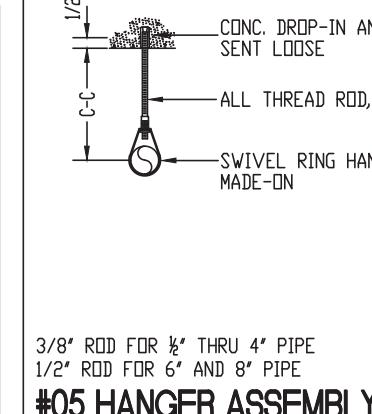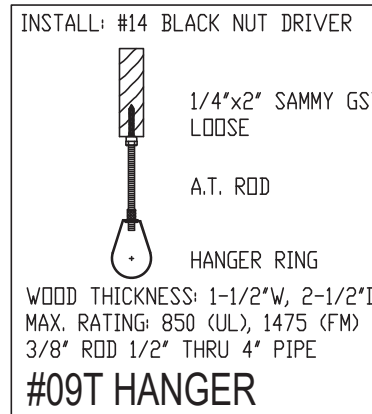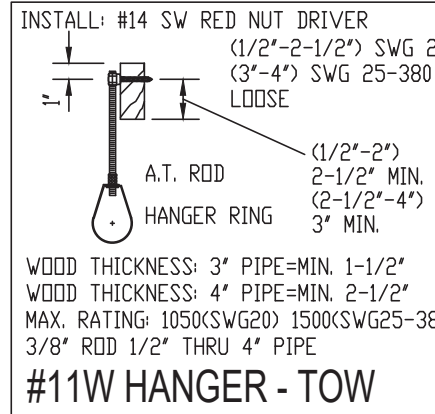Sprinkler Head Schedule					
Symbol	Count	Thread	K-Factor	Description	Note
	24	1/2"	5.6	K-5.6 1/2 QR 155 PEND	ON DROP
	10	1/2"	5.6	K-5.6 1/2 QR 155 BR UP	
	8	1/2"	5.6	K-5.6 1/2 QR 200 PEND	ON DROP
	407	1/2"	4.3	VK468 1/2 155 RES PEND	OR EQUAL
	8	1/2"	5.6	K-5.6 1/2 QR 200 B UP	
	4	1/2"	5.6	K-5.6 1/2 QR BR SW 200 W/CAGE	


461 = Total Number of Heads This Floor

- 10 LB ABC FIRE EXTINGUISHER -



Symbols		SPRINKLER PLANS AND DETAILS			
Symbol	Description	Drawing Title	Revision	Date	
	Hydraulic Reference Point	Job No. 24-185-118	PRELIMINARY PLAN	3/28/24	
	Elev. Below Top of Steel	Drawn By PE	REV 1	4/4/24	
	Elev. Above Finished Floor	Checked By JAC/SHW	ISSUED FOR PERMIT	4/30/24	
	Top of Tank of Steel		ISSUED FOR PERMIT/TENDER	8/30/24	
	Ceiling Height	Date 3/1/24			
	Denotes Hanger Location	Approved by			
	Rise up or down	Chief AE / Local FM			

AUG. 30, 2024



90218512
M. M. BASSILY
PROVINCE OF ONTARIO

Job: Proposed Courtice
Mixed-Use Building
Development - BLDG.#3

1697 Durham Regional Hwy 2,
Courtice, ON L1E 2R5

SHEET FP-1

