



# Dynamic Response of ['Store\_Coolant', 'Tank\_Sig', 'Valve1\_Sig'] to fault Leak


Tank\_Sig: indicator

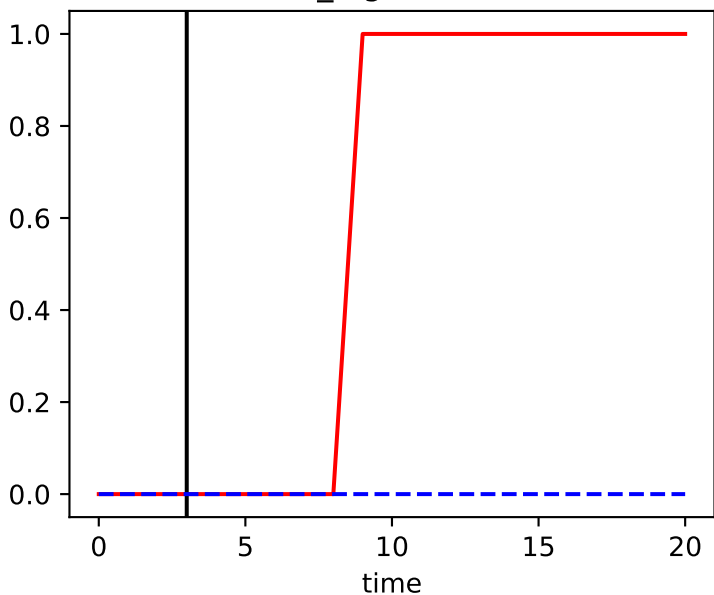

Store\_Coolant: level

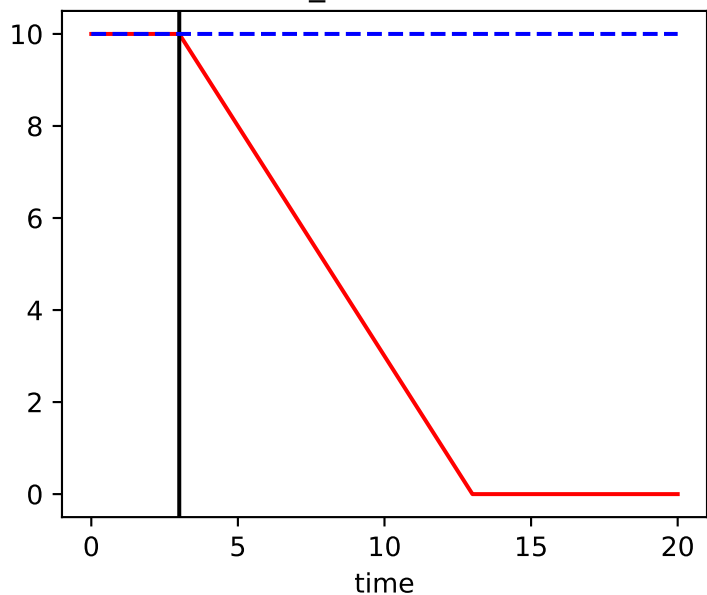

Store\_Coolant: net\_flow

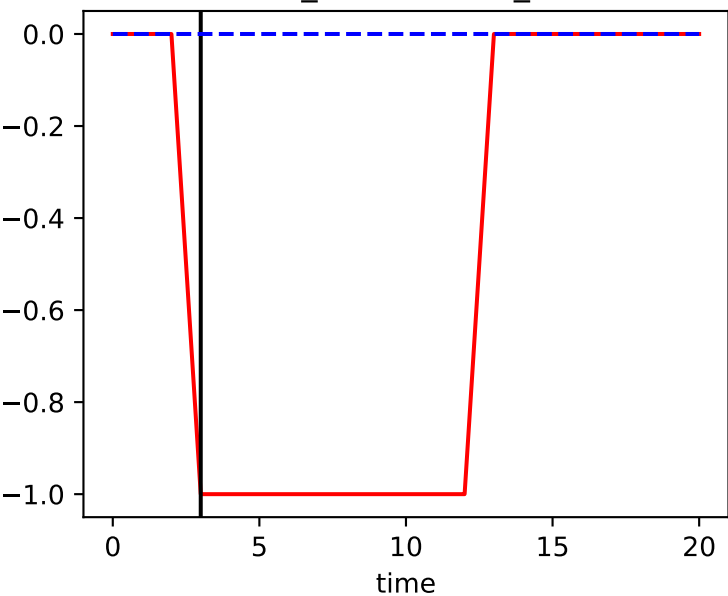

Propagation of faults to Leak at t=3

