

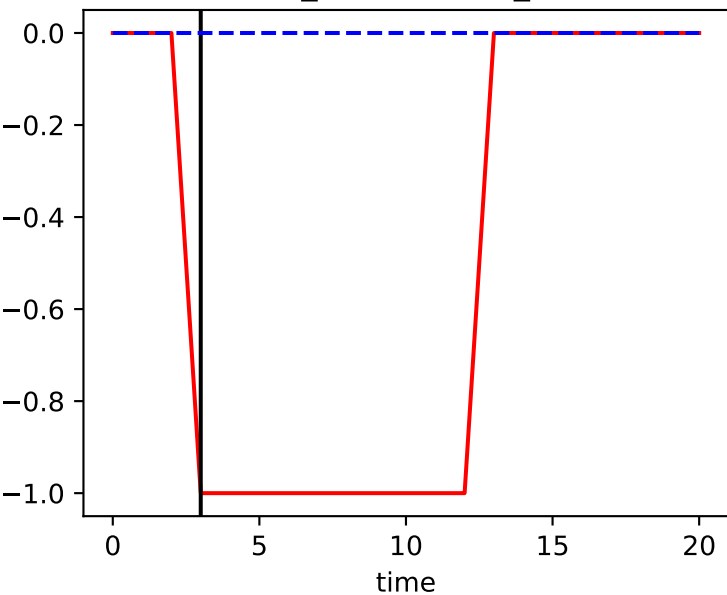


### Dynamic Response of ['Store\_Coolant', 'Tank\_Sig', 'Valve1\_Sig'] to fault Leak

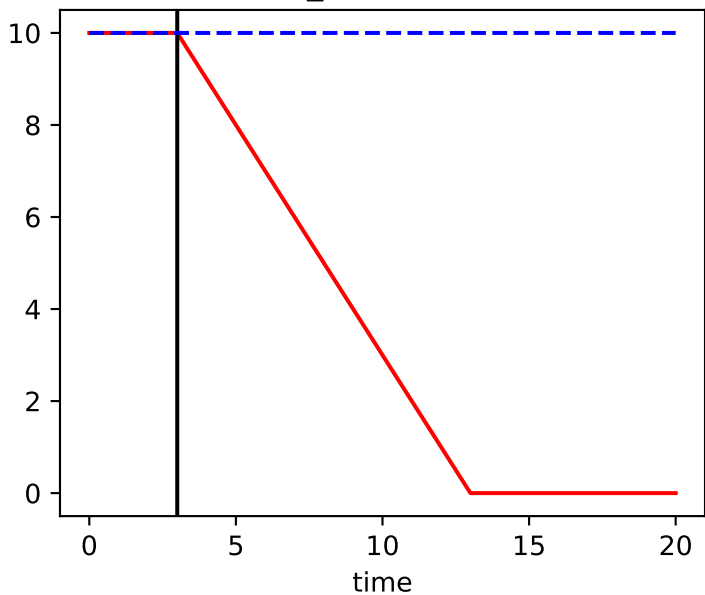

## Propagation of faults to Leak at t=3

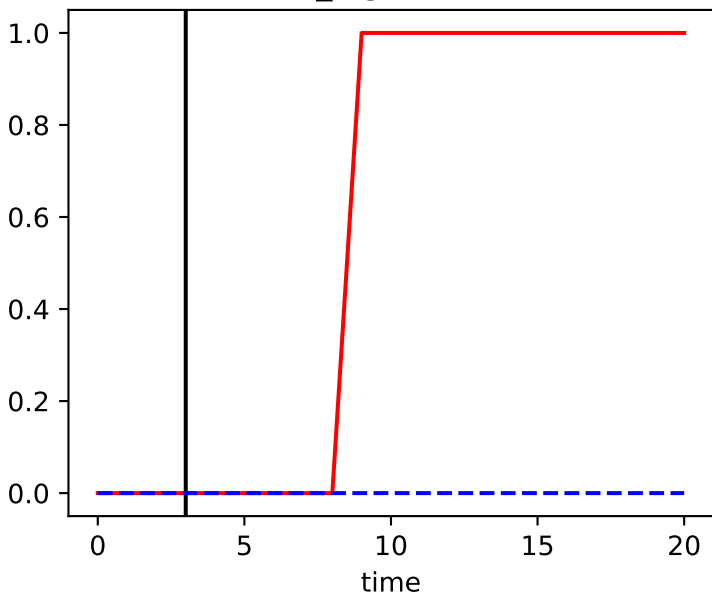