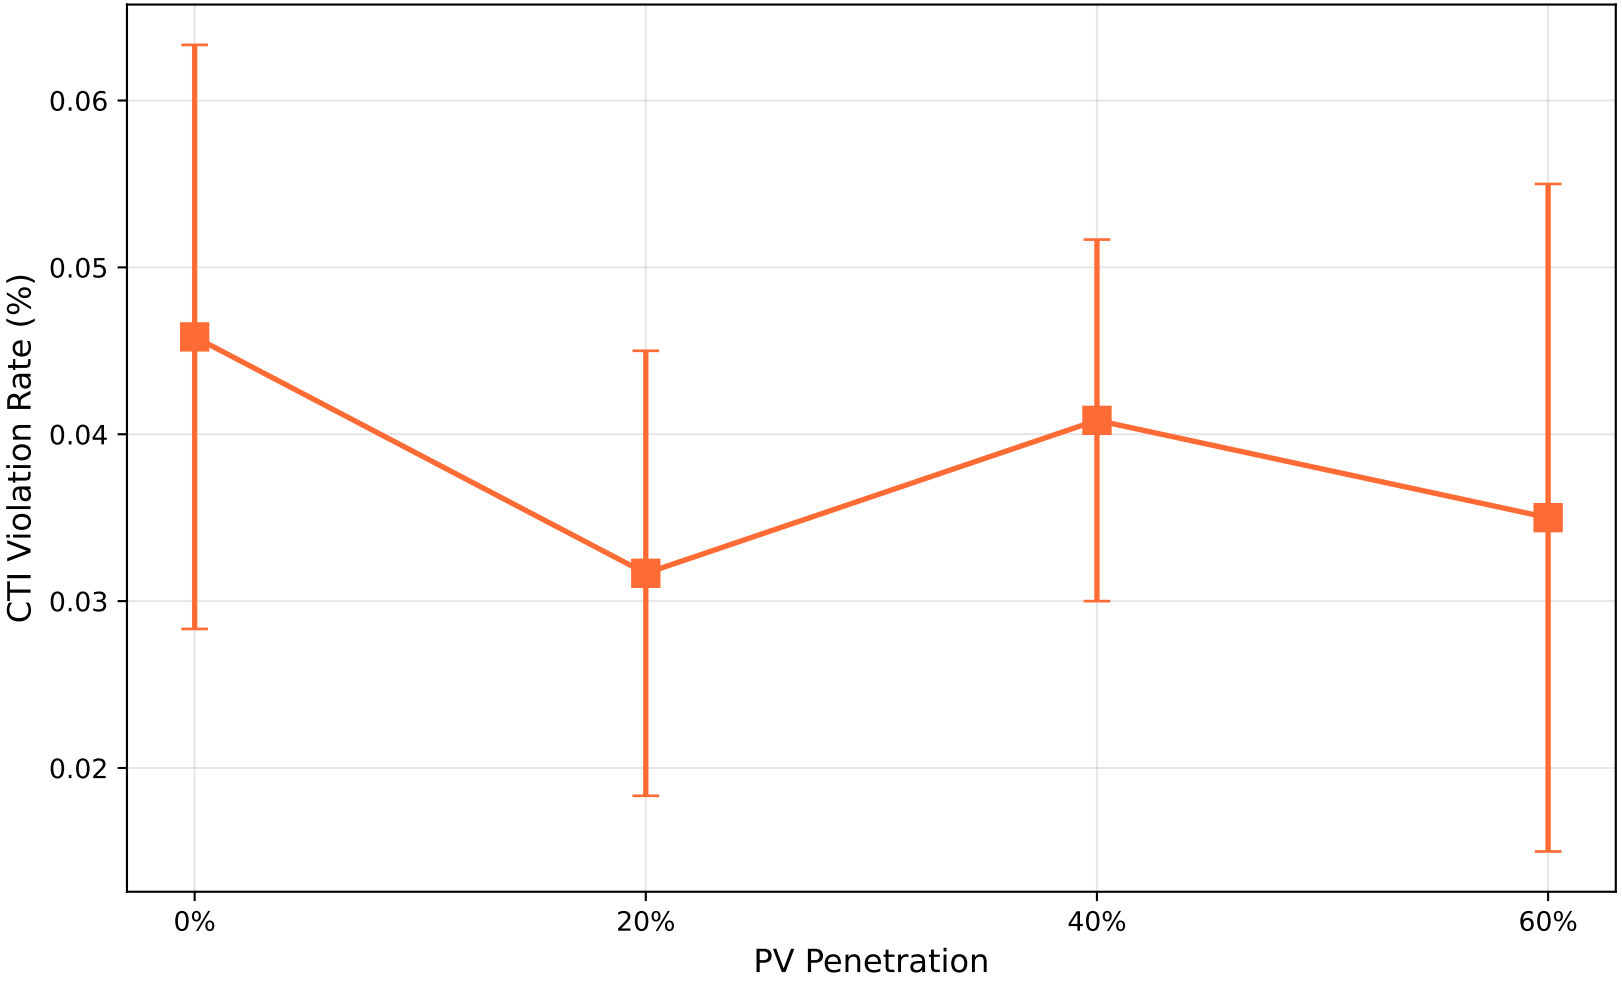
Figure 6 — CTI Violation Rate vs. PV Penetration (8-Bus)
CTI Violation Rate (%)
0.06
0.05
0.04
0.03
0.02
0%
20%
40%
60%
PV Penetration