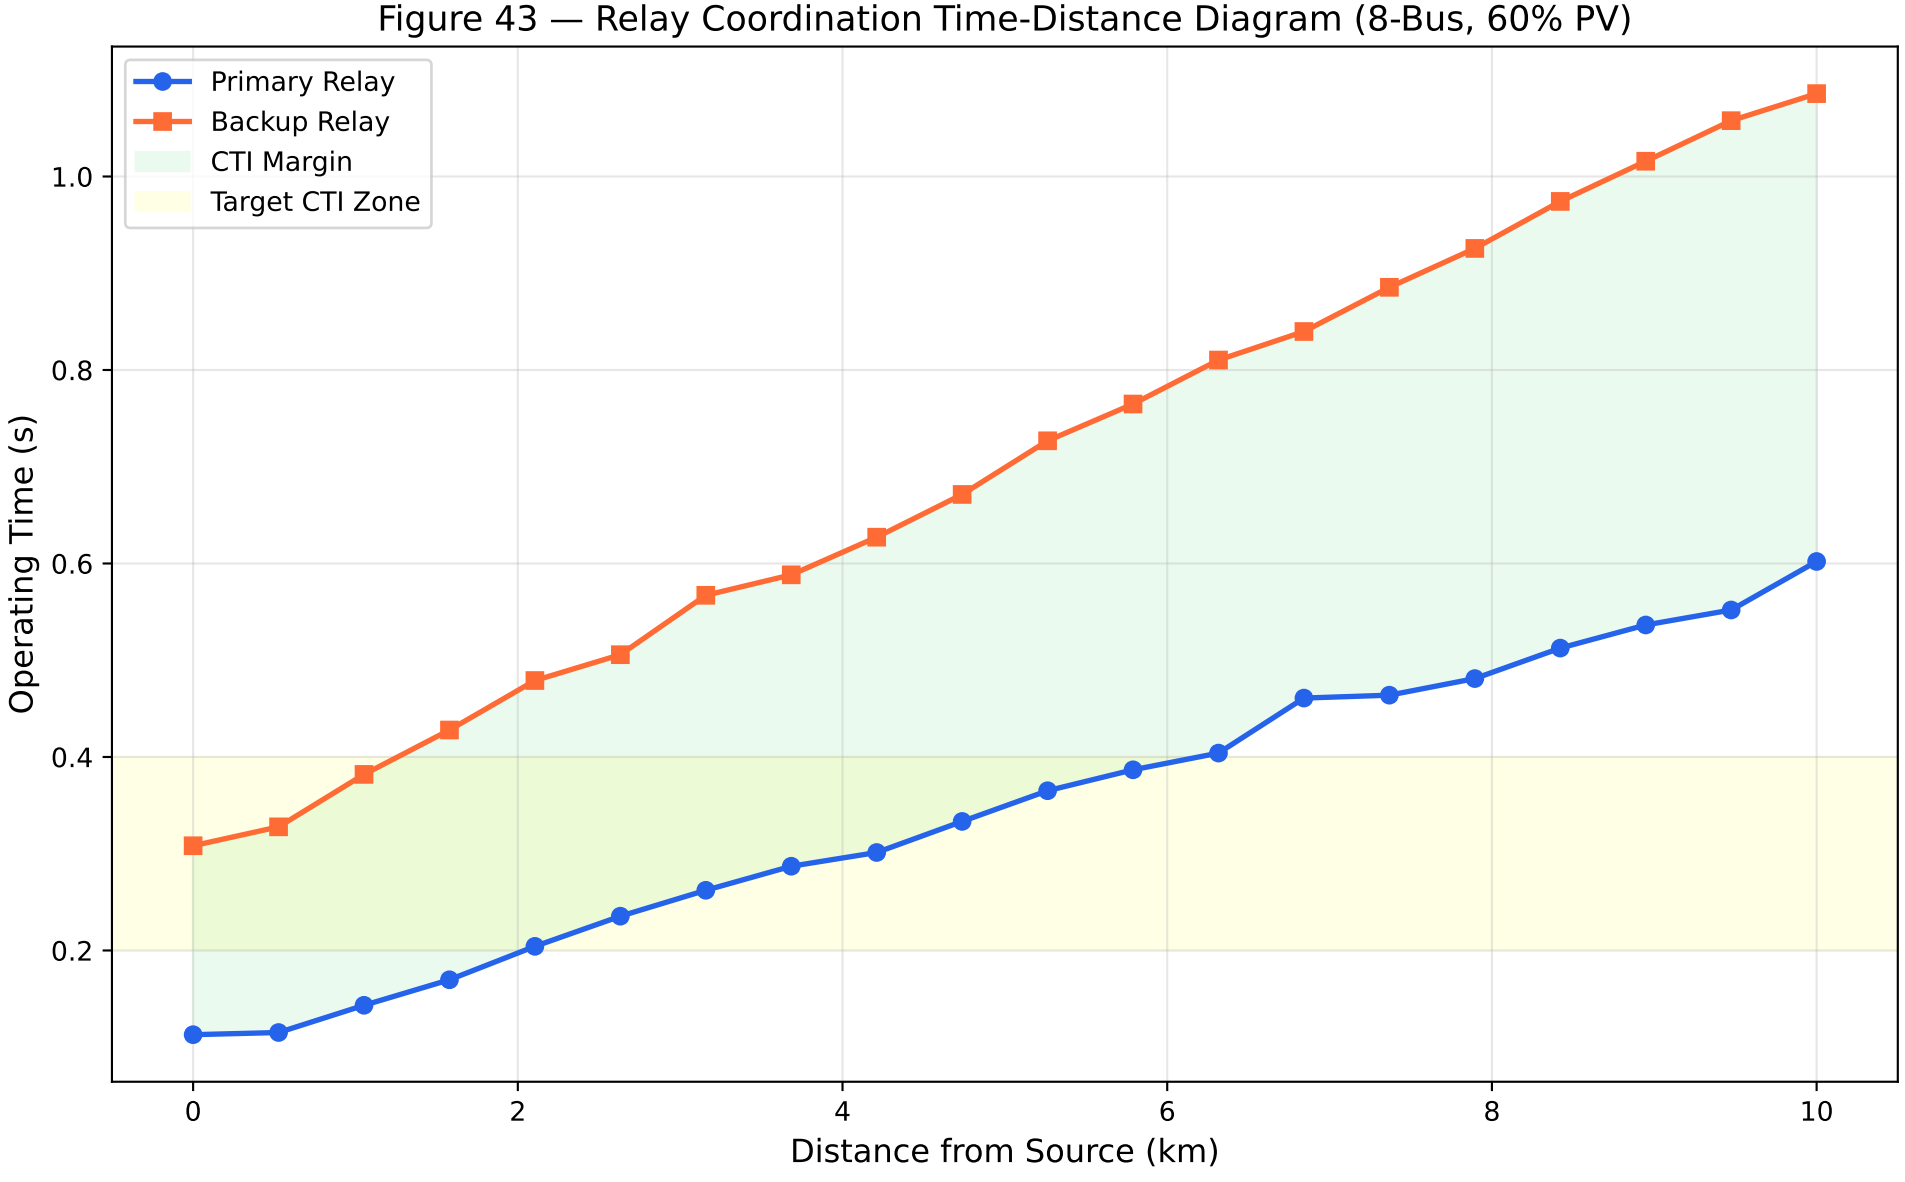
Figure 43 — Relay Coordination Time-Distance Diagram (8-Bus, 60% PV)
Primary Relay
Backup Relay
CTI Margin
Target CTI Zone
Operating Time (s)
0.2
0.4
0.6
0.8
1.0
0
2
4
6
8
10
Distance from Source (km)