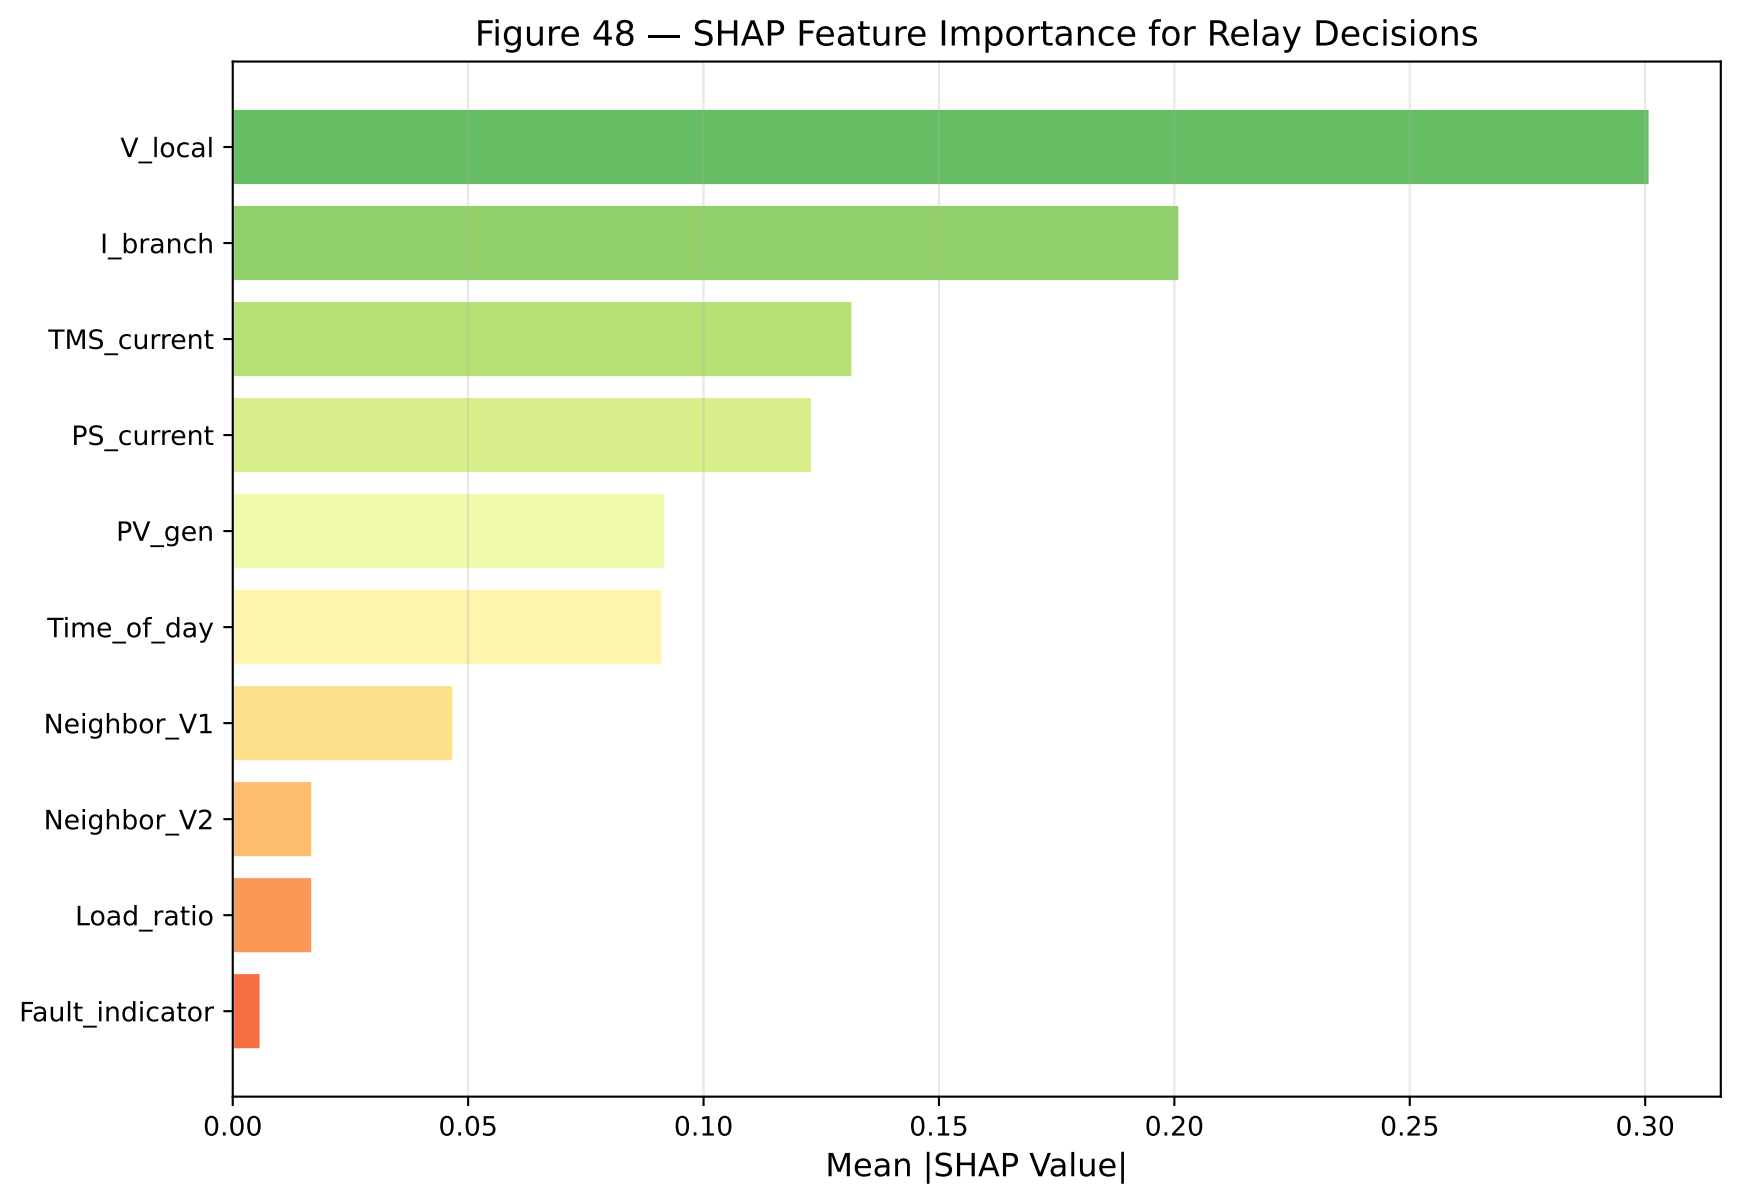
Figure 48 — SHAP Feature Importance for Relay Decisions
V_local
I_branch
TMS_current
PS_current
PV_gen
Time_of_day
Neighbor_V1
Neighbor_V2
Load_ratio
Fault_indicator
0.00
0.05
0.10
0.15
0.20
0.25
0.30
Mean |SHAP Value|