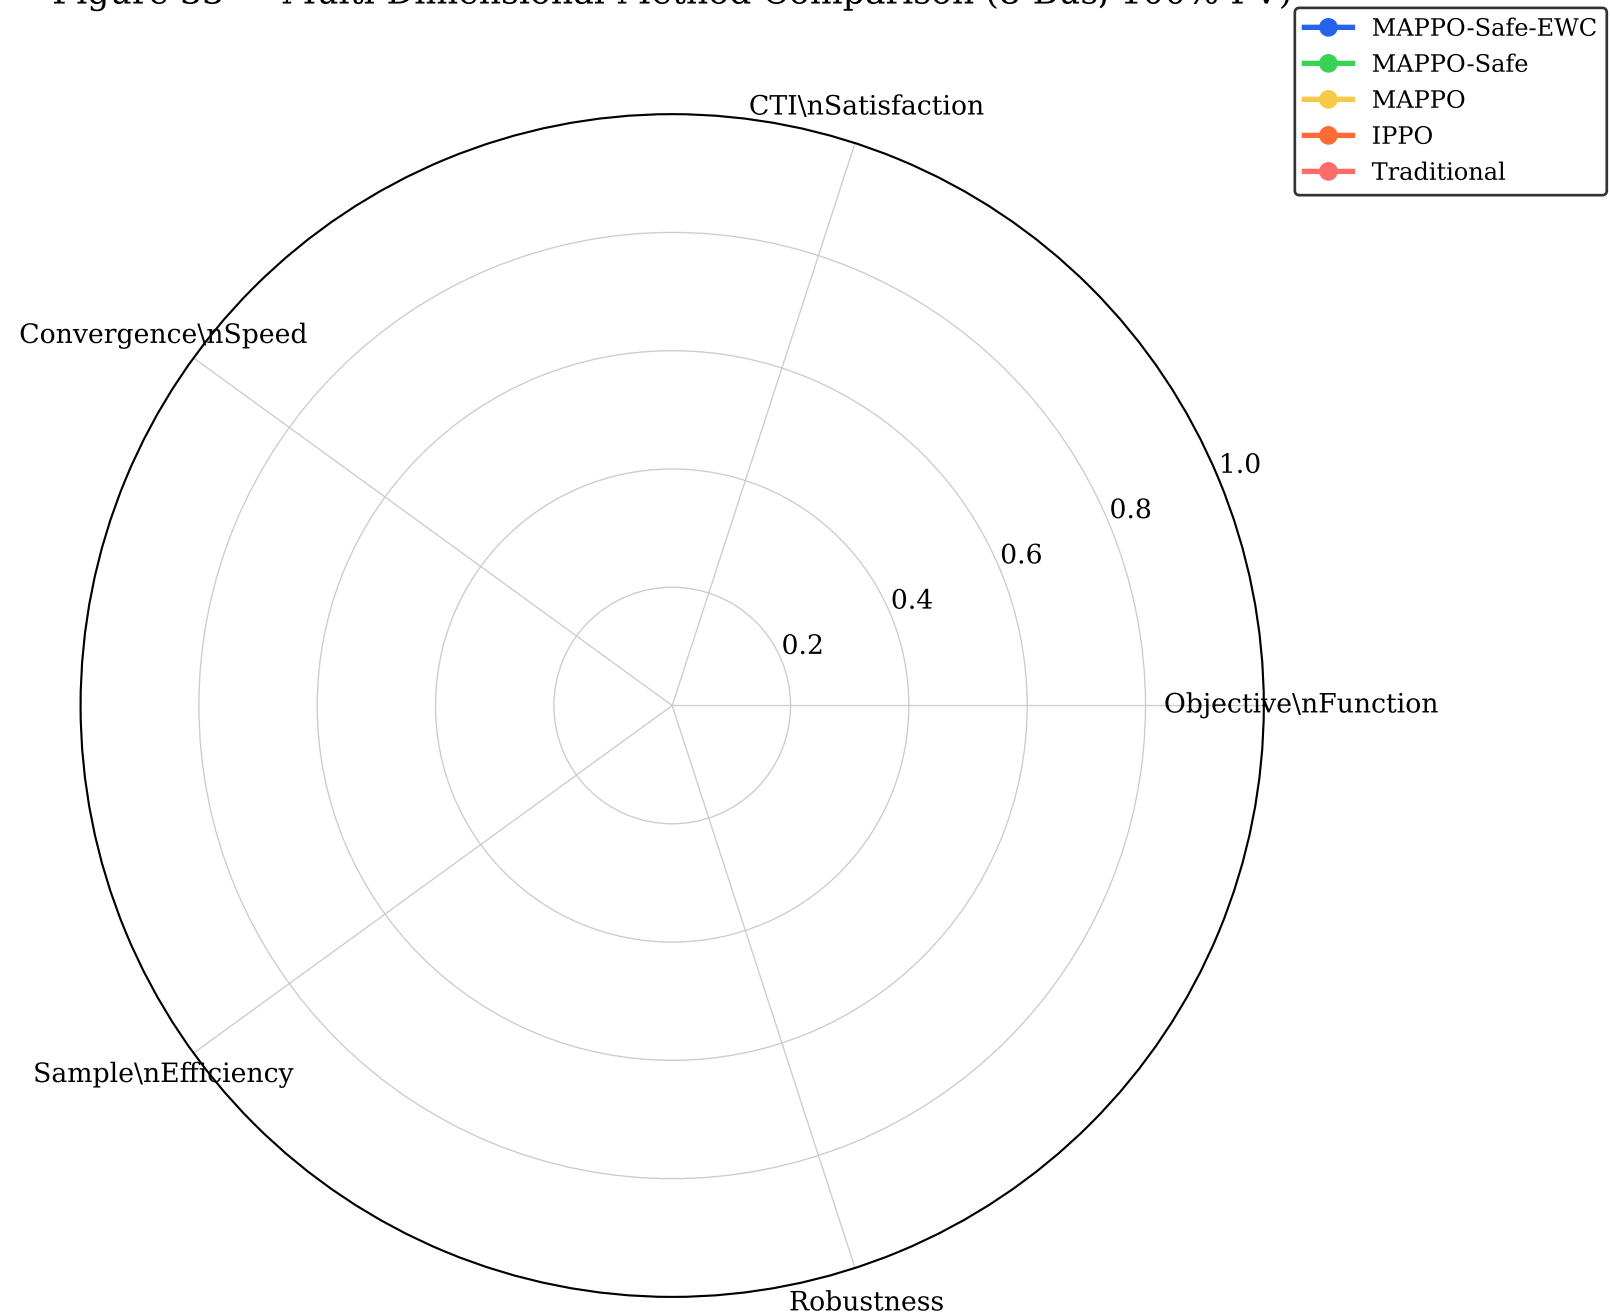Figure 33 — Multi-Dimensional Method Comparison (8-Bus, 100% PV)