
Home: wording corrections

Original screenshot with requested text areas circled. Amber marks a suggestion.

ORIGINAL HOME CARD

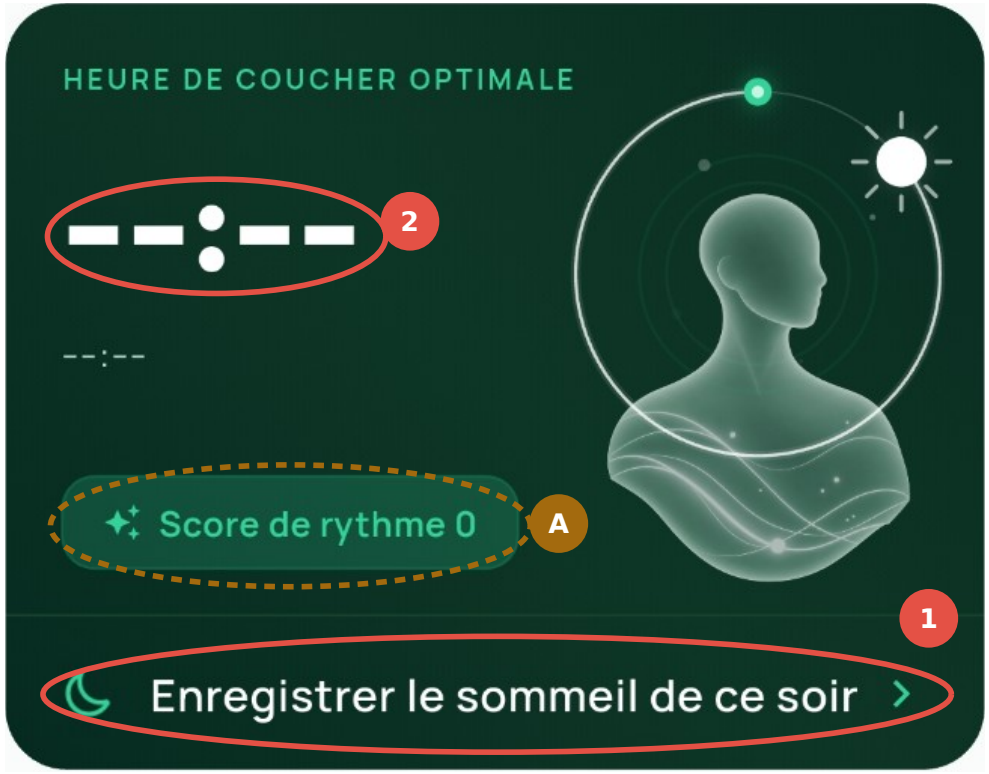

The circled --:-- identifies the bedtime display. It is not an instruction to replace empty-data dashes.

Red: requested corrections

Amber: optional item for discussion

1 Log the most recent sleep

Replace “Enregistrer le sommeil de ce soir” with:

FR: Enregistrez votre dernier sommeil

EN: Log your last sleep

The text must refer to the latest sleep, whether it happened during the day or at night.

2 French ASAP status

When the bedtime recommendation displays **ASAP**, show **MTN** in the French interface. The final letter is **N**.

This localization request concerns the ASAP state only.

A - OPTIONAL: rhythm score on the home card
Consider removing “Score de rythme 0” from this card and keeping the score in Statistics. This was discussed as a design suggestion; removal has not been explicitly confirmed.

Work: remove the impact card

03 | Remove the whole card and reclaim its vertical space.

ORIGINAL WORK SCREEN



The red outline marks the complete card to remove.

3 Remove “Impact sur aujourd’hui”

Delete the entire **“Impact sur aujourd’hui”** card from the Work screen, including its icon, title, background and reserved space.


Move the sections below it upward so the page does not retain an empty gap.

Expected screen flow
Weekly schedule → Create a custom work rotation → Rotation settings.


Sleep: remove two interface elements

05 + 07 | Apply these changes to the original Sleep screen.

ORIGINAL SCREEN: SLEEP DEBT

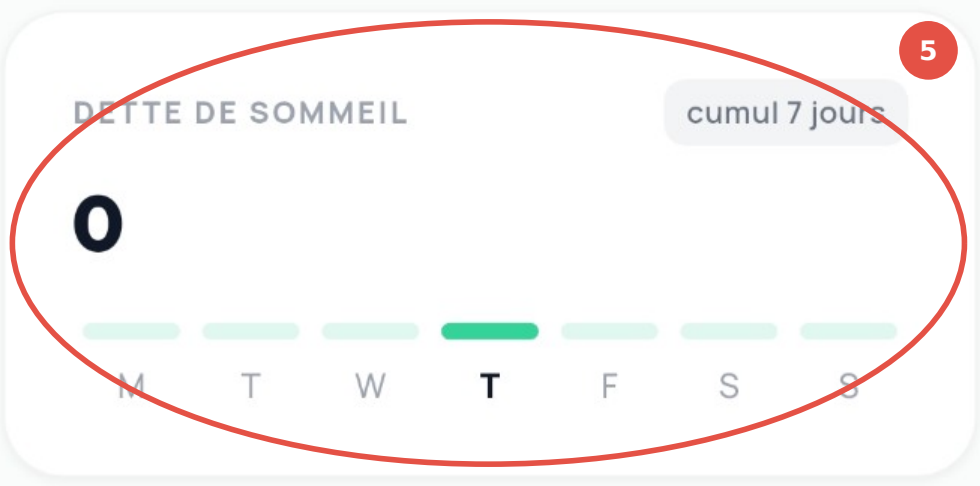

ORIGINAL SCREEN: OPTIONAL NOTE FIELD

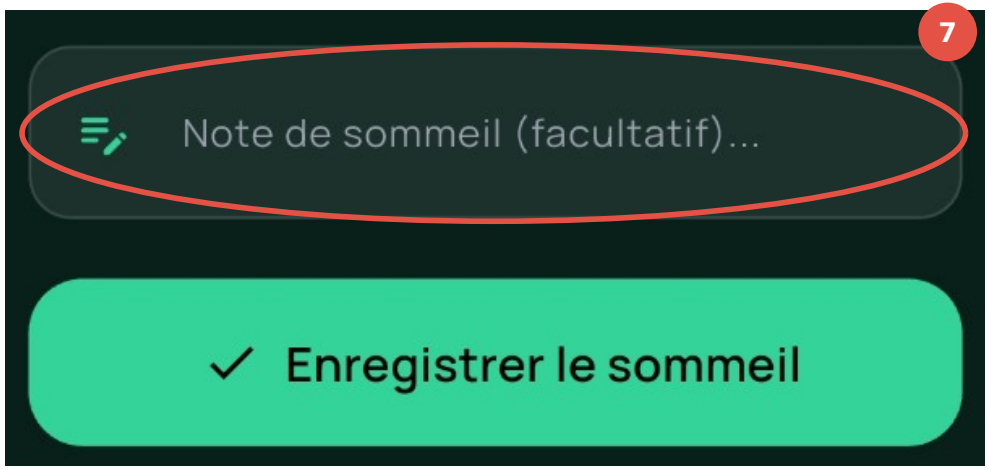

5 Move sleep debt to Analytics

Remove the standalone **“Dette de sommeil”** card from this screen, including the 7-day mini-chart and the space occupied by the card.

Add this existing metric inside the **Sommeil** block in **Historique / Vue d’ensemble**. See the retained Analytics mockup on page 5.

7 Remove the optional sleep note

Remove the **“Note de sommeil (facultatif)…”** input from the sleep-entry form.

Move the **“Enregistrer le sommeil”** button upward and reduce the height of the form card accordingly.

Visual scope: use the original Sleep screen shown above. The separately generated Sleep redesign was rejected and is not included in this specification.

Analytics: translate the comparison

04 | Historique → Vue d’ensemble → Stabilité circadienne.

ORIGINAL ANALYTICS SUMMARY



English text remains inside the French interface. The comparison is also repeated below the badge.

Localization target
The comparison wording must follow the selected interface language. This page specifies the French wording for the 7-day example.

4 Use French comparison text

Localize **“vs last week”** in the French interface.

Full French translation
Par rapport à la semaine précédente

For the illustrated **7-day view**, use the compact layout shown in the retained mockup:


Badge: variation value only
Caption: Par rapport aux 7 jours précédents

Keep the underlying comparison calculation. The screenshot does not confirm the unit of “-12”; do not add a new unit based on the mockup.

Analytics: add the sleep-debt metric

05 | Retained visual reference for the new location inside the Sommeil block.

RETAINED ANALYTICS MOCKUP

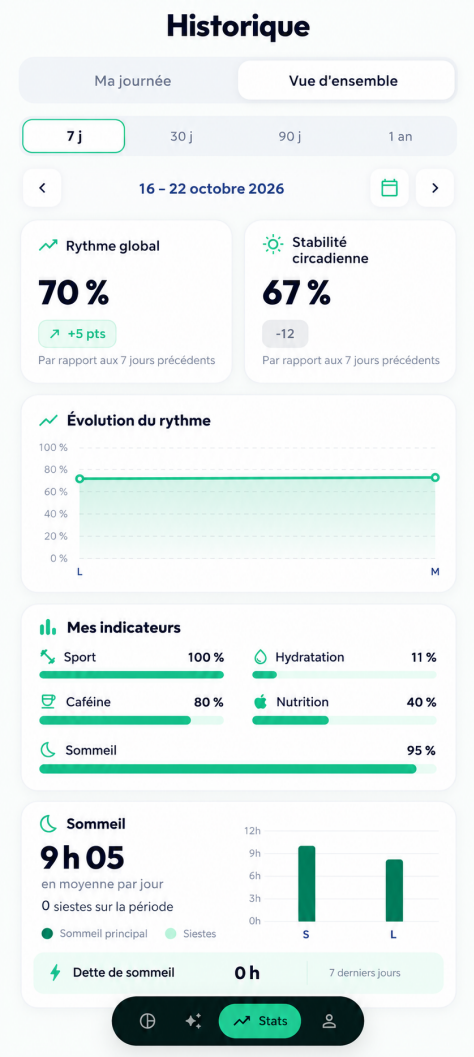

5 Destination: the Sommeil card

Add the existing sleep-debt metric as a compact row **inside the Sommeil card**, below the sleep summary and chart.

French labels: **“Dette de sommeil”** and **“7 derniers jours”**. Display the existing calculated value; **0 h** is the example shown here.

Keep its current 7-day scope and calculation. This mockup shows the requested placement; the comparison localization is specified on page 4.


ENLARGED DESTINATION



Recommendations: translate the empty state

06 | French message when no recommendations are available.

ORIGINAL RECOMMENDATIONS SCREEN

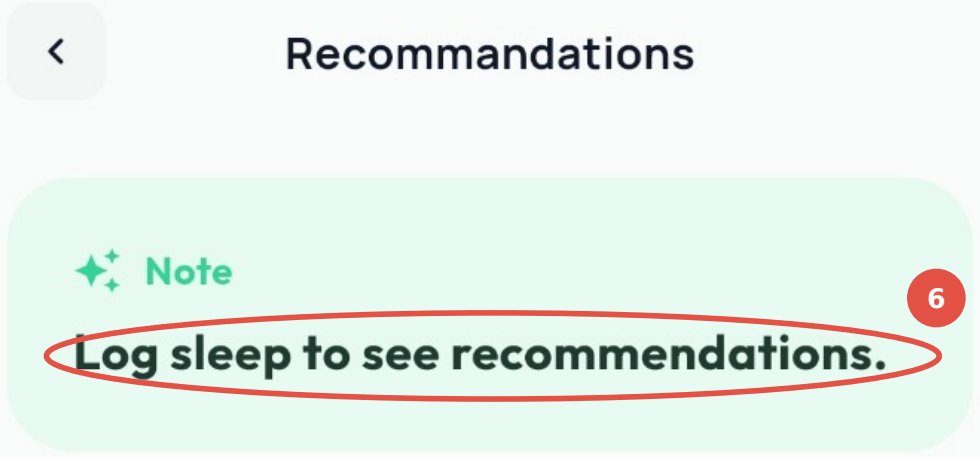

The message is displayed in English while the rest of the interface is in French.

6 Translate the sleep-entry prompt

Replace the English message below when French is selected:

Current message
Log sleep to see recommendations.


French replacement - exact copy
Enregistrez votre dernier sommeil pour voir vos recommandations.

Apply the translation to this empty-state message. Keep the English wording for the English interface.

Sleep: recommended sleep window

08 | Rename the existing card and adjust the morning-shift wake-up buffer.

ORIGINAL SLEEP RECOMMENDATION CARD

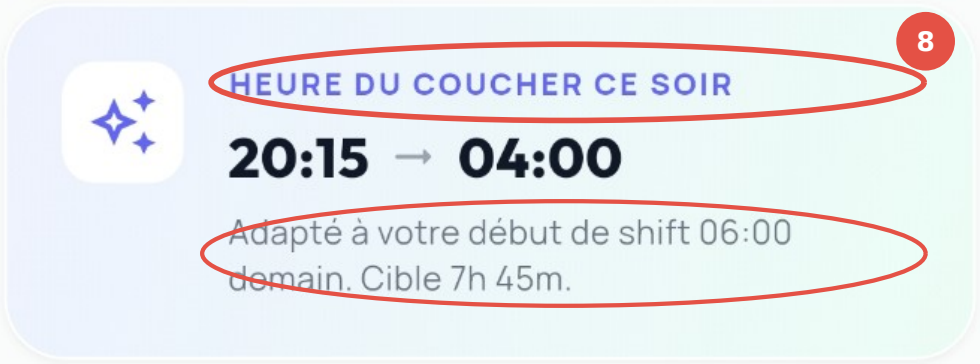

Keep the current design
Retain the **bedtime → wake time** range. Both times must be calculated dynamically by RYVENZA. The screenshot hours are examples, not values to hardcode.

Morning-shift default
Wake time = next shift start - **1 h 30**
Bedtime = wake time - personalized sleep-duration target

Use a 90-minute default buffer for morning shifts, rather than the 2-hour interval illustrated in the screenshot. This is the requested product rule.

8 Update title and explanation

FR title - exact copy
Plage de sommeil recommandée

EN title
Recommended sleep window

FR explanatory text - exact copy
Adaptée à votre prochain shift à [heure du prochain shift].

Objectif : [durée de sommeil calculée] pour favoriser votre récupération avant le travail.

Populate both bracketed fields automatically from the user’s data. Do not display the brackets or fixed example values in the app.

Afternoon and night shifts: continue the existing adaptation to the user’s sleep rhythm and work cycle. Do not apply the morning buffer automatically to these shifts.

Notifications: adapt the sleep reminder

09 | Scope: the reminder to record sleep. Scheduling is automatic.

9 Timing follows the planned wake time

Use the configured work rotation and planned wake time to schedule the **sleep-logging reminder**, instead of a fixed morning delivery time.

Target reminder time
Planned wake time + approximately **20 minutes**

Work days - all shift types
Apply the same principle to morning, afternoon, evening and night shifts. A wake time in the afternoon or evening must be respected.

Rest days
If a planned wake time is known, prioritize it and target wake time + 20 minutes. If no wake time is known, **08h00** may be used as the default.

Unknown wake time on a work day
Use the configured work rotation as a reference to determine suitable timing.

All times refer to the user’s local time zone.

Cancellation and recalculation rules

Already recorded: cancel or suppress the reminder if the sleep it refers to has already been logged.

Planned sleep: do not send during a planned sleep interval. This restriction also applies to the 08h00 fallback.

Changed schedule: recalculate automatically when the rotation or planned wake time changes; replace the outdated pending reminder.

Automatic setup: the user must not have to configure a manual reminder time. Other adaptive notifications retain their existing behavior.

Example with a known planned wake time

Shift starts	**05h00**
Shift ends	**13h00**
Planned wake time	**04h00**
Sleep-logging reminder	**04h20**

Sport: clarify the recovery indicator

10 | Explain the 100% metric, check duplication and localize the retained content.

ORIGINAL SPORT SCREEN



Current English text
Recovery is excellent - ready for high-intensity training.

Provisional French translation, if the card is retained
Récupération excellente : prêt pour un entraînement de haute intensité.

The wording and title should be finalized after the developer explains what the metric actually measures.

10 Explain the meaning of 100%

What exactly does the **100%** represent, and which user data and calculation produce it?

Is this the same indicator, with the same calculation and value, as the recovery bubble on the **Home screen**?

If it is different, what is its specific purpose on the **Sport** screen and how should the user interpret it?

If it duplicates the Home indicator:
Remove this duplicate block from Sport and close the resulting space.


If it is a distinct indicator:
Explain its role, use a clear French title that reflects its meaning, and translate the English explanatory text.

The screenshot alone does not confirm whether the two indicators are identical. The removal request is conditional on that explanation.

Settings: time zone and French profile label

11 + 12 | Add the time-zone entry and translate the profile-edit action.

ORIGINAL SETTINGS / ACCOUNT SECTION

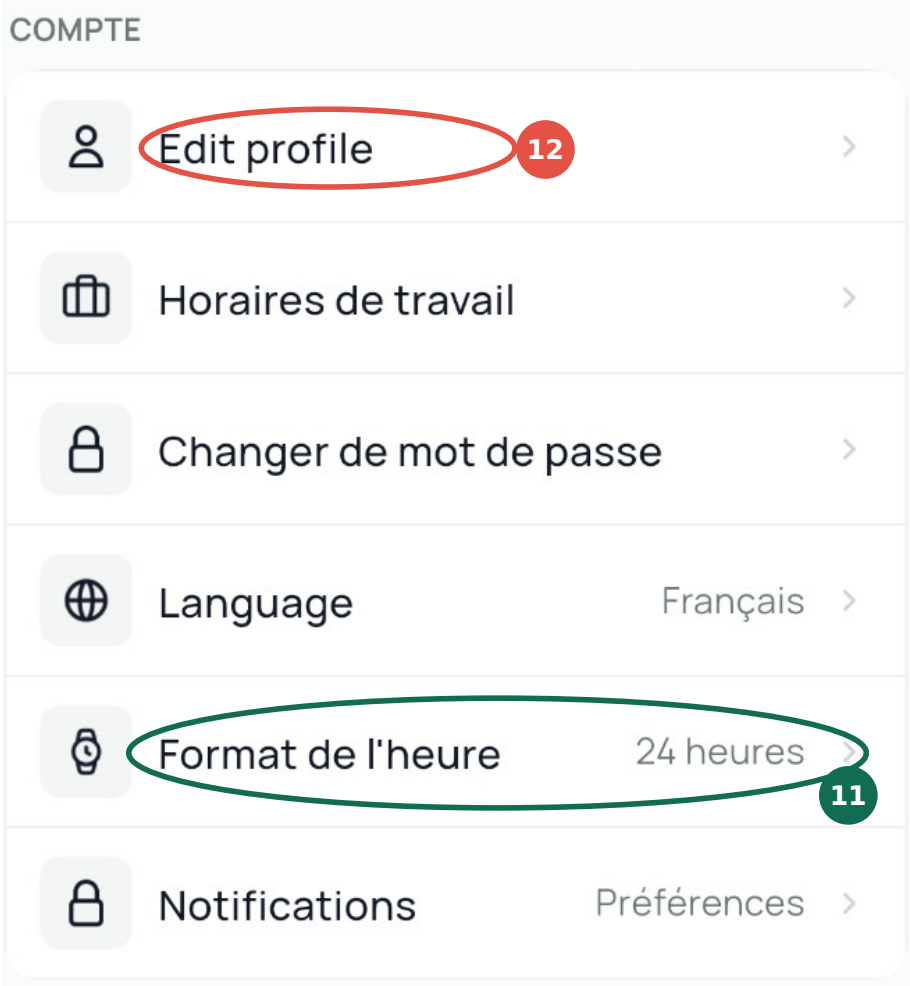

Red: text to translate. Green: position reference for the new time-zone entry.

11 Add a time-zone entry

Expose the **time-zone setting** on this Settings page, near **“Format de l’heure”**. Display the currently configured time zone and provide access to its setting.

FR label: Fuseau horaire
EN label: Time zone
Value: [user’s configured time zone]

12 Translate “Edit profile”

Current label: Edit profile
French replacement: Éditer le profil

Show the French replacement when French is selected as the interface language.