



# TPM-04ES Report

Generators Working Hours  
from 2025-10-06 00:00 to 2025-10-06 23:59 (Europe/Istanbul)

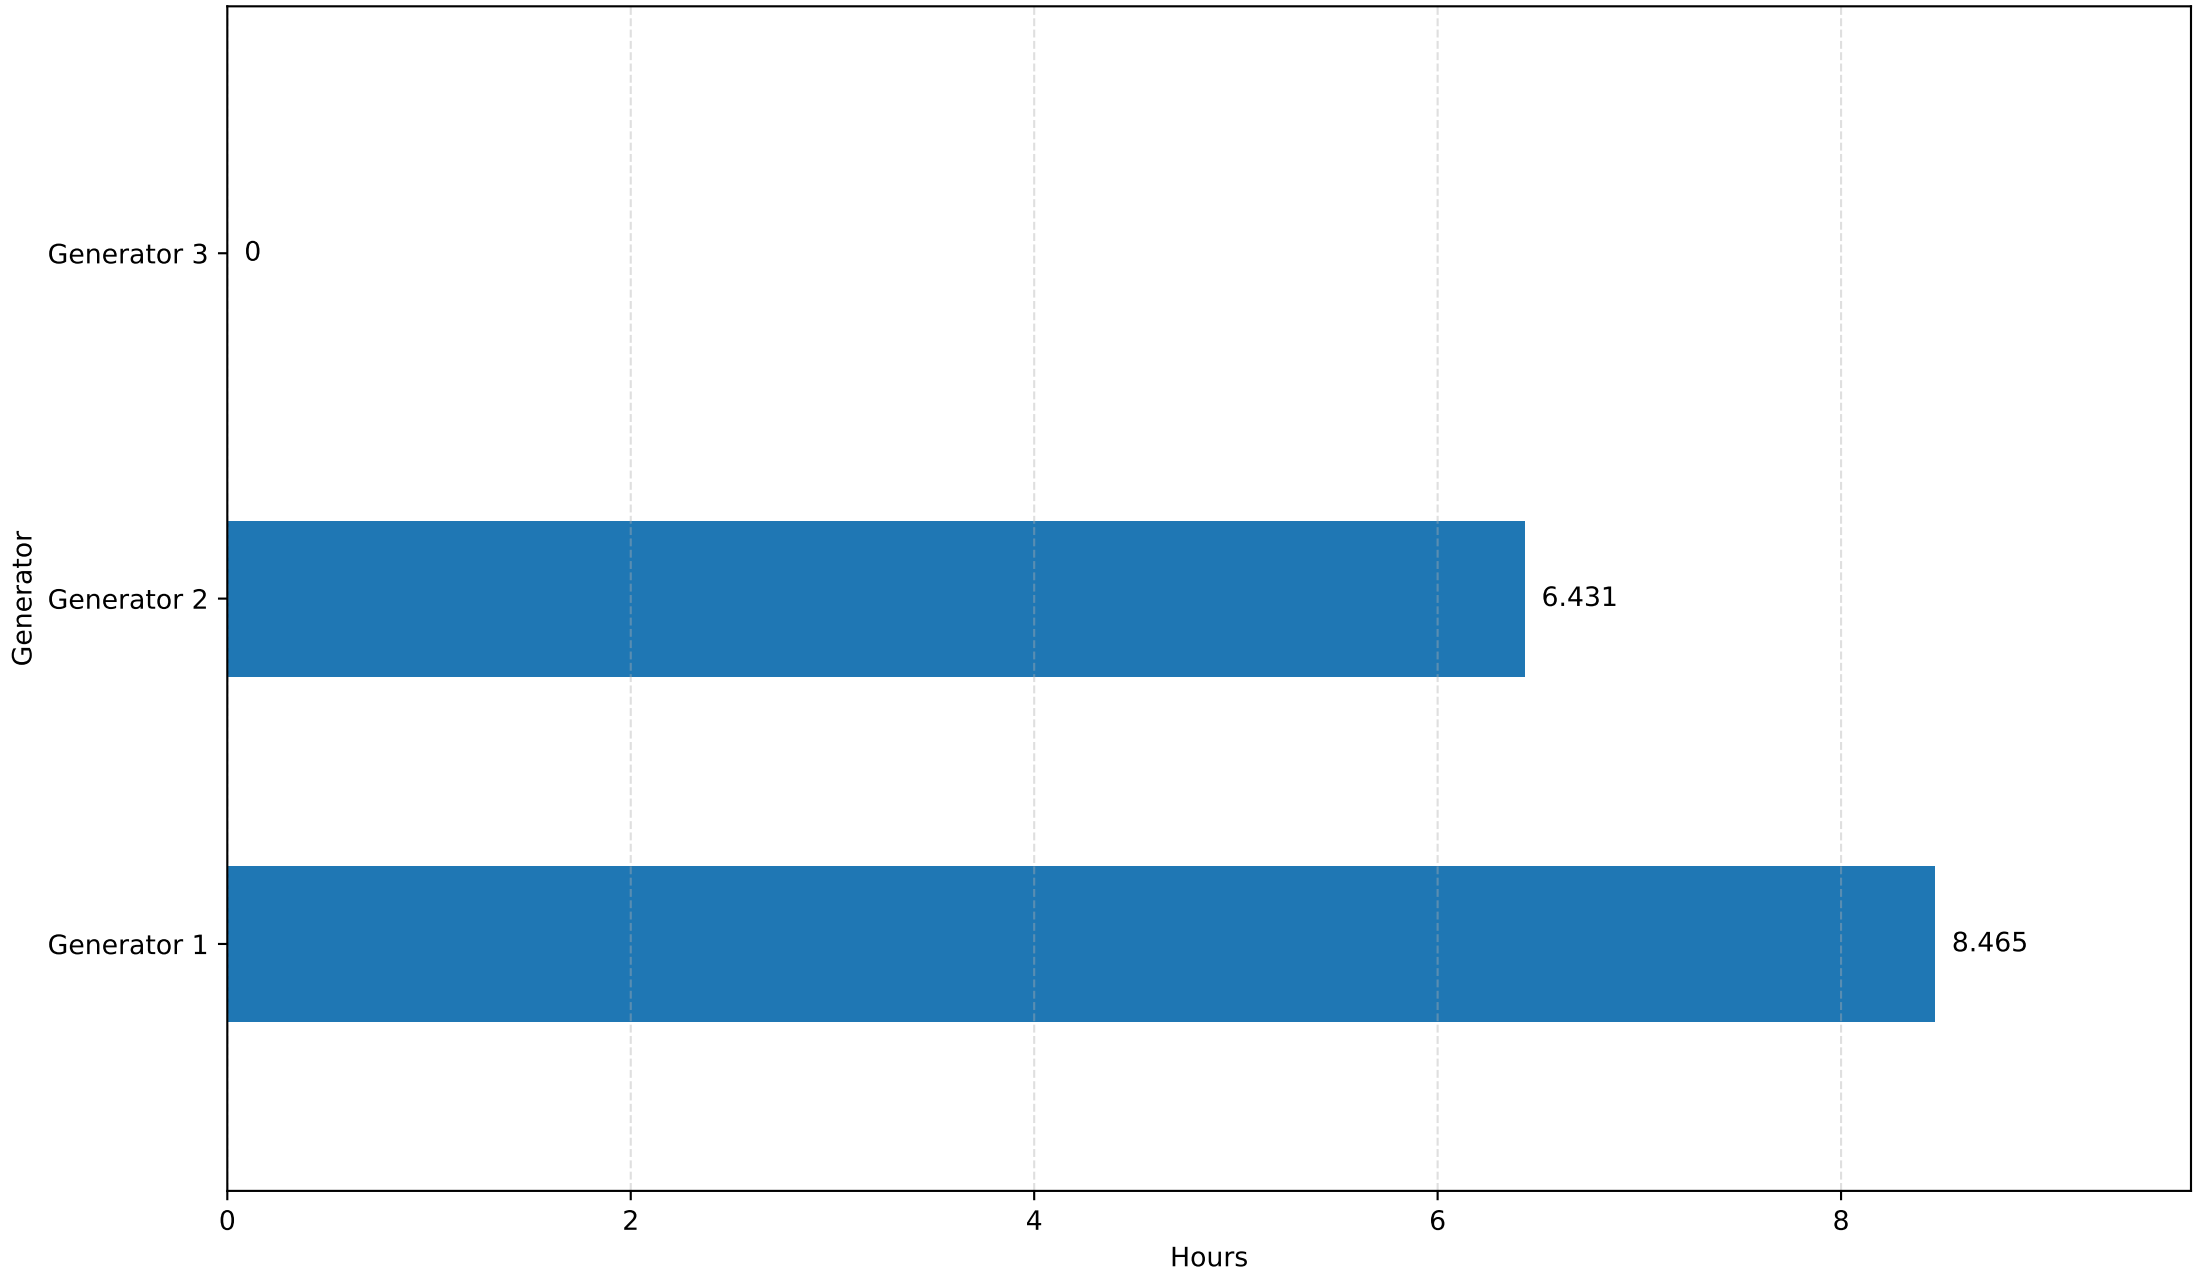

Total Active Power  
from 2025-10-06 00:00 to 2025-10-06 23:59 (Europe/Istanbul)

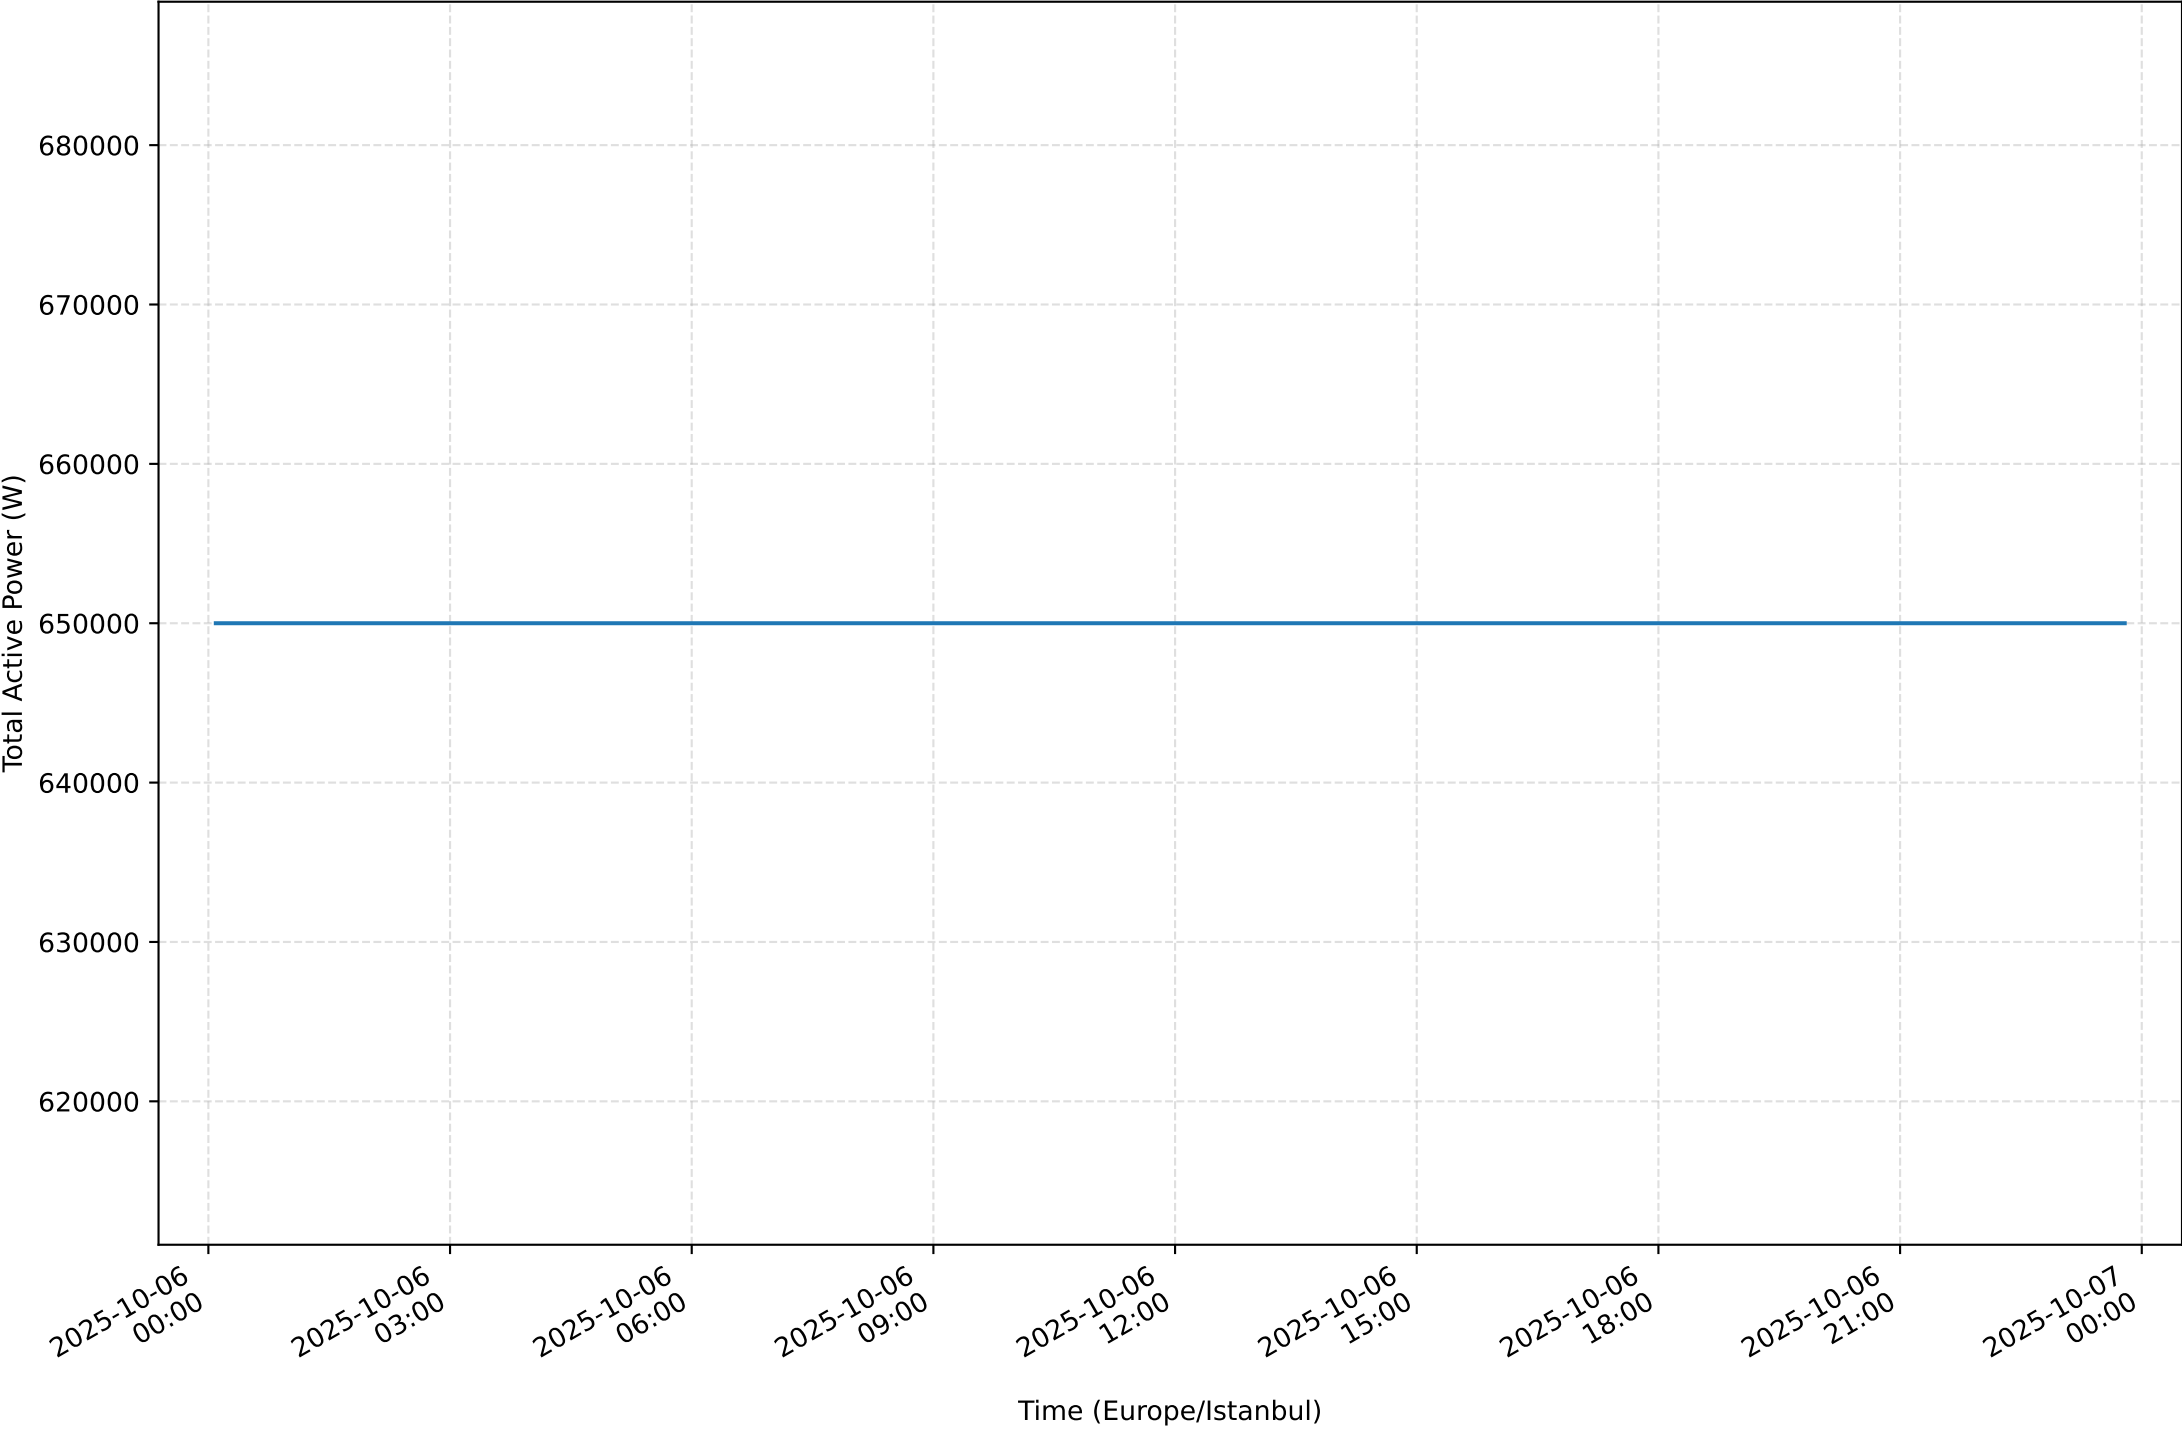

Last readings at 2025-10-06 23:47:18 (Europe/Istanbul)

Reading	Value
L1 Active Power	250000
L1 Apparent Power	260000
L1 Current	1.23
L1 Frequency	50.0
L1 Power Factor	0.98
L1 Reactive Power	50000
L1 Voltage	230.4
L2 Active Power	190000
L2 Apparent Power	200000
L2 Current	0.99
L2 Frequency	50.0
L2 Power Factor	0.99
L2 Reactive Power	30000
L2 Voltage	229.9
L3 Active Power	210000
L3 Apparent Power	220000
L3 Current	1.11
L3 Frequency	50.0
L3 Power Factor	0.99
L3 Reactive Power	20000
L3 Voltage	230.2
Neutral Current	0.12
Total Active Export Energy	0
Total Active Import Energy	1000000
Total Active Power	650000
Total Apparent Energy	1250000
Total Apparent Power	680000
Total Capacitive Energy	0
Total Inductive Energy	50000
Total Power Factor	0.99
Total Reactive Power	100000
gen1	0
gen2	1
gen3	1
genhours	{'Generator 1': '13:19', 'Generator 2': '9:25', 'Generator 3': '4:00'}