



TPM-04ES Report


Generators Working Hours
from 2025-10-05 00:00 to 2025-10-05 23:59 (Europe/Istanbul)

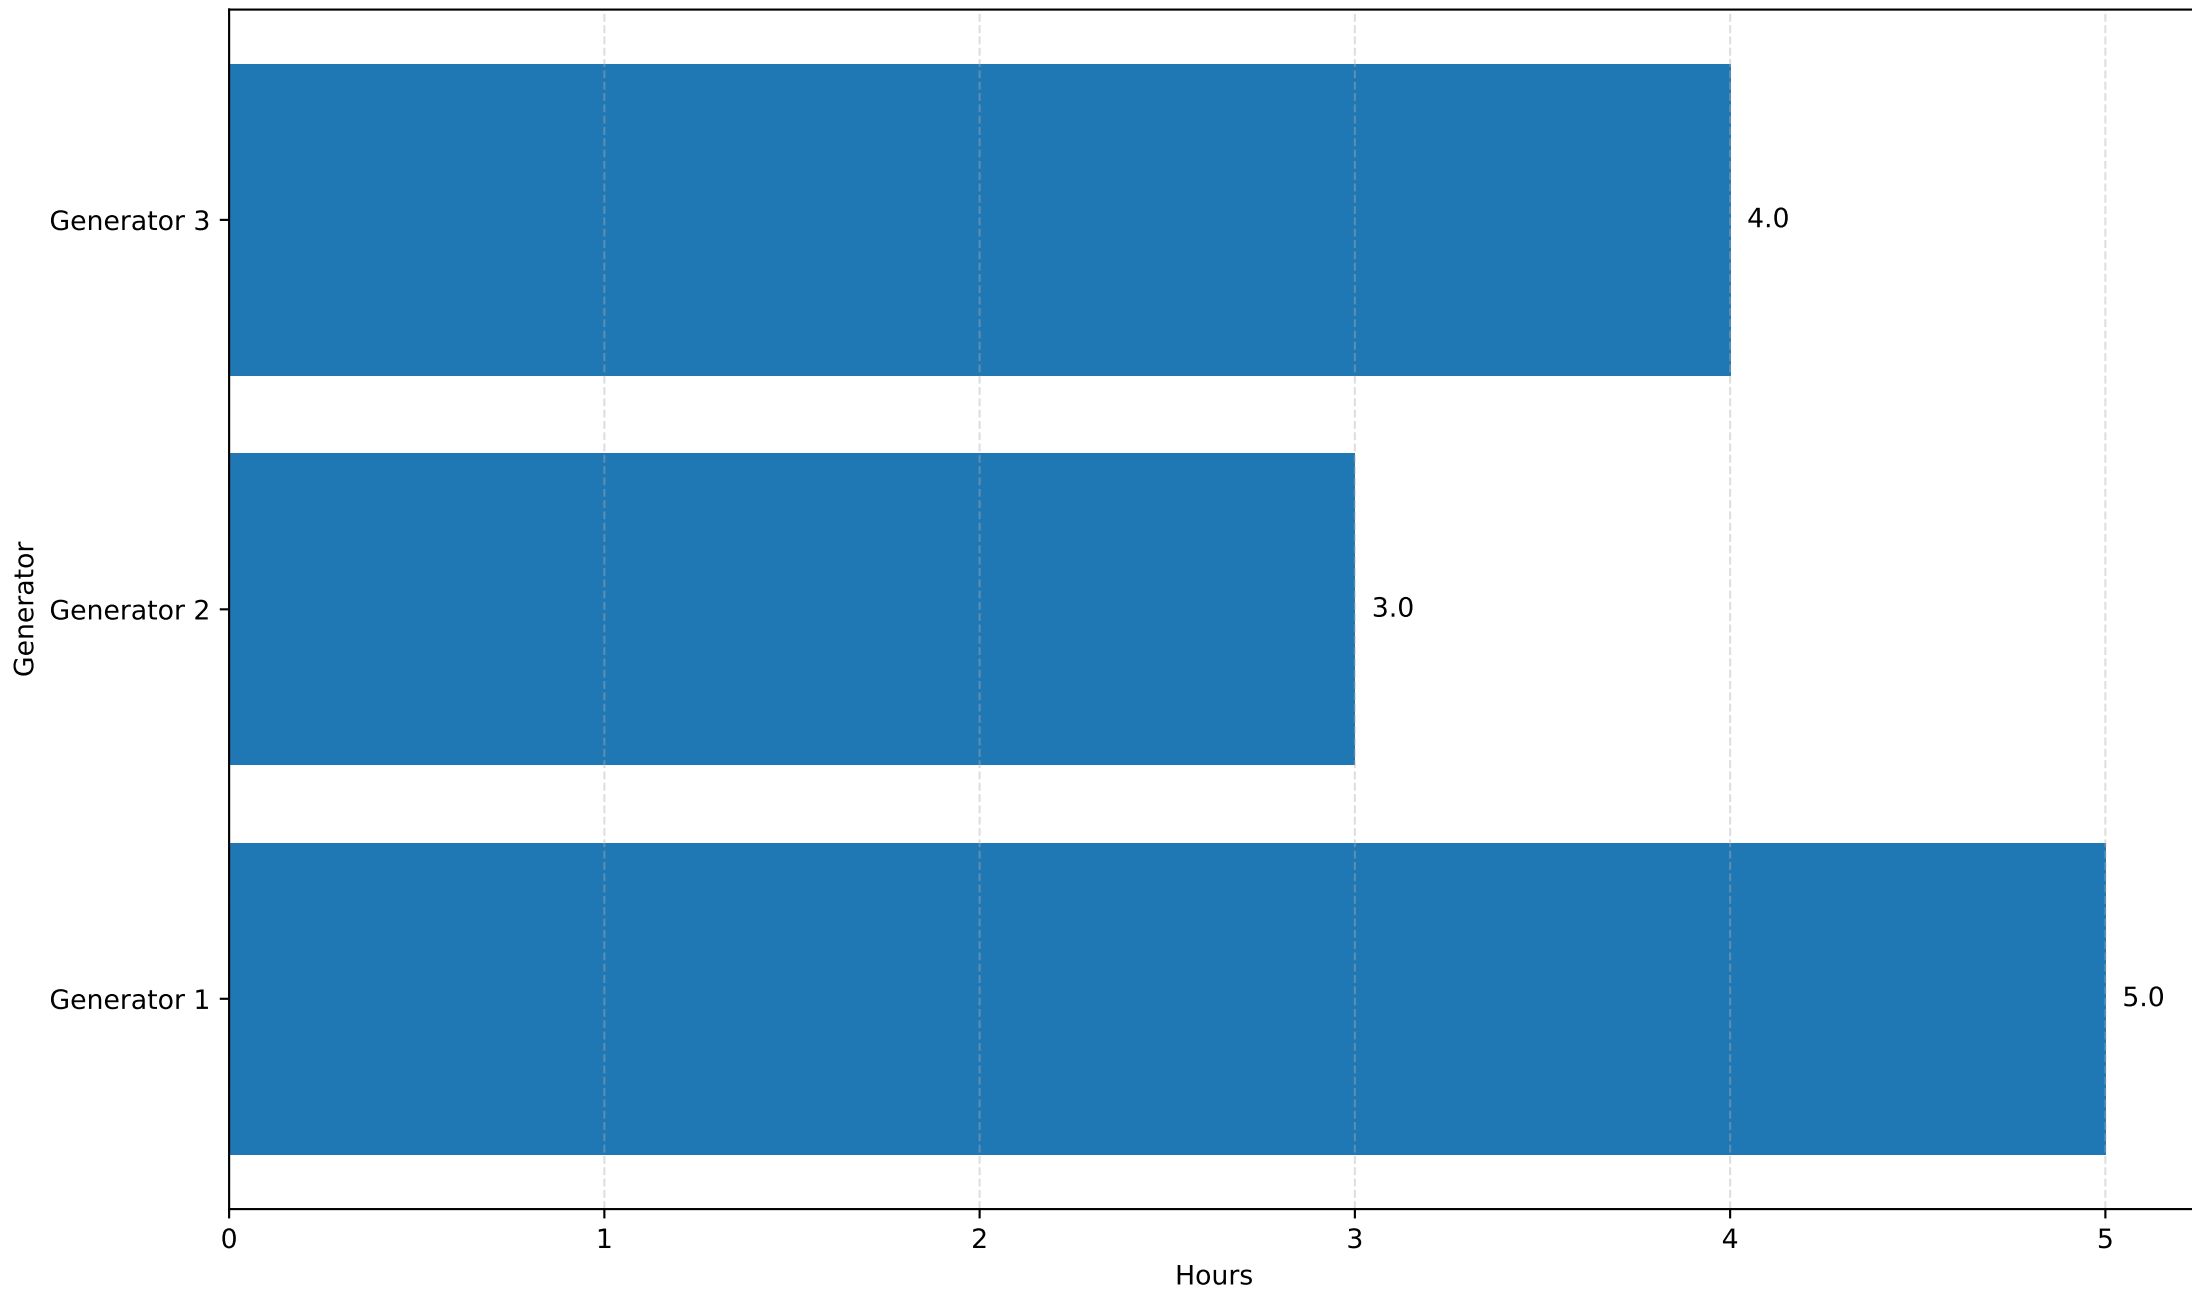

Total Active Power
from 2025-10-05 00:00 to 2025-10-05 23:59 (Europe/Istanbul)

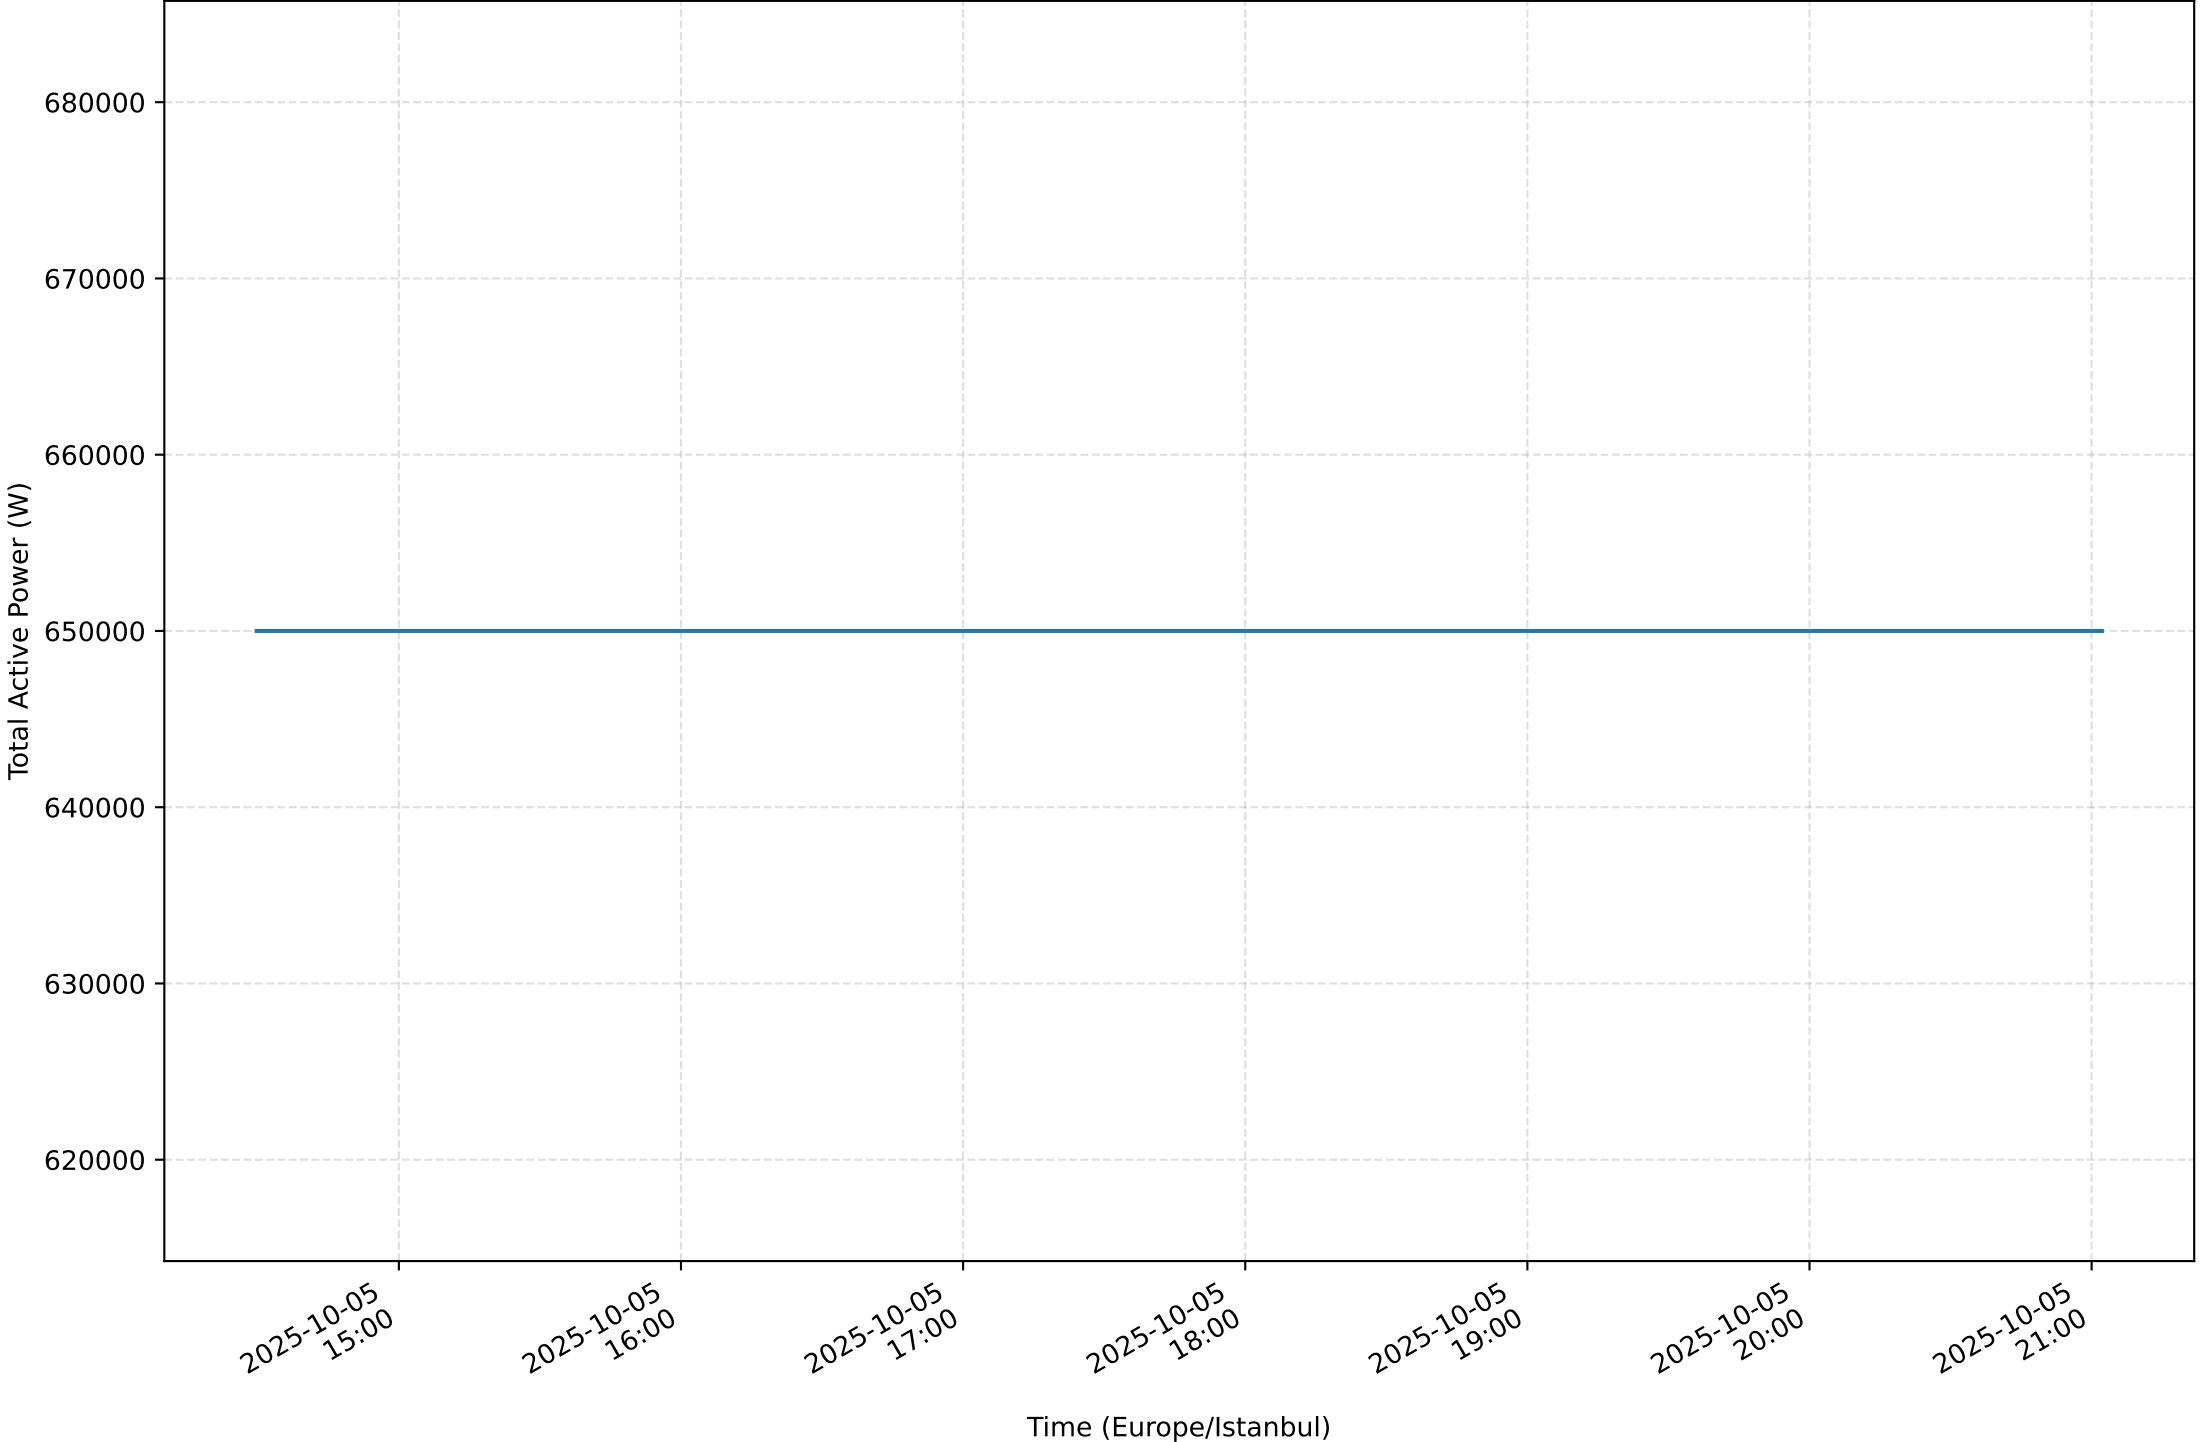

Total Active Import Energy
from 2025-10-05 00:00 to 2025-10-05 23:59 (Europe/Istanbul)

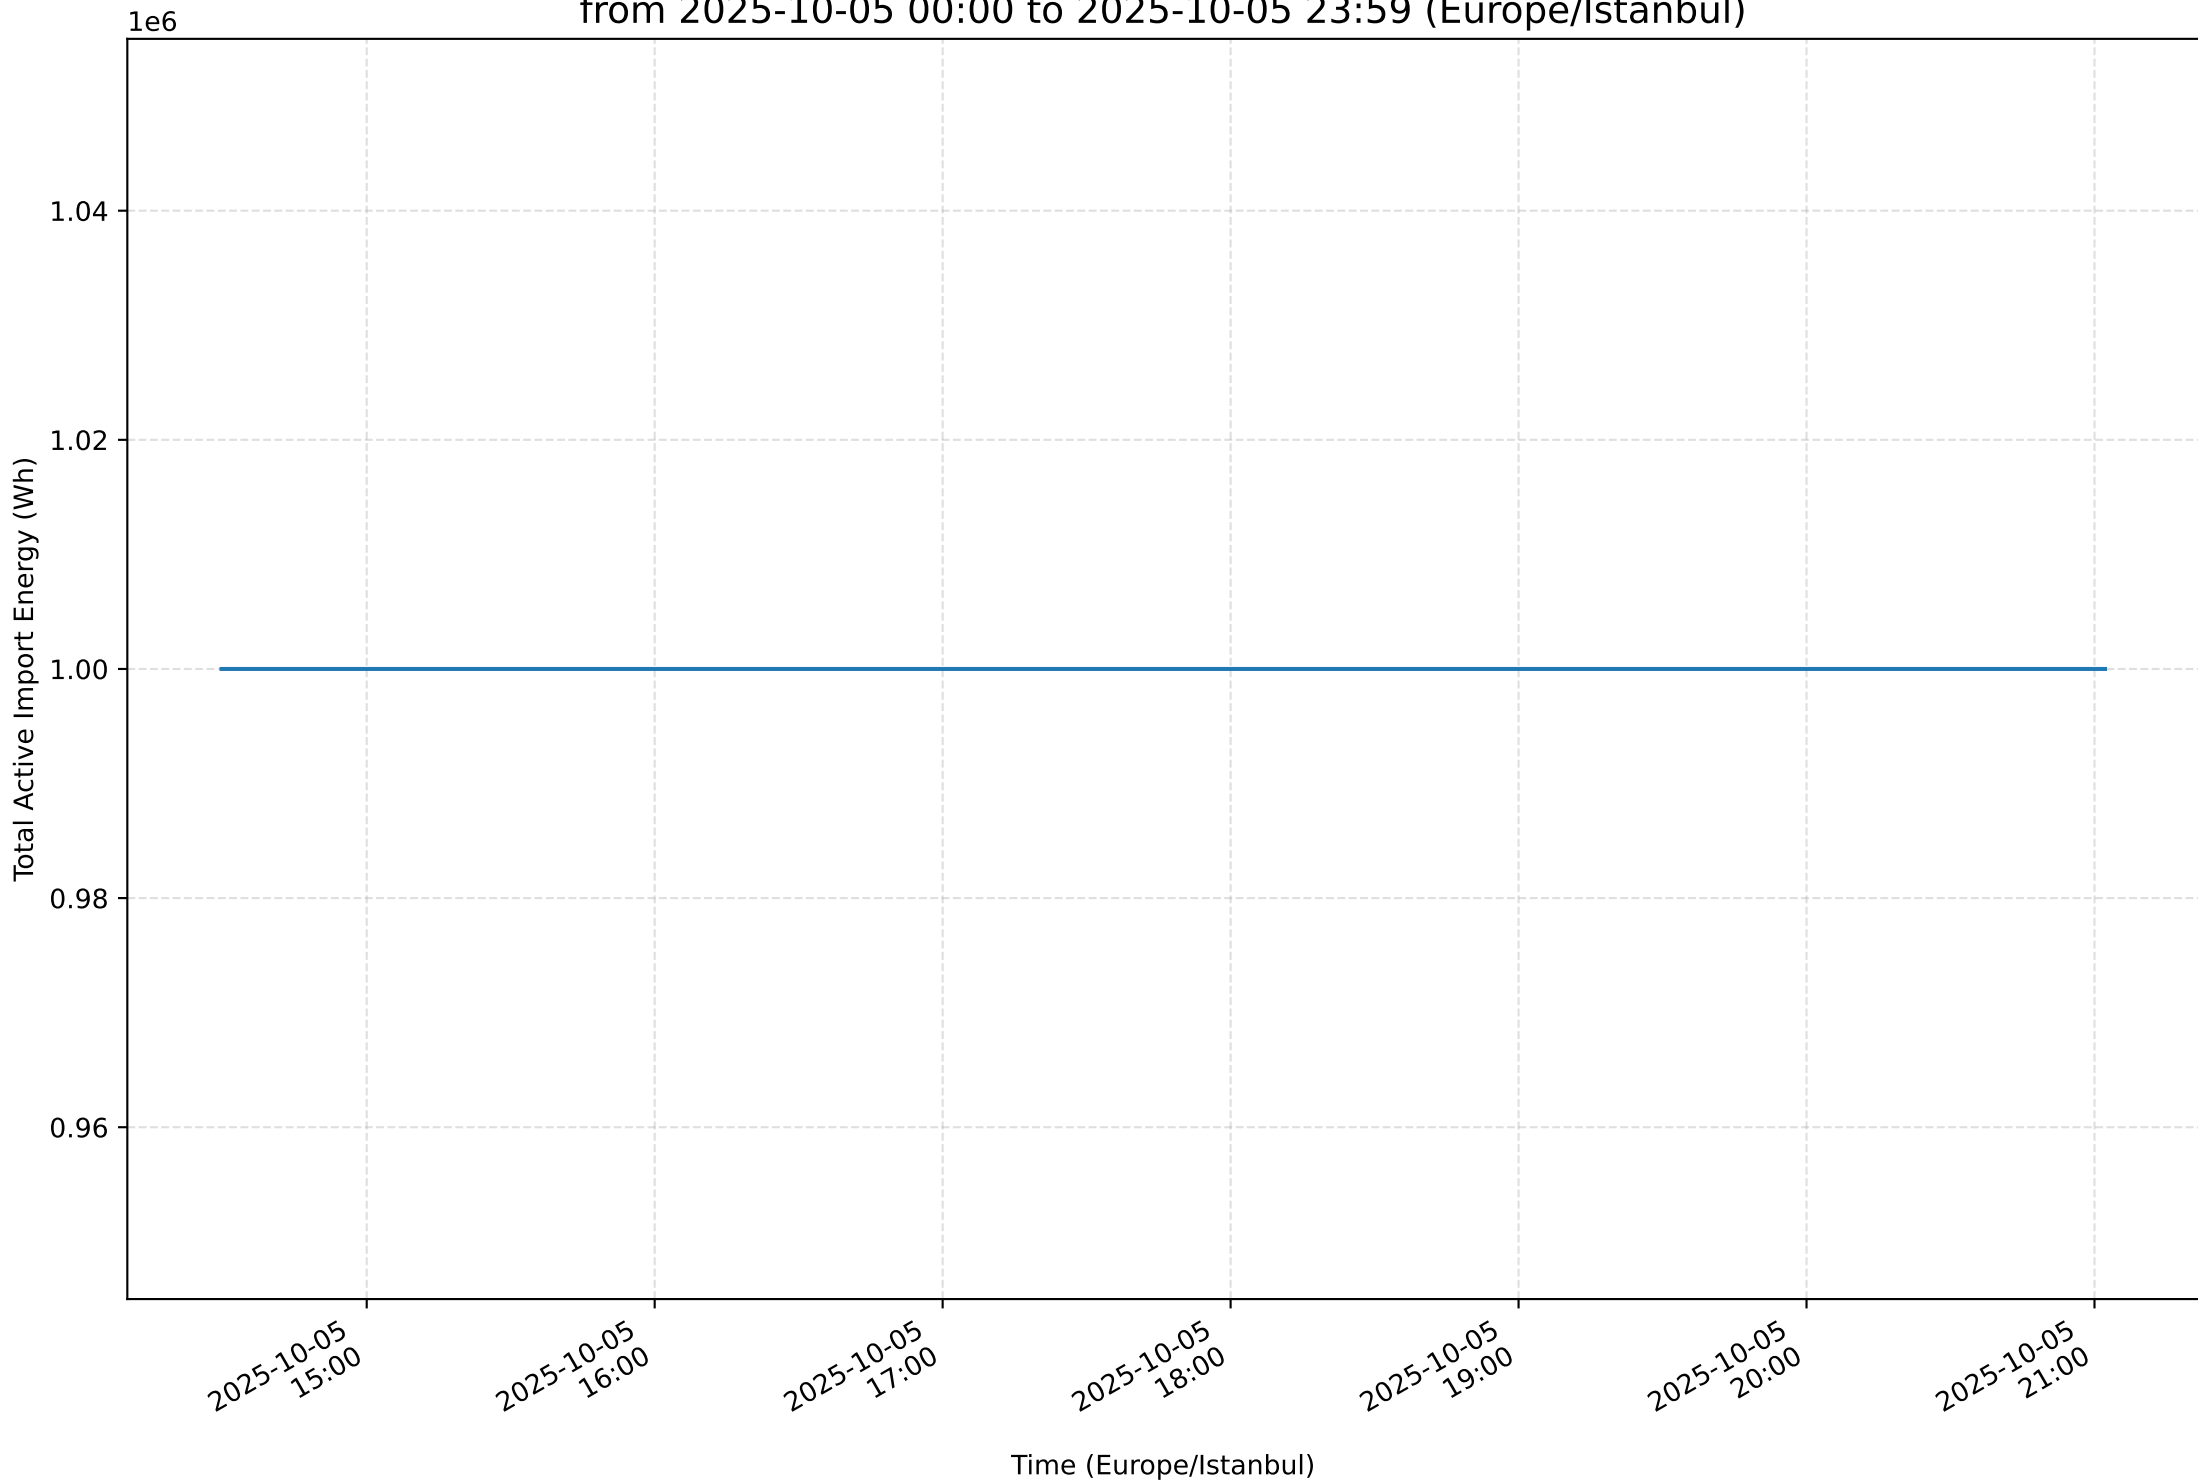

Last readings at unknown (Europe/Istanbul)

| Reading | Value |
|----------------------------|---------|
| L1 Active Power | 250000 |
| L1 Apparent Power | 260000 |
| L1 Current | 1.23 |
| L1 Frequency | 50.0 |
| L1 Power Factor | 985 |
| L1 Reactive Power | 50000 |
| L1 Voltage | 230.4 |
| L2 Active Power | 190000 |
| L2 Apparent Power | 200000 |
| L2 Current | 0.99 |
| L2 Frequency | 50.0 |
| L2 Power Factor | 990 |
| L2 Reactive Power | 30000 |
| L2 Voltage | 229.9 |
| L3 Active Power | 210000 |
| L3 Apparent Power | 220000 |
| L3 Current | 1.11 |
| L3 Frequency | 50.0 |
| L3 Power Factor | 988 |
| L3 Reactive Power | 20000 |
| L3 Voltage | 230.2 |
| Neutral Current | 0.12 |
| Total Active Export Energy | 0 |
| Total Active Import Energy | 1000000 |
| Total Active Power | 650000 |
| Total Apparent Energy | 1250000 |
| Total Apparent Power | 680000 |
| Total Capacitive Energy | 0 |
| Total Inductive Energy | 50000 |
| Total Power Factor | 988 |
| Total Reactive Power | 100000 |