



Study	OR	95% CI
-------	----	--------


### Chlorine

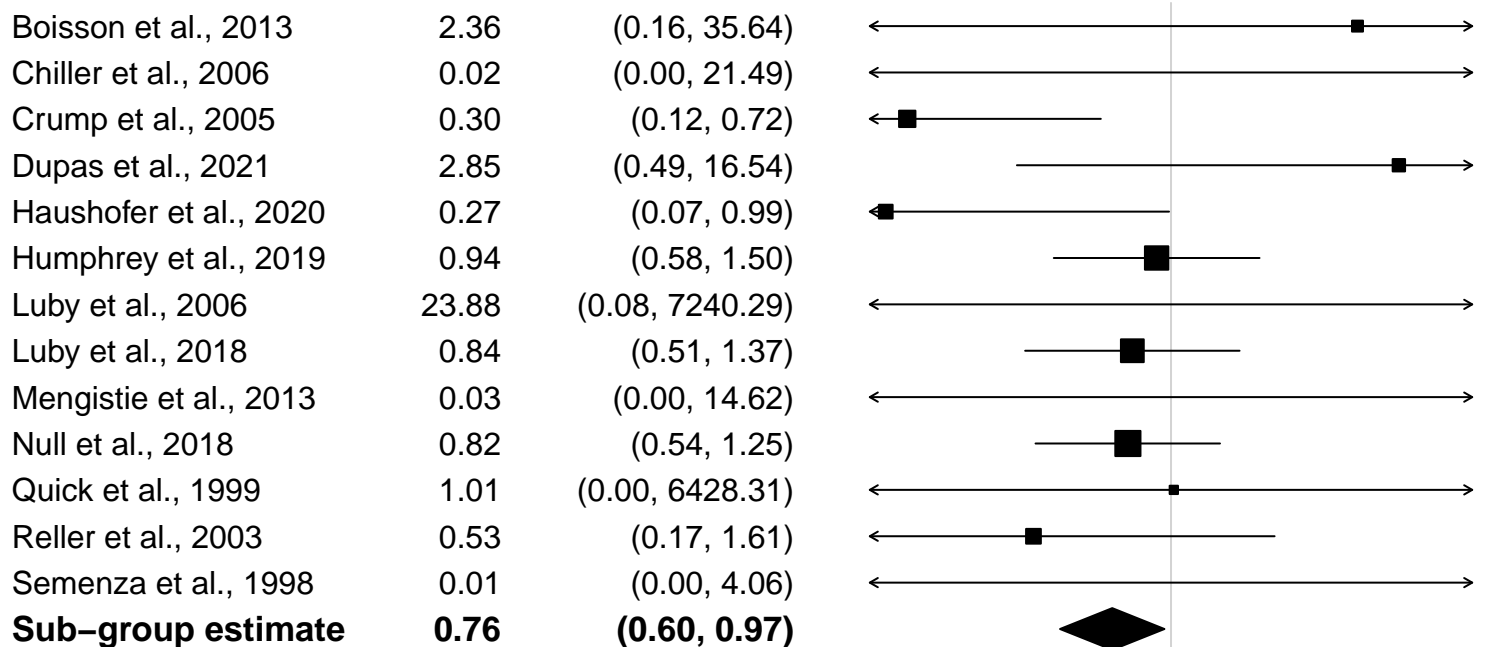


### Filtration

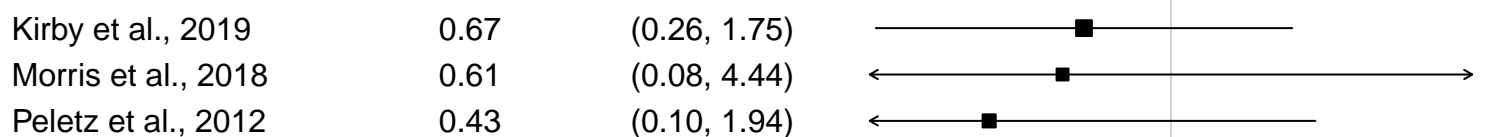

### Spring protection



### Solar disinfection



<b>Overall estimate</b>	<b>0.75</b>	<b>(0.60, 0.92)</b>	
-------------------------	-------------	---------------------	--

0.25 0.35 0.50 0.71 1.0 1.41 4.0