



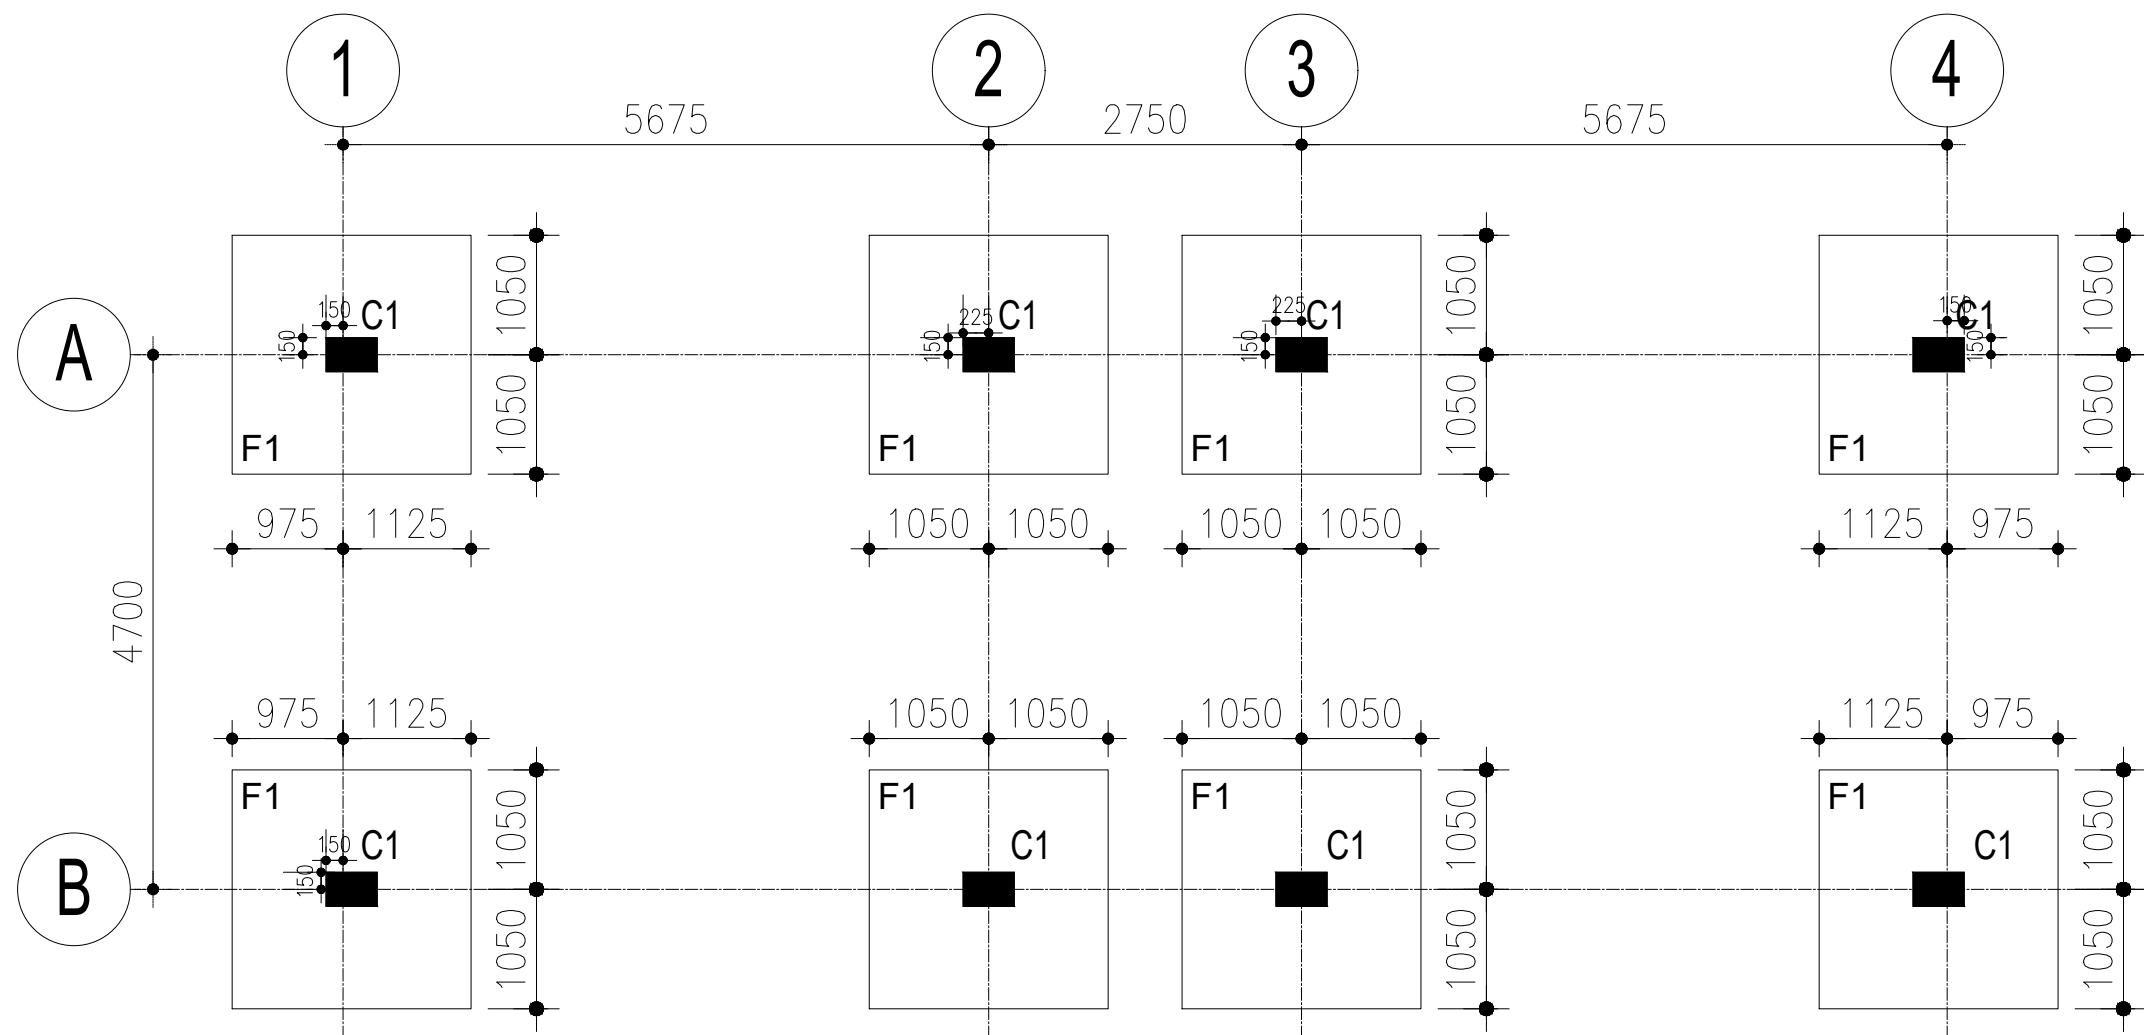

1 FOUNDATION LAYOUT
SCALE 1:100

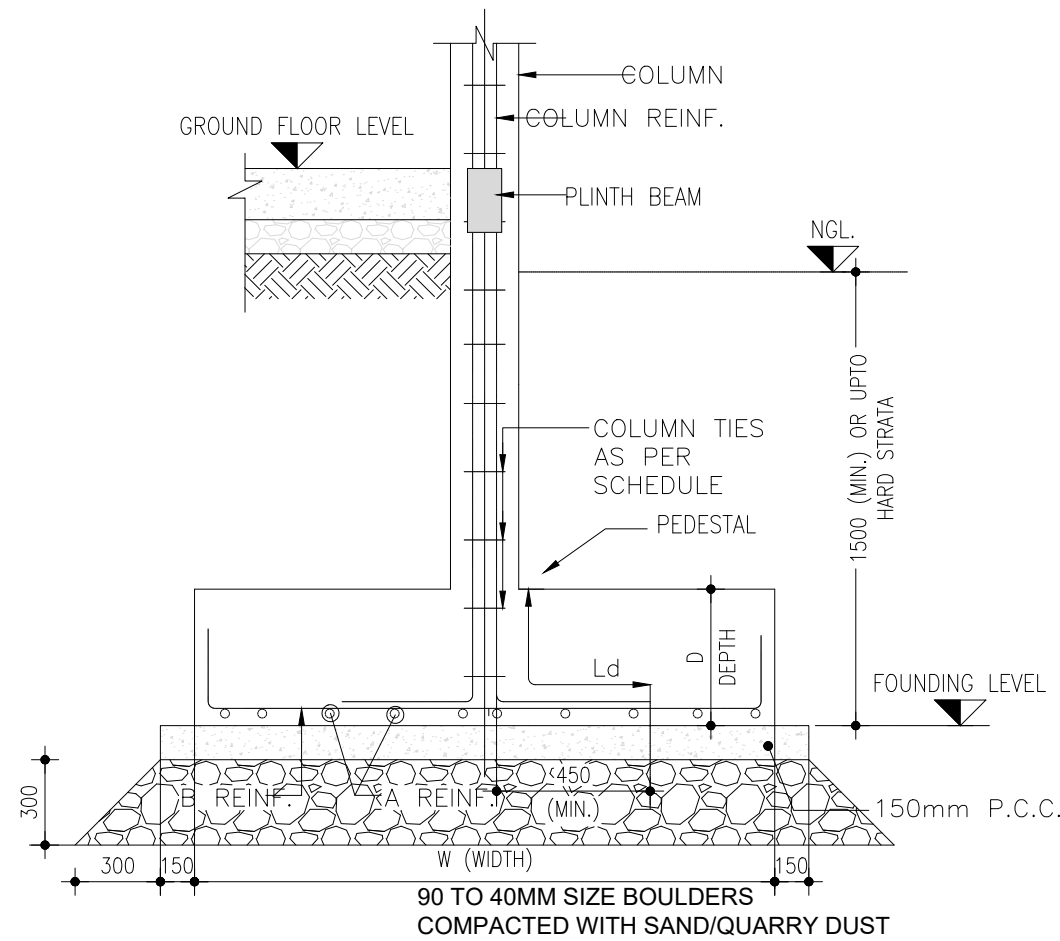



3 SECTION X
SCALE 1:25

(FOR DIMENSIONS REFER TO FOOTING SCHEDULE)

NOTE: 1. SIZE STONE LAYERS BELOW THE FOOTING IS TO BE LAID AFTER EXCAVATING AND OMPACTING THE SAME AS PER THE STANDARD PROCEDURE

SCHEDULE OF FOOTINGS

FOOTING MARK	SIZE			BOTTOM REINFORCEMENT	
	LENGTH (L)	WIDTH (W)	DEPTH (D)	A	B
F1	2100	2100	450	Y10@125	Y10@125

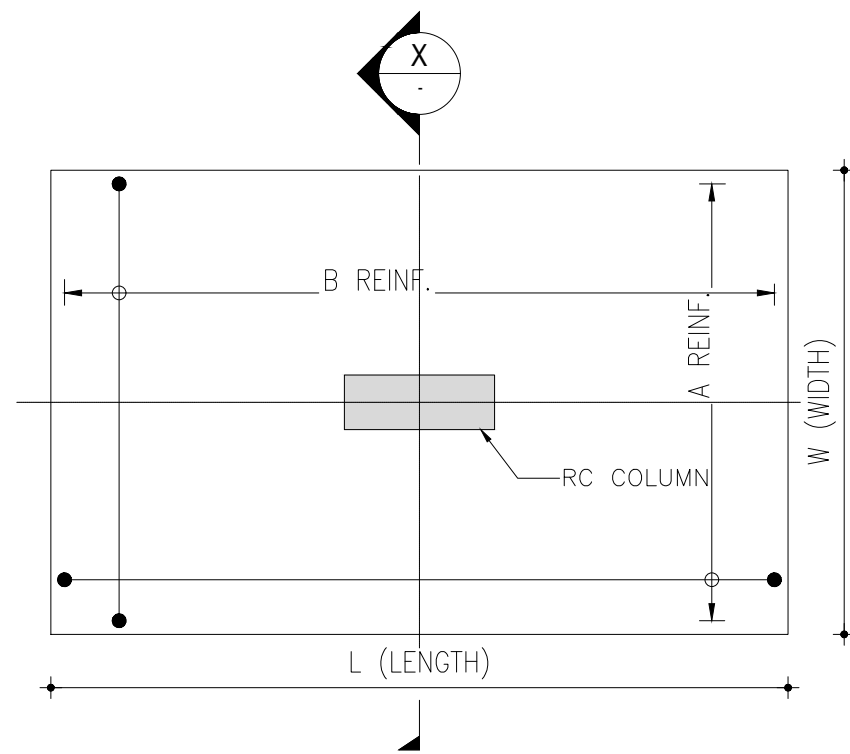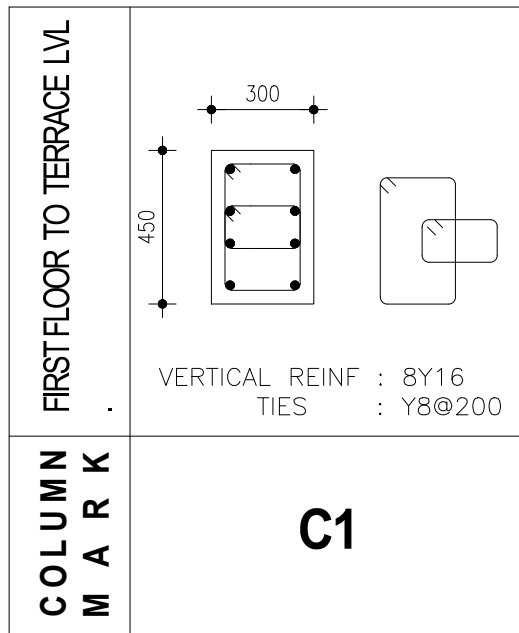

2 TYPICAL PLAN OF FOOTING
SCALE 1:35

(FOR DIMENSIONS REFER TO FOOTING SCHEDULE)

GENERAL NOTES:

- DO NOT SCALE FROM THE DRAWINGS. FOLLOW WRITTEN DIMENSIONS ONLY.
- ALL DIMENSIONS ARE IN MM AND LEVELS IN METRES UNLESS NOTED OTHERWISE.
- ALL DIMENSIONS TO BE VERIFIED ON SITE BEFORE EXECUTION & APPROVED BY THE ENGINEER.
- EXECUTION OF THE WORKS SHALL BE CARRIED BY QUALIFIED PERSONNEL ONLY. ANY DISCREPANCY IN SITE SHALL BE BROUGHT TO THE NOTICE OF THE CONSULTANTS PRIOR TO THE EXECUTION.

Rev.No:-	Date:-
----------	--------

DESIGNER: CONSULTANT:

DESIGN VETTED BY:

ASSISTANT ENGINEER

ASSISTANT EXECUTIVE ENGINEER
PORT AND FISHERIES SUB DIVISION,
UDUPI

EXECUTIVE ENGINEER
PORT AND FISHERIES SUB DIVISION,
UDUPI

SUPERINTENDENT ENGINEER,
PORT AND FISHERIES SUB DIVISION,
KARWAR

CHIEF ENGINEER AND MEMBER (TECHNICAL)
PORT AND FISHERIES SUB DIVISION,
KARWAR

Issued For :-

GOOD FOR CONSTRUCTION

STRUCTURAL CONSULTANT

TECHMILLENNIALS PVT. LTD.
#10, NITK STEP,
NITK SURATHKAL,
MANGALURU - 575025

Dwg by :-	AJ	Scale :-	AM
Clk by :-	PS	Sheet size :-	A2

Client :-

EXECUTIVE ENGINEER
PORTS AND FISHERIES SUB DIVISION,
UDUPI

Name of the Project :-

MODERNISATION AND
UPGRADATION OF MALPE
FISHERY HARBOUR

DRAWING TITLE :-

ENTRANCE GATE AND GUARD ROOM 1 OF 2
(FOUNDATION AND COLUMN DETAILS)

DEPARTMENT



Infrastructure Development Ports & IWT Department,
Karnataka Maritime Board

DATE NO: 16-07-24	DWG. NO:TEMPLATE/19-7/24/SD-001	REV: R0
-------------------	---------------------------------	---------

NOTES:

- GRADE OF CONCRETE SHALL BE M25 FOR ALL R.C.C WORKS.
- T/Y DENOTES HYSD TMT BARS OF GRADE Fe 550 CONFORMING TO IS 1786-1985.
- LAP LENGTH SHALL BE 50 TIMES DIA OF THE BAR AND TO BE STAGGERED SUCH THAT NOT MORE THAN 50% OF THE BARS ARE LAPPED AT A SECTION.
- CLEAR COVER TO THE REINFORCEMENT :
FOOTING/WALL : 50 mm
COLUMNS : 40 mm
SLAB : 25 mm
BEAM : 30 mm
- DEVELOPMENT LENGTH SHALL BE 50 TIMES THE DIA. OF THE BAR.
- IMPROVED S.B.C OF SOIL CONSIDERED IS 10 T/m²
- STRUCTURE IS DESIGNED FOR SEISMIC ZONE III AND WIND FORCES AS PER IS 1893:2016 & IS 875:2015 RESPECTIVELY.
- STRUCTURE IS DESIGNED FOR GROUND+1STORIE+LIGHTWEIGHT ROOF