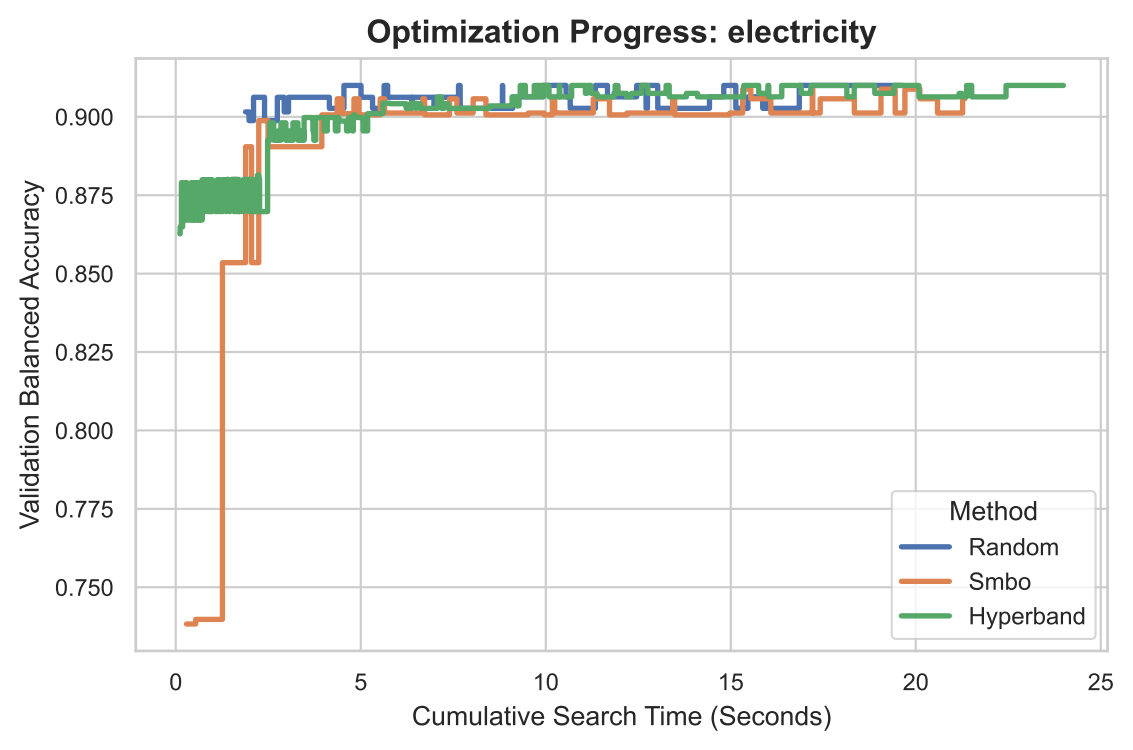
Optimization Progress: electricity
Validation Balanced Accuracy
0.900
0.875
0.850
0.825
0.800
0.775
0.750
0
5
10
15
20
25
Cumulative Search Time (Seconds)
Method
Random
Smbo
Hyperband